



### Installation Instructions

#### **TABLE OF CONTENTS**

Pa	ge
SAFETY CONSIDERATIONS	1
INTRODUCTION	
General	
Job Data	
INSTALLATION	
Step 1 — Receive the Machine	
-	. 3
<ul><li>INSPECT SHIPMENT</li><li>IDENTIFY MACHINE</li></ul>	
INSTALLATION REQUIREMENTS	
<ul> <li>PROVIDE MACHINE PROTECTION</li> </ul>	
Step 2 — Rig the Machine	4
<ul> <li>RIG MACHINE ASSEMBLY</li> </ul>	
19XR2-E RIG MACHINE COMPONENTS     19XP (77 PMC MACHINE COMPONENTS)	
• 19XR6/7 RIG MACHINE COMPONENTS	-0
Step 3 — Install Machine Supports	ΣÖ
<ul><li>INSTALL STANDARD ISOLATION</li><li>INSTALL ACCESSORY ISOLATION (IF REQUIRED)</li></ul>	
• INCTALL CODING ION ATION	
Step 4 — Connect Piping	60
• INSTALL WATER PIPING TO HEAT EXCHANGERS	
<ul> <li>INSTALL VENT PIPING TO RELIEF VALVES</li> </ul>	
<ul> <li>INSTALL CIRCUIT BREAKER HANDLE EXTENSION</li> </ul>	V
— 19XR2-E (FIG. 47)	~~
Step 5 — Make Electrical Connections	აგ
<ul><li>CONNECT CONTROL INPUTS</li><li>CONNECT CONTROL OUTPUTS</li></ul>	
CONNECT CONTROL OUTFUTS     CONNECT STARTER	
FIELD WIRING	
<ul> <li>CARRIER COMFORT NETWORK INTERFACE</li> </ul>	
Step 6 — Install Field Insulation10	)5
• 19XR	
• 19XRV	
INSTALLATION START-UP REQUEST	_
CHECKLISTCL	-1

#### SAFETY CONSIDERATIONS

Centrifugal liquid chillers are designed to provide safe and reliable service when operated within design specifications. When operating this equipment, use good judgment and safety precautions to avoid damage to equipment and property or injury to personnel. Be sure you understand and follow the procedures and safety precautions contained in the machine instructions, as well as those listed in this guide.

#### **ADANGER**

Failure to follow these procedures will result in severe personal injury or death.

DO NOT VENT refrigerant relief devices within a building. Outlet from rupture disc or relief valve must be vented outdoors in accordance with the latest edition of ANSI/ASHRAE 15 (American National Standards Institute/American Society of Heating, Refrigerating and Air-Conditioning Engineers) (Safety Code for Mechanical Refrigeration). The accumulation of refrigerant in an enclosed space can displace oxygen and cause asphyxiation.

PROVIDE adequate ventilation in accordance with ANSI/ASHRAE 15, especially for enclosed and low overhead spaces. Inhalation of high concentrations of vapor is harmful and may cause heart irregularities, unconsciousness, or death. Intentional misuse can be fatal. Vapor is heavier than air and reduces the amount of oxygen available for breathing. Product causes eye and skin irritation. Decomposition products are hazardous.

DO NOT USE OXYGEN to purge lines or to pressurize a machine for any purpose. Oxygen gas reacts violently with oil, grease, and other common substances.

DO NOT USE air to leak test. Use only refrigerant or dry nitrogen.

NEVER EXCEED specified test pressures. VERIFY the allowable test pressure by checking the instruction literature and the design pressures on the equipment nameplate.

DO NOT VALVE OFF any safety device.

BE SURE that all pressure relief devices are properly installed and functioning before operating any machine.

RISK OF INJURY OR DEATH by electrocution. High voltage is present on motor leads even though the motor is not running when a solid state or inside-delta mechanical starter is used. Open the power supply disconnect before touching motor leads or terminals.

#### **MARNING**

Failure to follow these procedures may result in personal injury or death.

DO NOT USE TORCH to remove any component. System contains oil and refrigerant under pressure.

To remove a component, wear protective gloves and goggles and proceed as follows:

- 1. Shut off electrical power to unit.
- 2. Recover refrigerant to relieve all pressure from system using both high-pressure and low pressure ports.
- Traces of vapor should be displaced with nitrogen and the work area should be well ventilated. Refrigerant in contact with an open flame produces toxic gases.
- 4. Cut component connection tubing with tubing cutter and remove component from unit. Use a pan to catch any oil that may come out of the lines and as a gage for how much oil to add to the system.
- 5. Carefully unsweat remaining tubing stubs when necessary. Oil can ignite when exposed to torch flame.

DO NOT USE eyebolts or eyebolt holes to rig machine sections or the entire assembly.

DO NOT work on high-voltage equipment unless you are a qualified electrician.

DO NOT WORK ON electrical components, including control panels, switches, starters, or oil heater until you are sure ALL POWER IS OFF and no residual voltage can leak from capacitors or solid-state components.

LOCK OPEN AND TAG electrical circuits during servicing. IF WORK IS INTERRUPTED, confirm that all circuits are de-energized before resuming work.

AVOID SPILLING liquid refrigerant on skin or getting it into the eyes. USE SAFETY GOGGLES. Wash any spills from the skin with soap and water. If liquid refrigerant enters the eyes, IMMEDIATELY FLUSH EYES with water and consult a physician.

NEVER APPLY an open flame or live steam to a refrigerant cylinder. Dangerous over pressure can result. When it is necessary to heat refrigerant, use only warm (110°F [43°C]) water.

DO NOT REUSE disposable (nonreturnable) cylinders or attempt to refill them. It is DANGEROUS AND ILLEGAL. When cylinder is emptied, evacuate remaining gas pressure, loosen the collar, and unscrew and discard the valve stem. DO NOT INCINERATE.

CHECK THE REFRIGERANT TYPE before adding refrigerant to the machine. The introduction of the wrong refrigerant can cause machine damage or malfunction.

Operation of this equipment with refrigerants other than those cited herein should comply with ANSI/ASHRAE 15 (latest edition). Contact Carrier for further information on use of this machine with other refrigerants.

BEFORE ADDING OIL to the compressor, be sure to check the oil type. Using the wrong type of oil could result in damage to the unit.

DO NOT ATTEMPT TO REMOVE fittings, covers, etc., while machine is under pressure or while machine is running. Be sure pressure is at 0 psig (0 kPa) before breaking any refrigerant connection.

CAREFULLY INSPECT all relief valves, rupture discs, and other relief devices AT LEAST ONCE A YEAR. If machine operates in a corrosive atmosphere, inspect the devices at more frequent intervals.

#### **↑** WARNING

DO NOT ATTEMPT TO REPAIR OR RECONDITION any relief valve when corrosion or build-up of foreign material (rust, dirt, scale, etc.) is found within the valve body or mechanism. Replace the valve.

DO NOT install relief devices in series or backwards.

USE CARE when working near or in line with a compressed spring. Sudden release of the spring can cause it and objects in its path to act as projectiles.

Prior to installing or servicing this equipment, ensure that personal protective equipment (PPE) is worn as required per OSHA or other local regulations.

For servicing or installing components where there is a risk of arc flash, the technicians must wear personal protective equipment as identified in NFPA (National Fire Protection Association) 70E or other local country-specific requirements for arc flash protection.

#### **A** CAUTION

Failure to follow these procedures may result in personal injury or damage to equipment.

DO NOT STEP on refrigerant lines. Broken lines can whip about and release refrigerant, causing personal injury.

DO NOT climb over a machine. Use platform, catwalk, or staging. Follow safe practices when using ladders.

USE MECHANICAL EQUIPMENT (crane, hoist, etc.) to lift or move inspection covers or other heavy components. Even if components are light, use mechanical equipment when there is a risk of slipping or losing your balance.

BE AWARE that certain automatic start arrangements CAN ENGAGE THE STARTER, TOWER FAN, OR PUMPS. Open the disconnect *ahead of* the starter, tower fan, and pumps. Shut off the machine or pump before servicing equipment

USE only repaired or replacement parts that meet the code requirements of the original equipment.

DO NOT VENT OR DRAIN waterboxes containing industrial brines, liquid, gases, or semisolids without the permission of your process control group.

DO NOT LOOSEN waterbox cover bolts until the waterbox has been completely drained.

DOUBLE-CHECK that coupling nut wrenches, dial indicators, or other items have been removed before rotating any shafts.

DO NOT LOOSEN a packing gland nut before checking that the nut has a positive thread engagement.

PERIODICALLY INSPECT all valves, fittings, and piping for corrosion, rust, leaks, or damage.

PROVIDE A DRAIN connection in the vent line near each pressure relief device to prevent a build-up of condensate or rain water.

DO NOT re-use compressor oil or any oil that has been exposed to the atmosphere. Dispose of oil per local codes and regulations.

DO NOT leave refrigerant system open to air any longer than the actual time required to service the equipment. Seal circuits being serviced and charge with dry nitrogen to prevent oil contamination when timely repairs cannot be completed.

#### INTRODUCTION

#### General

The 19XR machine is factory assembled, wired, and leak tested. Installation (not by Carrier) consists primarily of establishing water and electrical services to the machine. The rigging, installation, field wiring, field piping, and insulation of waterbox covers are the responsibility of the contractor and/or customer. Carrier has no installation responsibilities for the equipment.

#### **Job Data**

Necessary information consists of:

- job contract or specifications
- machine location prints
- rigging information
- piping prints and details
- field wiring drawings
- starter manufacturer's installation details
- · Carrier certified print

#### **INSTALLATION**

#### Step 1 — Receive the Machine

INSPECT SHIPMENT

#### **A** CAUTION

Do not open any valves or loosen any connections. The 19XR machine may be shipped with a nitrogen holding charge in both modules. Damage to machine may result.

- 1. Inspect for shipping damage while machine is still on shipping conveyance. If machine appears to be damaged or has been torn loose from its anchorage, have it examined by transportation inspectors before removal. Forward claim papers directly to transportation company. *Manufacturer is not responsible for any damage incurred in transit.*
- 2. Check all items against shipping list. Immediately notify the nearest Carrier representative if any item is missing.
- 3. To prevent loss or damage, leave all parts in original packages until beginning installation. All openings are closed with covers or plugs to prevent dirt and debris from entering machine components during shipping. A full operating oil charge is placed in the oil sump before shipment.

#### **IDENTIFY MACHINE**

The machine model number, serial number, and heat exchanger sizes are stamped on machine identification nameplate (Fig. 1-3). Check this information against shipping papers and job data.

#### INSTALLATION REQUIREMENTS

Prior to starting the chiller's electrical installation, certain requirements should be checked. Input power wire sizes, branch circuit protection, and control wiring are all areas that need to be evaluated. See Fig. 4-6 for general layouts. See Fig. 7 and 8 and Tables 1 and 2 for dimensional information.

#### **Determine Wire Size Requirements**

Wire size should be determined based on the size of the conduit openings, and applicable local, national, and international codes (e.g., NEC [National Electric Code]/CEC [California Energy Commission] regulations). General recommendations are included in the Carrier field wiring drawings.

	<b>E</b> .C		<b>er</b>	Comp	any								
REF	RIGER	ATIC	ON MAC	HIN	E								
	MOE	EL NUN	IBER	SE	RIAL	NO.							
MACHINE													
COMP 'R													
COOLER													
CONDENSER													
ECON													
STOR TANK													
RATED TONS													
RATED IKW													
REFRIGERANT LBS. KGS.													
K-	CHARGED												
COMPRESSOR MOTOR DATA													
VOLTS/PHASE/HERTZ AC													
RL AMPS LR AMPS Y-													
OLT AMPS			LR AMPS	D-									
MAX FUSE/C	IRCUIT BK	R											
MIN. CIRCU	IT AMPACI	TY											
TEST PRESS	SURE		PSI			KPA							
DESIGN PRE	SSURE		PSI			KPA							
CLR. WATER	PRESSURE		PSI			KPA							
COND. WATER	PRESSURE		PSI			KPA							
		STATE E. NOF USA	SVILLE RO		269								
SAFETY CODE CERTIFICATION  INIS UNIT IS DESIGNED, CONSTRUCTED,  AND TESTED IN CONFORMANCE WITH  ANSI/ASMARE IS LLATEST REVISION),  REFRICERION, MECHANICA,  THE COMPRESSOR MOTOR CONTROLLER  AND OVERLOAD PROTECTION MUSTS BE  IN ACCORDANCE WITH CARRIER  SPECIFICATION 2"-415.													
l					19XR0	5009801 /							

Fig. 1 — 19XR Refrigeration Machine Nameplate

#### Conduit Entry Size

It is important to determine the size of the conduit openings in the enclosure power entry plate so that the wire planned for a specific entry point will fit through the opening. Do NOT punch holes or drill into the top surface of control panels. Knockouts are provided on the enclosure.

#### Recommended Control and Signal Wire Sizes

The recommended minimum size wire to connect I/O signals to the control terminal blocks is 18 AWG (American Wire Gage). Recommended terminal tightening torque is 7 to 9 in.-lb (0.79 to 1.02 N-m).

#### Recommended Airflow Clearances

Be sure there is adequate clearance for air circulation around the enclosure. A 6-in. (152.4 mm) minimum clearance is required wherever vents are located in the control enclosures.

#### Service Clearances

Verify that there are adequate service clearances as identified in Fig. 7 and 8.

#### Verify Adequate Power Supply

It is important to verify that the building power will meet the input power requirements of the Machine Electrical Data nameplate input power rating. Be sure the input power to the chiller corresponds to the chiller's nameplate voltage, current, and frequency.

#### PROVIDE MACHINE PROTECTION

Store machine and starter indoors, protected from construction dirt and moisture. Inspect under shipping tarps, bags, or crates to be sure that water has not collected during transit. Keep protective shipping covers in place until machine is ready for installation.

#### **⚠ CAUTION**

Freezing water can damage equipment. If machine can be or possibly has been exposed to freezing temperatures after water circuits have been installed, open waterbox drains and remove all water from cooler and condenser. Leave drains open until system is filled.

It is important to properly plan before installing a 19XR unit to ensure that the environmental and operating conditions are satisfactory and the machine is protected. The installation must comply with all requirements in the certified prints.

#### **Operating Environment**

Chiller should be installed in an indoor environment where the ambient temperature is between 40 and 104°F (4 and 40°C) with a relative humidity of 95% or less, non-condensing. To ensure that electrical components operate properly, do not locate the chiller in an area exposed to dust, dirt, corrosive fumes, or excessive heat and humidity.

NOTE: NEMA Type 1 enclosures are constructed for indoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment and to provide a degree of protection against falling dirt. This type of enclosure does not protect against water, dust, moisture or airborne contaminants.

#### Step 2 — Rig the Machine

The 19XR machine can be rigged as an entire assembly. It also has flanged connections that allow the compressor, cooler, and condenser sections to be separated and rigged individually. See Fig. 9-14 for equipment rigging.

#### RIG MACHINE ASSEMBLY

See rigging instructions on label attached to machine. Refer to rigging guide (Fig. 9-14), dimensions in Fig. 7 and 8, and physical data in Tables 1-35. *Lift machine only from the points indicated in rigging guide*. Each lifting cable or chain must be capable of supporting the entire weight of the machine.

Contractors are not authorized to disassemble any part of the chiller without Carrier's supervision. Any request otherwise must be approved in writing by the Carrier Technical Service Manager.

NOTE: Carrier suggests that a structural engineer be consulted if transmission of vibrations from mechanical equipment is of concern.

#### **⚠WARNING**

Lifting chiller or components from points other than those specified may result in serious damage to the machine or personal injury. Rigging equipment and procedures must be adequate for maximum chiller weight. See Fig. 9-14 for maximum chiller and component weights.

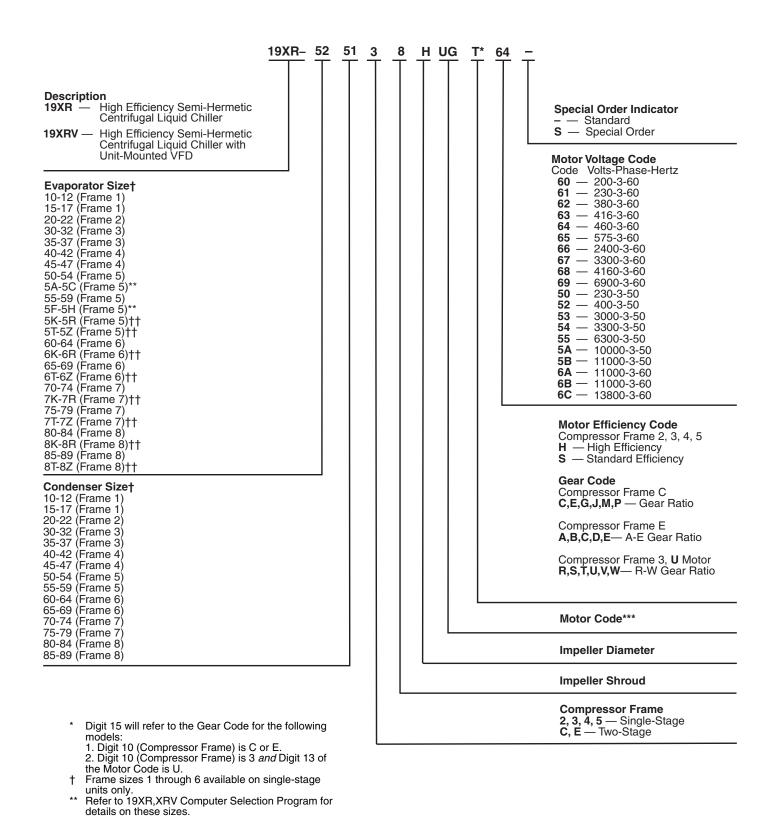


Fig. 2 — 19XR,XRV Single-stage Compressor and Two-stage Compressor Frame Size C and E

†† Frame sizes with K-R and T-Z are with 1-in. OD evaporator tubing.

\*\*\* Refer to the 19XR,XRV Computer Selection Program

for motor size details.

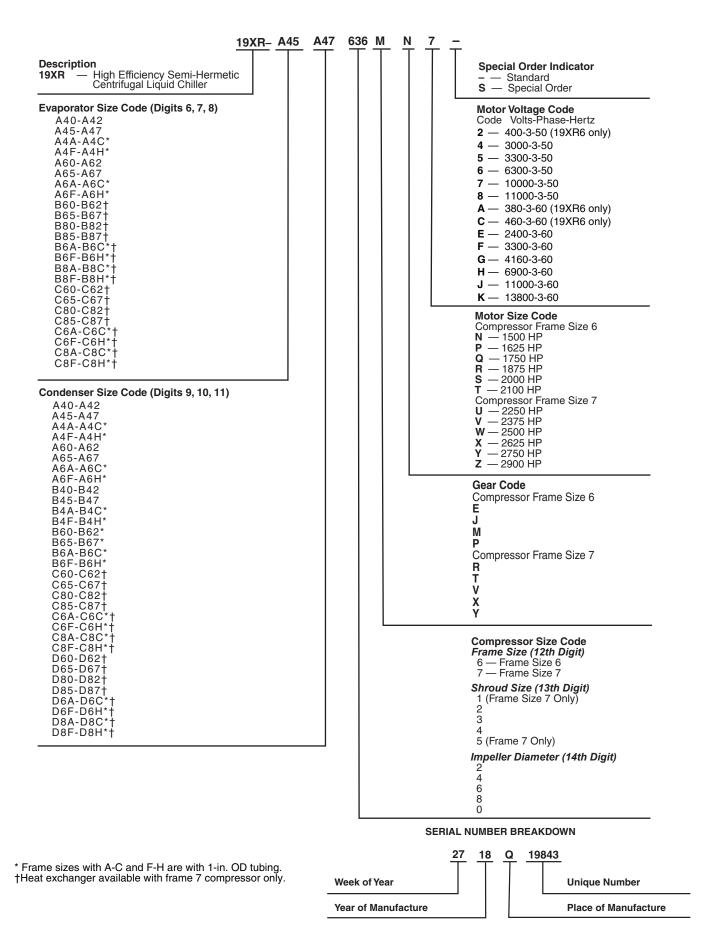
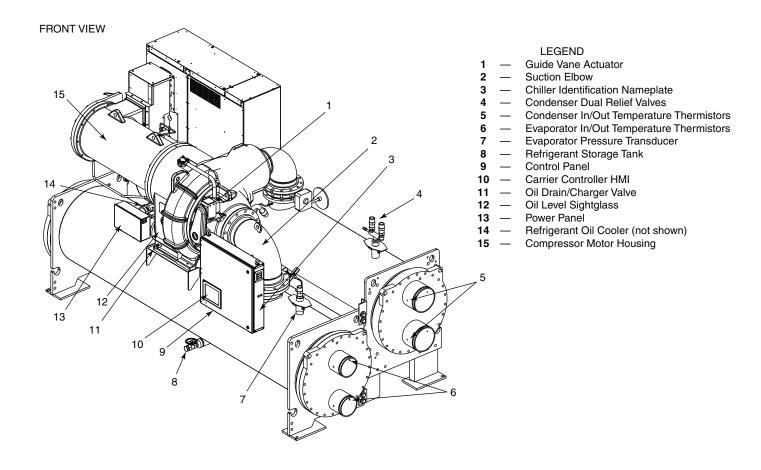


Fig. 3 — 19XR Two-Stage Compressor Frame Size 6 and 7



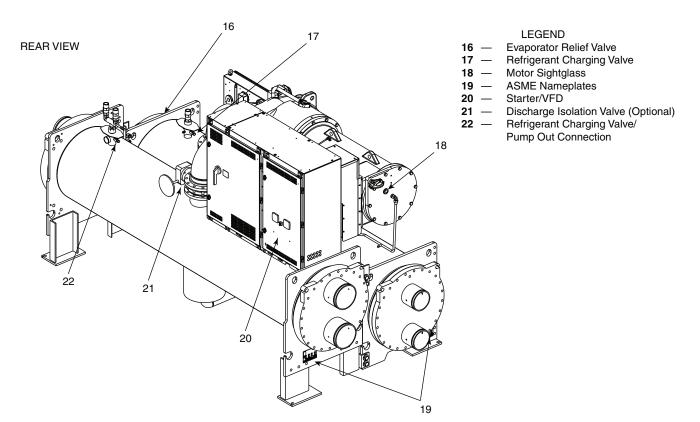
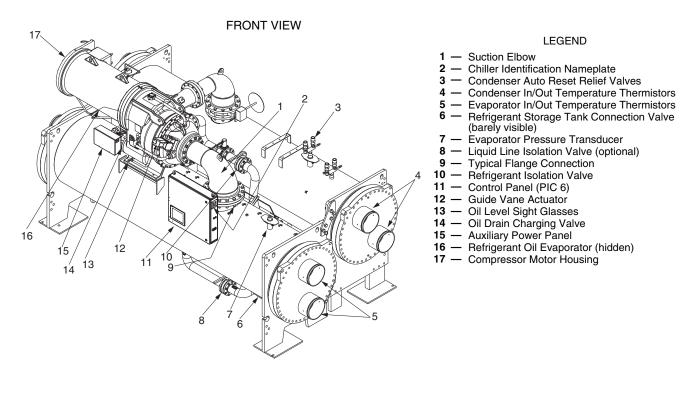


Fig. 4 — 19XR,XRV Single-Stage Compressor, Frame Size 2, 3, 4, 5




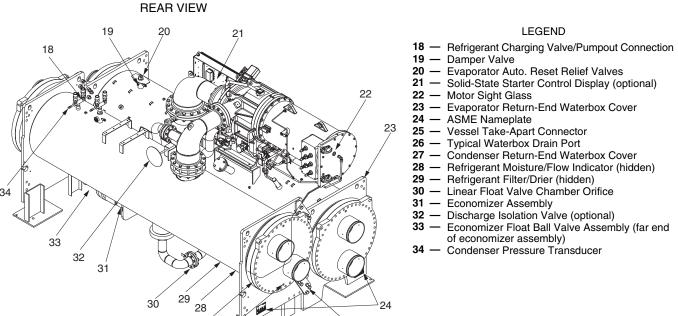


Fig. 5 — 19XR,XRV Two-Stage Compressor Frame Size C and E

#### FRONT VIEW

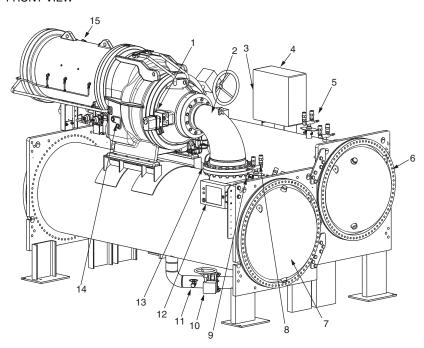


#### **LEGEND**

- 1 Guide Vane Actuator\*
- 2 Suction Elbow
- 3 Chiller Identification Nameplate
- 4 Auxiliary Power Panel
- 5 Condenser Auto. Reset Relief Valves
- 6 Condenser Return End Waterbox Cover
- 7 Evaporator Return End Waterbox Cover
- 8 Evaporator Auto. Reset Relief Valves
- 9 Evaporator Pressure Transducer
- 10 Liquid Line Isolation Valve (Optional)
- 11 Refrigerant Storage Tank Connection Valve
- 12 HMI (Human Machine Interface) Panel
- 13 Typical Flange Connection
- 14 Oil Level Sight Glasses
- 15 Compressor Motor Housing

\*See certified drawing for Frame 7 location.

#### **REAR VIEW**

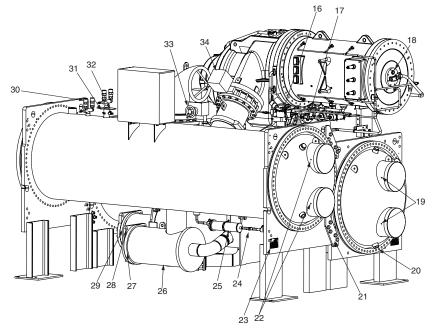

NOTE: Frame 6 is shown.

#### LEGEND

- 16 Oil Evaporator
- 17 Oil Drain Changing Valve (Hidden)
- 18 Motor Sight Glass
- 19 Evaporator In/Out Temperature Thermistors
- 20 Typical Waterbox Drain Port
- 21 Vessel Take-Apart Connector
- **22** Condenser In/Out Temperature Thermistors
- 23 ASME Nameplate
- 24 Refrigerant Moisture/Flow Indicator
- 25 Refrigerant Filter/Drier
- 26 High Side Float Chamber
- 27 High Side Float Ball Valve Assembly (Inside)
- 28 Economizer Assembly
- 29 Economizer Float Ball Assembly (Inside)
- 30 Evaporator Auto. Reset Relief Valve
- 31 Condenser Pressure Transducer
  32 Refrigerant Charging Valve/Pumpout
- Connection
- 3 Damper Valve
- 34 Discharge Isolation Valve (Optional)

Fig. 6 — 19XR Two-Stage Compressor Frame Sizes 6 and 7

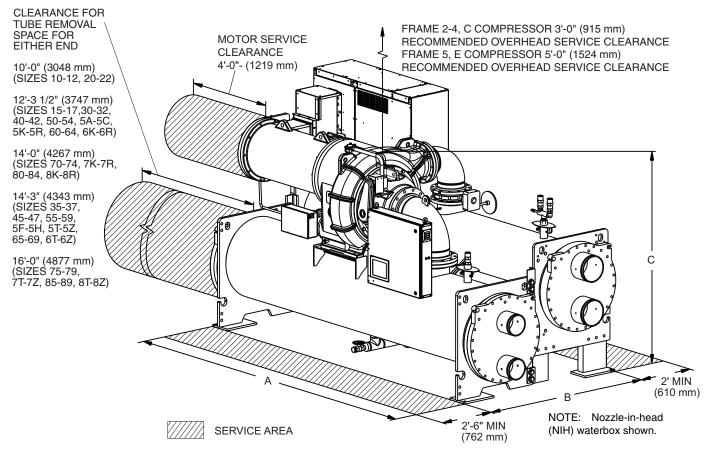


Fig. 7 — 19XRV Dimensions (Refer to Table 1)

Table 1 — 19XR,XRV Dimensions — Single-Stage Compressor and Two-stage Compressor Frame Size C and E (150 psig Nozzle-in-Head Waterbox)


		A (LEI	NGTH, MAR	INE WATE	RBOX)		192	XR	19X	(RV
HEAT EXCHANGER SIZE	2-Pa	ss *	1-Pa	ıss †	3-Pa	ass†	B WI	DTH	B WI	DTH
SIZE	ft-in.	mm	ft-in.	mm	ft-in.	mm	ft-in.	mm	ft-in.	mm
10 to 12	11 - 4.5	3467	12	3658	12	3658	5 -2.76	1594	5 -4.38	1635
15 to 17	13 -8	4165	14 -3.5	4356	14 -3.5	4356	5 -2.76	1594	5 -4.38	1635
20 to 22	11 -5.13	3483	12 -0.5	3670	12 -0.5	3670	5 -7.13	1705	5 -9.13	1755
30 to 32	13 -8.63	4181	14 -4	4369	14 -4	4369	5 -7.13	1705	5 -10.88	1800
35 to 37	15 -5.13	4702	16 -0.5	4890	16 -0.5	4890	5 -7.13	1705	5 -10.88	1800
40 to 42	14 -3.63	4359	14 -10	4521	14 -6.76	4439	6-3	1905	6 -3	1905
45 to 47	16 -0.13	4880	16 -6.5	5042	16 -3.26	4960	6 -3	1905	6 -3	1905
50 to 54, 5K to 5R, 5A to 5C	14 -5	4394	14 -11	4547	16 -7.26	5061	6 -7.88	2028	7 -11.63	2429
55 to 59, 5T to 5Z, 5F to 5H	16 -1.5	4914	16 -7.5	5067	16 -3.76	4972	6 -7.88	2028	7 -11.63	2429
60 to 64, 6K to 6R	14 -5.75	4413	15 -0	4572	16 -7.76	5074	6 -10.63	2098	8 -1.88	2486
65 to 69, 6T to 6Z	16 -2.25	4933	16 -8.5	5093	16 -4.26	4985	6 -10.63	2098	8-1.88	2486
70 to 74, 7K to 7R	16 -6.63	5045	17 -1.5	5220	16 -10.75	5150	8 -1.25	2470	9 -4.63	2860
75 to 79, 7T to 7Z	18 -6.63	5654	19 -1.5	5829	18 -10.75	5759	8 -1.25	2470	9 -4.63	2860
80 to 84, 8K to 8R	16 -9.63	5121	17 -4.5	5296	16 -11	5156	8 -11.57	2732	10 -2.88	3121
85 to 89, 8T to 8Z	18 -9.63	5731	19 -4.5	5906	18 -11	5766	8 -11.57	2732	10 -2.88	3121

Assumes both evaporator and condenser nozzles on same end of chiller.

- 1. Service access should be provided per American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE) 15, latest edition, National Fire Protection Association (NFPA) 70, and local safety code.
- Allow at least 3 ft (915 mm) overhead clearance for service rigging for frame 2-4 and frame C compressor. Overhead clearance for service rigging frame 5 and frame E compressor should be 5 ft (1524 mm).
- Dimensions are approximate. Certified drawings available upon
- Marine waterboxes may add 6 in. (152 mm) to the width of the machine. See certified drawings for details.
- 'A' length dimensions shown are for standard 150 psig (1034 kPa) design and flanged connections. The 300 psig (2068 kPa) design and/or flanges will add length. See certified drawings. 19XR,XRV heights can vary depending on the configuration.
- Check 19XR,XRV certified drawings for height information.

  7. Not all waterbox/pass combinations are available with unit-mounted VFD (variable frequency drive). Check selection program for availability.

<sup>1-</sup> or 3-pass length applies if evaporator is a 1- or 3-pass design.

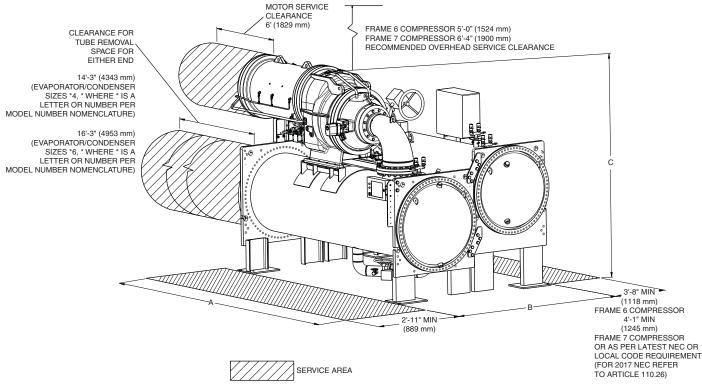

NOTE: Compressor Frame Size 6, dished head waterbox shown.

Fig. 8 — 19XR Dimensions — Two-Stage Compressor Frame Sizes 6 and 7

Table 2 — 19XR Dimensions — Two-Stage Compressor Frame Sizes 6 and 7 (150 psig Nozzle-in-Head Waterbox)

COOLER	CONDENSER		A (LENGT	H, DISHED	HEAD W	ATERBOX	)	192	XR	
<b>HEAT EXCHANGER</b>	HEAT EXCHANGER	1-P/	ASS	2-P/	ASS	3-P	ASS	B WI	DTH	19XR C HEIGHT
SIZE*	SIZE*	ft-in.	mm	ft-in.	mm	ft-in.	mm	ft-in.	mm	OTILIAITI
A4	A4	17- 8	5385	17- 63/4	5353	17- 63/4	5353	10- 3 <sup>1</sup> / <sub>8</sub>	3127	
A6	A6	19-8	5994	19- 6 <sup>3</sup> / <sub>4</sub>	5962	19- 6 <sup>3</sup> / <sub>4</sub>	5962	10- 3 <sup>1</sup> / <sub>8</sub>	3127	
A4	B4	17- 8	5385	17- 7 <sup>3</sup> / <sub>8</sub>	5369	17- 7 <sup>3</sup> / <sub>8</sub>	5369	10- 81/2	3264	
A6	B6	19-8	5994	19- 7 <sup>3</sup> / <sub>8</sub>	5978	19- 7 <sup>3</sup> / <sub>8</sub>	5978	10- 81/2	3264	]
В6	C6	20- 0	6096	19-11 <sup>1</sup> / <sub>8</sub>	6074	19- 9	6120	12- 0 <sup>5</sup> / <sub>8</sub>	3674	SEE NOTE 6
B8	C8	22- 0	6096	21-111/8	6684	21- 9	6629	12- 5 <sup>1</sup> / <sub>2</sub>	3797	
C6	C6	20- 41/4	6204	19-11 <sup>1</sup> / <sub>8</sub>	6074	19-113/4	6090	12- 5 <sup>1</sup> / <sub>2</sub>	3797	
C6	D6	20- 41/4	6204	20- 0	6096	20- 01/2	6109	13- 2	4013	
C8	D8	22- 21/2	6769	21- 77/8	6600	21-101/4	6661	13- 2	4013	]

<sup>\*</sup> Assumes both evaporator and condenser nozzles on same end of chiller.

- Service access should be provided per American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE) 15, latest edition, National Fire Protection Association (NFPA) 70, and local safety code.
- 2. Allow at least 5 ft (1524 mm) overhead clearance for service rigging.
- Dimensions are approximate. Certified drawings available upon request.
- 'A' length dimensions shown are for standard 150 psig (1034 kPa) design and flanged connections.
- 5. Table contains largest of all configurations of the type shown.
- 6. 19XR heights can vary depending on the configuration. Check 19XR certified drawings for height information.

			IM MACHINE											CHAIN L	ENGTH		
COMP FRAME SIZE	HEAT EXCH SIZE	FREE-	EIGHT STANDING NTED STARTER		SSEL NGTH	DIM.	"A"	DIM.	"B"	DIM.	"C"	"D	"	"Е		"F	,,
		LB	KG	FT	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM
	10-12	18,590	8432	10	3048	4-7	1397	2-6	762	2-3	686	12-7	3835	13-0	3962	13-0	3962
	15-17	19,140	8682	12	3658	5-9	1753	2-6	762	2-3	686	13-6	4115	13-2	4013	13-3	4039
2	20-22	19,610	8895	10	3048	4-7	1397	2-4	711	3-1	940	12-7	3835	13-0	3962	13-0	3962
	30-32	21,210	9620	12	3658	5-9	1753	2-6	762	3-6	1067	13-6	4115	13-2	4013	13-3	4039
	35-37	22,720	10306	14	4267	7-4	2235	2-6	762	3-6	1067	14-2	4318	13-4	4064	13-4	4064
	30-32	21,210	9620	12	3658	5-9	1753	2-6	762	3-6	1067	13-6	4115	13-2	4013	13-3	4039
	35-37	22,720	10306	14	4267	7-4	2235	2-6	762	3-6	1067	14-2	4318	13-4	4064	13-4	4064
	40-42	29,930	13576	12	3658	5-9	1753	2-7	787	3-2	965	12-8	3861	12-8	3861	13-4	4064
3	45-47	32,040	14533	14	4267	6-10	2083	2-7	787	3-2	965	13-1	3988	13-2	4013	13-8	4166
3	50-54	31,603	14335	12	3658	5-9	1753	2-7	787	3-2	965	12-7	3835	12-9	3886	13-5	4089
	5K-5R	31,603	14355	12	3658	5-9	1753	2-7	787	3-2	965	12-7	3835	12-9	3886	13-5	4089
	55-59	33,631	15255	14	4267	6-10	2083	2-7	787	3-2	965	13-1	3988	13-3	4039	13-9	4191
	5T-5Z	33,631	15255	14	4267	6-10	2083	2-7	787	3-2	965	13-1	3988	13-3	4039	13-9	4191
	50-54	32,933	14938	12	3658	5-9	1753	2-8	813	3-4	1016	13-1	3988	12-9	3886	13-4	4064
	5K-5R	32,933	14938	12	3658	5-9	1753	2-8	813	3-4	1016	13-1	3988	12-9	3886	13-4	4064
	55-59	34,661	15722	14	4267	6-2	1880	2-8	813	3-4	1016	13-7	4140	13-1	3998	14-4	4369
	5T-5Z	34,661	15722	14	4267	6-2	1880	2-8	813	3-4	1016	13-7	4140	13-1	3998	14-4	4369
4	60-64	35,433	16072	12	3658	5-9	1753	2-8	813	3-4	1016	13-1	2988	12-9	3886	13-4	4064
7	6K-6R	35,433	16072	12	3658	5-9	1753	2-8	813	3-4	1016	13-1	3988	12-9	3886	13-4	4064
	65-69	37,536	17026	14	4267	6-2	1880	2-8	813	3-4	1016	13-7	4140	13-1	3998	14-4	4369
	6T-6Z	37,536	17026	14	4267	6-2	1880	2-8	813	3-4	1016	13-7	4140	13-1	3998	14-4	4369
	70-74	40,929	18565	14	4267	6-6	1981	3-5	1041	4-4	1321	11-6	3505	12-5	3785	12-9	3886
	7K-7R	40,929	18565	14	4267	6-6	1981	3-5	1041	4-4	1321	11-6	3505	12-5	3785	12-9	3886
	50-54	27,868	12641	12	3658	5 - 10	1778	2 - 8	813	3 -11	1194	12- 8	3861	12- 0	3658	12- 8	3861
	5A-5C	27,868	12641	12	3658	5 - 10	1778	2 - 8	813	3 -11	1194	12- 8	3861	12- 0	3658	12- 8	3861
	5K-5R	27,868	12641	12	3658	5 - 10	1778	2 - 8	813	3 -11	1194	12- 8	3861	12- 0	3658	12- 8	3861
	55-59	29,311	13295	14	4267	6 - 6	1981	2 -10	864	3 -11	1194	13- 1	3988	12-8	3861	13- 2	4013
	5F-5H	29,311	13295	14	4267	6 - 6	1981	2 -10	864	3 -11	1194	13- 1	3988	12- 8	3861	13- 2	4013
	5T-5Z	29,311	13295	14	4267	6 - 6	1981	2 -10	864	3 -11	1194	13- 1	3988	12-8	3861	13- 2	4013
С	60-64	30,951	14039	12	3658	6 - 0	1829	3 - 0	914	4 - 6	1372	12- 3	3734	11- 4	3454	12- 0	3658
·	6K-6R	30,951	14039	12	3658	6 - 0	1829	3 - 0	914	4 - 6	1372	12- 3	3734	11- 4	3454	12- 0	3658
	65-69	32,906	14926	14	4267	6 - 7	2007	3 - 1	940	4 - 6	1372	12- 8	3861	12- 0	3658	12- 8	3861
	6T-6Z	32,906	14926	14	4267	6 - 7	2007	3 - 1	940	4 - 6	1372	12- 8	3861	12- 0	3658	12- 8	3861
	70-74	44,023	19968	14	4267	6-11	2108	3-7	1092	4-4	1321	13-5	4089	12-0	1829	12-4	3759
	7K-7R	44,023	19968	14	4267	6-11	2108	3-7	1092	4-4	1321	13-5	4089	12-0	1829	12-4	3759
	75-79	46,612	21143	16	7801	7-8	2337	3-8	1118	4-4	1321	14-1	4293	12-8	2032	13-1	3988
	7T-7Z	46,612	21143	16	7801	7-8	2337	3-8	1118	4-4	1321	14-1	4293	12-8	2032	13-1	3988


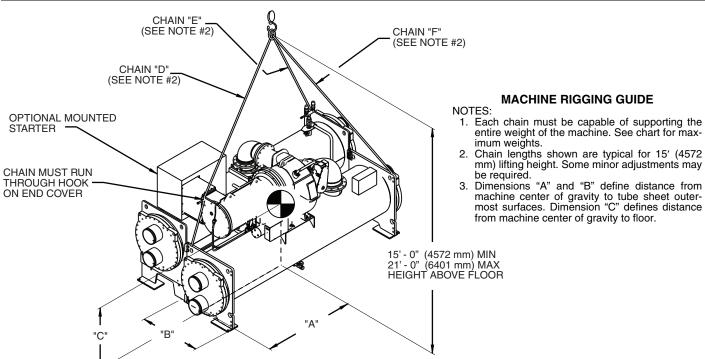


Fig. 9 — Machine Rigging Guide (Heat Exchanger Size 10 Through 7R) with Free-Standing or Unit-Mounted Starter


COMP	HEAT		МИМ	VESSEL		DIM. "A"				DIM. "C"		CHAIN LENGTH					
FRAME SIZE	EXCH SIZE	MAC WEI	HINE GHT		IGTH	DIM.	"A"	DIM.	"B"	DIM.	"C"	"D	,,	"Е	"	"F	,,,
SIZE	SIZE	lb	kg	ft	mm	ft-in.	mm	ft-in.	mm	ft-in.	mm	ft-in.	mm	ft-in.	mm	ft-in.	mm
	70-74	46,119	20919	14	4267	6-2	1880	3-6	1067	4-7	1397	11-6	3505	12-5	3785	12-9	3886
	7K-7R	46,119	20919	14	4267	6-2	1880	3-6	1067	4-7	1397	11-6	3505	12-5	3785	12-9	3886
	75-79	49,977	22669	16	4877	6-11	2108	3-6	1067	4-7	1397	11-11	3632	13-3	4039	13-7	4140
5	7T-7Z	49,977	22669	16	4877	6-11	2108	3-6	1067	4-7	1397	11-11	3632	13-3	4039	13-7	4140
3	80-84	55,981	25393	14	4267	6-2	1880	3-6	1067	4-7	1397	11-6	3505	12-5	3785	12-9	3886
	8K-8R	55,981	25393	14	4267	6-2	1880	3-6	1067	4-7	1397	11-6	3505	12-5	3785	12-9	3886
	85-89	59,564	27018	16	4877	6-11	2108	3-6	1067	4-7	1397	11-11	3632	13-3	4039	13-7	4140
	8T-8Z	59,564	27018	16	4877	6-11	2108	3-6	1067	4-7	1397	11-11	3632	13-3	4039	13-7	4140
	70-74	46,906	21276	14	4267	6-4	1930	3-11	1194	4-6	1372	11-5	3480	12-3	3734	12-6	3810
	7K-7R	46,906	21276	14	4267	6-4	1930	3-11	1194	4-6	1372	11-5	3480	12-3	3734	12-6	3810
	75-79	50,693	22994	16	4877	7-5	2261	3-11	1194	4-6	1372	12-1	3683	12-9	3887	13-2	4013
E	7T-7Z	50,693	22994	16	4877	7-5	2261	3-11	1194	4-6	1372	12-1	3683	12-9	3887	13-2	4013
_	80-84	56,870	25796	14	4267	6-4	1930	3-11	1194	4-6	1372	11-5	3480	12-3	3734	12-6	3810
	8K-8R	56,870	25796	14	4267	6-4	1930	3-11	1194	4-6	1372	11-5	3480	12-3	3734	12-6	3810
	85-89	60,560	27470	16	4877	7-5	2261	3-11	1194	4-6	1372	12-1	3683	12-9	3887	13-2	4013
	8T-8Z	60,560	27470	16	4877	7-5	2261	3-11	1194	4-6	1372	12-1	3683	12-9	3887	13-2	4013

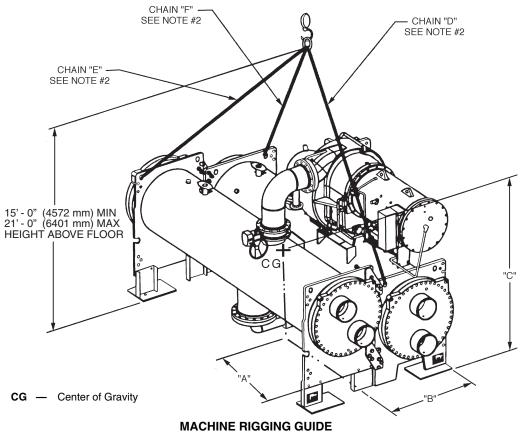

- Each chain must be capable of supporting the entire weight of the machine. See chart for maximum weights.
   Chain lengths shown are typical for 15' (4572 mm) lifting height. Some minor adjustments may be required.
   Dimensions "A" and "B" define distance from machine center of gravity to tube sheet outermost surfaces. Dimension "C" defines distance from machine center of gravity to floor.

Fig. 10 — Machine Rigging Guide (Heat Exchanger Size 70 Through 8Z) with Free-Standing or Unit-Mounted Starter

СОМР	HEAT	MAXI		VES	SSEL		<b>"</b>		<b></b>		<b>"</b>			CHAIN L	.ENGTH		
FRAME	EXCH	MAC WEI			IGTH	DIM.	"A″	DIM.	."В″	DIM.	"C"	"[	)"	"Е	"	"F	•"
SIZE	SIZE	LB	KG	FT	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM
	20-22	22,910	10 392	10	3048	4- 7	1397	2-4	711	3-1	940	12-7	3835	13-0	3962	13- 0	3962
2	30-32	24,510	11 118	12	3658	5- 9	1753	2-6	762	3-6	1067	13-6	4115	13-2	4013	13- 3	4039
	35-37	26,020	11 802	14	4267	7- 4	2235	2-6	762	3-6	1067	14-2	4318	13-4	4064	13- 4	4064
	30-32	24,510	11 118	12	3658	5- 9	1753	2-6	762	3-6	1067	13-6	4115	13-2	4013	13- 3	4039
	35-37	26,020	11 802	14	4267	7- 4	2235	2-6	762	3-6	1067	14-2	4318	13-4	4064	13- 4	4064
	40-42	33,230	15 073	12	3658	5- 9	1753	2-7	787	3-2	965	12-8	3861	12-8	3861	13- 4	4064
3	45-47	35,340	16 030	14	4267	6-10	2083	2-7	787	3-2	965	13-1	3988	13-2	4013	13-8	4166
3	50-54	34,103	15 481	12	3658	5- 9	1753	2-7	787	3-2	965	12-7	3835	12-9	3886	13- 5	4089
	5K-5R	34,103	15 481	12	3658	5- 9	1753	2-7	787	3-2	965	12-7	3835	12-9	3886	13- 5	4089
	55-59	36,131	16 389	14	4267	6-10	2083	2-7	787	3-2	965	13-1	3988	13-3	4039	13- 9	4191
	5T-5Z	36,131	16 389	14	4267	6-10	2083	2-7	787	3-2	965	13-1	3988	13-3	4039	13- 9	4191
	50-54	36,233	16 435	12	3658	5- 9	1753	2-8	813	3-4	1016	13-1	3988	12-9	3886	13- 4	4064
	5K-5R	36,233	16 435	12	3658	5- 9	1753	2-8	813	3-4	1016	13-1	3988	12-9	3886	13- 4	4064
	55-59	37,961	17 219	14	4267	6- 2	1880	2-8	813	3-4	1016	13-7	4140	13-1	3998	14- 4	4369
4	5T-5Z	37,961	17 219	14	4267	6- 2	1880	2-8	813	3-4	1016	13-7	4140	13-1	3998	14- 4	4369
4	60-64	38,733	17 569	12	3658	5- 9	1753	2-8	813	3-4	1016	13-1	2988	12-9	3886	13- 4	4064
	6K-6R	38,733	17 569	12	3658	5- 9	1753	2-8	813	3-4	1016	13-1	3988	12-9	3886	13- 4	4064
	65-69	40,836	18 523	14	4267	6- 2	1880	2-8	813	3-4	1016	13-7	4140	13-1	3998	14- 4	4369
	6T-6Z	40,836	18 523	14	4267	6- 2	1880	2-8	813	3-4	1016	13-7	4140	13-1	3998	14- 4	4369
	50-54	30,868	14 001	12	3658	6- 0	1829	3-4	1016	4-2	1270	12-8	3861	11-9	3581	12-8	3861
	5A-5C	30,868	14 001	12	3658	6- 0	1829	3-4	1016	4-2	1270	12-8	3861	11-9	3581	12-8	3861
	5K-5R	30,868	14 001	12	3658	6- 0	1829	3-4	1016	4-2	1270	12-8	3861	11-9	3581	12- 8	3861
	55-59	32,311	14 656	14	4267	6- 7	2007	3-4	1016	4-2	1270	13-1	3988	12-6	3810	13- 4	4064
С	5F-5H	32,311	14 656	14	4267	6- 7	2007	3-4	1016	4-2	1270	13-1	3988	12-6	3810	13- 4	4064
C	5T-5Z	32,311	14 656	14	4267	6- 7	2007	3-4	1016	4-2	1270	13-1	3988	12-6	3810	13- 4	4064
	60-64	33,951	15 400	12	3658	6- 0	1829	3-6	1067	4-8	1422	12-4	3759	11-4	3454	12- 4	3759
	6K-6R	33,951	15 400	12	3658	6- 0	1829	3-6	1067	4-8	1422	12-4	3759	11-4	3454	12- 4	3759
	65-69	35,906	16 287	14	4267	6- 7	2007	3-6	1067	4-8	1422	12-8	3861	12-0	3759	12-10	3912
	6T-6Z	35,906	16 287	14	4267	6- 7	2007	3-6	1067	4-8	1422	12-8	3861	12-0	3759	12-10	3912

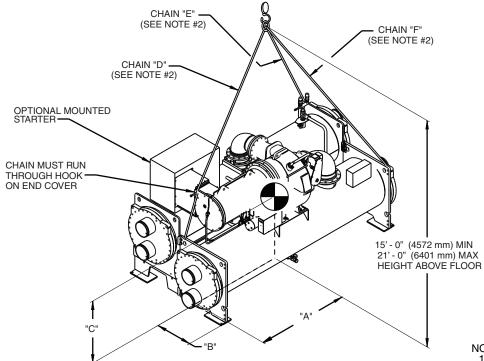


#### **MACHINE RIGGING GUIDE**

- 1. Each chain must be capable of supporting the entire weight of the machine. See chart for maximum weights.
- Chain lengths shown are typical for 15' (4572 mm) lifting height. Some minor
- (4572 mm) litting neight. Some minor adjustments may be required.
  3. Dimensions "A" and "B" define distance from machine center of gravity to tube sheet outermost surfaces. Dimension "C" defines distance from machine center of gravity to floor.

Fig. 11 — Machine Rigging Guide (Heat Exchanger Size 20 Through 6Z) with LF2 VFD (442 or 608A), Standard Tier VFD (230, 335, 445, 485, 550, 605, 680A Drives), or 575-v VFD

		MAXI	MUM	VE	SSEL	DIM. "	. A "	DIM.	·D"	DIM.	"C"			CHAIN L	ENGTH	I	
COMP. FRAME	MACHINE CODE	WEI	GHT	LE	NGTH	DIW.	A	DIIVI.	Ь	DIM.	C	"D	)"	"Е	,,	"F	,,
THAME	OODL	LB	KG	FT	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM
4	70-74, 7K-7R	49,949	22656	14	4267	6 - 5	1956	3 - 81/2	1130	4 - 9	1448	9 - 8	2946	11 - 6	3505	11 - 8	3556
С	70-74, 7K-7R	47,023	21329	14	4267	6 - 10 <sup>1</sup> / <sub>2</sub>	2096	4	1219	4 - 7	1397	10 - 3	3124	10 - 4	3150	10 - 10	3302
C	75-79, 7T-7Z	49,612	22504	16	4877	7 - 8	2337	4	1219	4 - 61/2	1384	10 - 9	3277	11 - 3	3429	11 - 9	3581
'	70-74, 7K-7R	55,139	25011	14	4267	6 - 1 <sup>1</sup> / <sub>2</sub>	1867	3 - 9	1143	4 - 9	1448	9 - 10	2997	11 - 4	3454	11 - 6	3505
5	75-79, 7T-7Z	59,357	26924	16	4877	6 - 10	2083	3 - 9	1143	4 - 9	1448	10 - 6	3200	12 - 8	3861	12 - 10	3912
5	80-84, 8K-8R	64,866	29423	14	4267	6 - 11/2	1867	3 - 9	1143	4 - 9	1448	9 - 10	2997	11 - 4	3454	11 - 6	3505
	85-89, 8T-8Z	68,839	31225	16	4877	6 - 10	2083	3 - 9	1143	4 - 9	1448	10 - 6	3200	12 - 8	3861	12 - 10	3912
	70-74, 7K-7R	55,926	25368	14	4267	6 - 2	1880	4 - 7	1397	4 - 11	1499	9 - 9	2972	10 - 9	3277	11 - 7	3531
Е	75-79, 7T-7Z	60,073	27249	16	4877	7 - 1	2159	4 - 7	1397	4 - 11	1499	10 - 4	3150	11 - 7	3531	12 - 4	3759
E	80-84, 8K-8R	65,750	29824	14	4267	6 - 2	1880	4 - 7	1397	4 - 11	1499	9 - 9	2972	10 - 9	3277	11 - 7	3531
	85-89, 8T-8Z	69,835	31677	16	4877	7 - 1	2159	4 - 7	1397	4 - 11	1499	10 - 4	3150	11 - 7	3531	12 - 4	3759

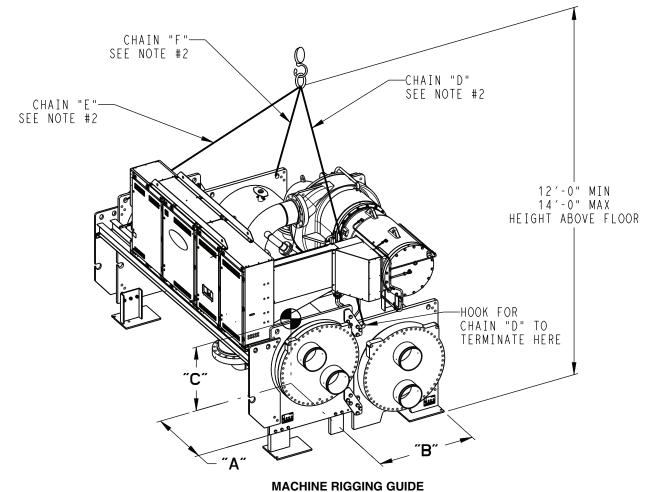


- Each chain must be capable of supporting the entire weight of the machine. See chart for maximum weights.
   Chain lengths shown are typical for 13' (3962 mm) lifting height. Some minor adjustments may be required.
   Dimensions "A" and "B" define distance from machine center of gravity to tube sheet outermost surfaces. Dimension "C" defines distance from machine center of gravity to floor.
- of gravity to floor.

  4. Care must be taken to prevent damage to the machine while threading chain "D" between drive, conduit, and piping.

Fig. 12 — Machine Rigging Guide (Compressor Frame 4, 5, C, and E)


HEAT				VESSEL				CH	IAIN LENG	TH
EXCHANGER CODE (COOLER— CONDENSER)	COMPRESSOR FRAME	NIH MAX. WEIGHT Ib [kg]	MWB MAX WEIGHT Ib [kg]	LENGTH ft [mm]	DIM. "A" in. [mm]	DIM. "B" in. [mm]	DIM. "C" in. [mm]	"D" in. [mm]	"E" in. [mm]	"F" in. [mm]
A4—A4	6	65,094 [29,526]	76,501 [34,700]	14 [4267]	68.31 [1735]	53.98 [1371]	72.96 [1853]	136.50 [3467]	156.73 [3981]	161.42 [4100]
A4—B4	6	69,266 [31,419]	80,673 [36,593]	14 [4267]	69.09 [1755]	57.56 [1462]	71.26 [1810]	137.01 [3480]	157.28 [3995]	162.01 [4115]
A6—A6	6	68,282 [30,972]	81,556 [36,993]	16 [4877]	76.61 [1946]	54.69 [1389]	72.16 [1833]	140.83 [3577]	166.93 [4240]	171.77 [4363]
A6—B6	6	72,810 [33,026]	86,084 [39,047]	16 [4877]	77.87 [1978]	58.46 [ 1485 ]	70.39 [1788]	141.54 [3595]	166.97 [4241]	172.05 [4370]

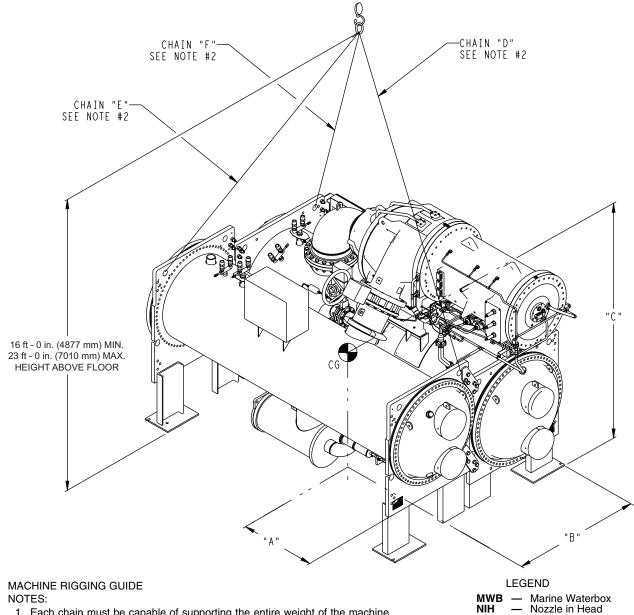

- 1. Each chain must be capable of supporting the entire weight of the machine. See chart for maximum weights.
- Chain lengths shown are typical for 16' (4877 mm) lifting height. Some minor adjustments may be required.
   Dimensions "A" and "B" define distance from machine center of gravity to tube sheet outermost surfaces. Dimension "C" defines distance from machine center of gravity to floor.

Fig. 13 — Machine Rigging Guide (Compressor Frame Size 6)

HEAT			MWB					CH	IAIN LENG	TH
EXCHANGER CODE (COOLER— CONDENSER)	COMPRESSOR FRAME	NIH Max. WEIGHT Ib [kg]	MAX. WEIGHT [kg]	VESSEL LENGTH ft [mm]	DIM. "A" in. [mm]	DIM. "B" in. [mm]	DIM. "C" in. [mm]	"D" in. [mm]	"E" in. [mm]	"F" in. [mm]
B6—C6	7	94,574 [42,898]	112,911 [51,216]	16 [4877]	73.98 [1879]	64.65 [1642]	76.81 [1951]	167.01 [4242]	188.70 [4793]	198.23 [5035]
B8—C8	7	98,876 [44,849]	117,213 [53,167]	18 [5486]	83.23 [2114]	64.65 [1642]	76.81 [1951]	171.55 [4357]	197.90 [5027]	206.85 [5254]
C6—C6	7	101,110 [45,863]	121,448 [55,088]	16 [4877]	79.33 [2015]	66.69 [1694]	75.28 [1912]	166.57 [4231]	186.81 [4745]	193.62 [4918]
C6—D6	7	109,798 [49,803]	133,108 [60,377]	16 [4877]	82.32 [2091]	73.43 [1865]	73.66 [1871]	168.03 [4268]	185.63 [4715]	194.02 [4928]
C8—D8	7	121,971 [55,325]	146,897 [66,631]	18 [5486]	89.31 [2268]	73.43 [1865]	73.66 [1871]	171.76 [4363]	195.77 [4973]	203.72 [5174]

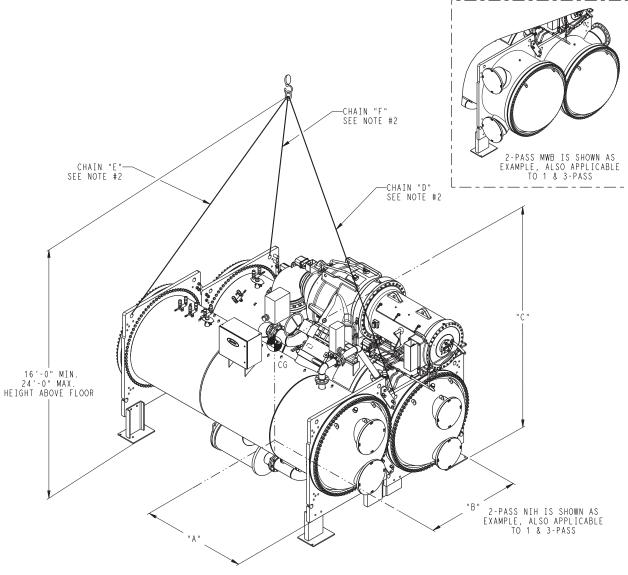

MACHINE RIGGING GUIDE

NOTES:

Each chain must be capable of supporting the entire weight of the machine. See chart for maximum weights.
 Chain lengths shown are typical for 20' (6096 mm) lifting height.

Some minor adjustments may be required.

Dimensions "A" and "B" define distance from machine center of gravity to tube sheet outermost surfaces. Dimension "C" defines distance from machine center of gravity to floor.

LEGEND

MWB — Marine Waterbox NIH — Nozzle in Head

Fig. 14 — Machine Rigging Guide (Compressor Frame Size 7)

Table 3 — 19XR Nozzle Size

HEATEXCHANGER	NOZZLE SIZE (in.) (Nominal Pipe Size)											
FRAME SIZE		Cooler			Condenser							
SIZL	1-Pass	2-Pass	3-Pass	1-Pass	2-Pass	3-Pass						
2	10	8	6	10	8	6						
3	10	8	6	10	8	6						
4	10	8	6	10	8	6						
5	10	8	6	10	10	8						
6	10	10	8	10	10	8						
7	14	12	10	14	12	12						
8	14	14	12	14	14	12						
Α	20	16	12	20	16	14						
В	20	18	14	20	18	14						
С	20	18	14	24	20	16						
D	_	_	_	24	20	16						

Table 4 — 19XRV Dimensions (Marine Waterbox)

		A (LEN	NGTH, MARINI	E WATER	BOX)		D WIDT		O LIFTOLIT
HEAT EXCHANGER SIZE	1-PASS†		2-PASS*		3-PAS	S†	B WIDT	П	C HEIGHT
SIZL	FT-IN.	MM	FT-IN.	MM	FT-IN.	MM	FT-IN.	ММ	
20 TO 22	14- 11/4	4299	12- 5 <sup>1</sup> / <sub>2</sub>	3797	14- 1 <sup>1</sup> / <sub>4</sub>	4299	6- 1 <sup>1</sup> / <sub>16</sub>	1856	
30 TO 32	16- 4 <sup>3</sup> / <sub>4</sub>	4997	14- 9	4496	16- 4 <sup>3</sup> / <sub>4</sub>	4997	6- 1 <sup>1</sup> / <sub>16</sub>	1856	
35 TO 37	18- 1 <sup>1</sup> / <sub>4</sub>	5518	16- 5 <sup>1</sup> / <sub>2</sub>	5017	18- 1 <sup>1</sup> / <sub>4</sub>	5518	6- 1 <sup>1</sup> / <sub>16</sub>	1856	
40 TO 42	16- 81/4	5086	15- 2 <sup>3</sup> / <sub>4</sub>	4642	16- 8 <sup>1</sup> / <sub>4</sub>	5086	6- 31/4	1911	
45 TO 47	18- 43/4	5607	16-11 <sup>1</sup> / <sub>4</sub>	5163	18- 43/4	5607	6- 31/4	1911	
50 TO 54, 5K TO 5R	16- 81/2	5093	15- 31/2	4661	16- 8 <sup>1</sup> / <sub>2</sub>	5093	6- 87/8	2054	
5A TO 5C	16- 81/2	5093	15- 31/2	4661	16- 8 <sup>1</sup> / <sub>2</sub>	5093	6- 87/8	2054	See
55 TO 59, 5T TO 5Z	18- 5	5613	17- 0	5182	18- 5	5613	6- 8 <sup>7</sup> / <sub>8</sub>	2054	Note 7
5F TO 5H	18- 5	5613	17- 0	5182	18- 5	5613	6- 8 <sup>7</sup> / <sub>8</sub>	2054	
60 TO 64, 6K TO 6R	16- 83/4	5099	15- 4 <sup>1</sup> / <sub>8</sub>	4677	16- 83/4	5099	6-113/4	2127	
65 TO 69, 6T TO 6Z	18- 5 <sup>1</sup> / <sub>4</sub>	5620	17- 05/8	5197	18- 5 <sup>1</sup> / <sub>4</sub>	5620	6-113/4	2127	
70 TO 74, 7K TO 7R	19- 93/4	6039	18- 35/8	5579	19- 93/4	6039	9- 63/8	2905	
75 TO 79, 7T TO 7Z	21- 93/4	6649	20- 35/8	6188	21- 93/4	6649	9- 63/8	2905	
80 TO 84, 8K TO 8R	19-101/2	6058	18- 4	5583	19-10 <sup>1</sup> / <sub>2</sub>	6058	10- 5	3175	
85 TO 87, 8T TO 8Z	21-101/2	6668	20- 4	6198	21-10 <sup>1</sup> / <sub>2</sub>	6668	10- 5	3175	
A4	23- 13/4	7055	21- 81/2	6617	20-11	6375	10- 63/8	3210	
A6	25- 1 <sup>3</sup> / <sub>4</sub>	7665	23- 81/2	7226	22-11	6985	10- 63/8	3210	
Α4	23- 13/4	7055	22- 13/4	6750	21- 13/4	6446	11- 0 <sup>1</sup> / <sub>8</sub>	3356	
<b>A</b> 6	25- 1 <sup>3</sup> / <sub>4</sub>	7665	24- 1 <sup>3</sup> / <sub>4</sub>	7360	23- 13/4	7055	11- 0 <sup>1</sup> / <sub>8</sub>	3356	See
В6	26- 6 <sup>3</sup> / <sub>4</sub>	8097	25- 2 <sup>1</sup> / <sub>2</sub>	7680	24- 23/4	7385	12- 3 <sup>7</sup> / <sub>8</sub>	3756	Note 5
B8	28- 63/4	8706	27- 21/2	8293	26- 23/4	7994	12- 10 <sup>3</sup> / <sub>8</sub>	3921	
C6	26- 63/4	8097	25- 4 <sup>7</sup> / <sub>8</sub>	7744	24- 23/4	8097	12- 3 <sup>7</sup> / <sub>8</sub>	3756	
C6	26-11	8204	25- 7 <sup>1</sup> / <sub>8</sub>	7801	24- 7	7493	13- 6 <sup>5</sup> / <sub>8</sub>	4131	

Assumes both cooler and condenser nozzles on same end of chiller.

Service access should be provided per ASHRAE 15, latest edition, NFPA 70, and local safety code.
 Allow at least 3 ft (915 mm) overhead clearance for service rigging for frame 2-4 compressor. Overhead clearance for service rigging frame 5 compressor should be 5 ft (1524 mm). Overhead clearance for service rigging frame 6 compressor should be 5 ft (1524 mm). Overhead clearance for service rigging frame 7 compressor should be 6 ft 4 in. (1930 mm).

- 3. Dimensions are approximate. Certified drawings available upon request.

- request.

  4. Marine waterboxes may add 6 in. to the width of the machine. See certified drawings for details.

  5. 19XR height can vary depending on the configuration. Check 19XR certified drawings for height information.

  6. "A" length dimensions shown are for standard 150-psig design and Victaulic connections. The 300-psig design and/or flanges will add length. See certified drawings.

  7. The 19XRV height can vary depending on the configuration. Check 19XRV certified drawings for height information.

<sup>1</sup> or 3-pass length applies if cooler is a 1 or 3-pass design.

Table 5 — 19XR Component Weights

COMPONENT	FRAN COMPRE		FRAN COMPRE			ME 4 ESSOR*	FRA COMPR		FRAI COMPR		FRAI COMPR	
	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg	lb	kg
SUCTION ELBOW	116	53	185	84	239	108	407	185	303	137	337	171
DISCHARGE ELBOW	100	45	125	57	157	71	325	147	245	111	427	194
CONTROL PANEL†	92	72	92	72	92	72	92	72	92	42	92	42
OPTIONAL COOLER INLET ISOLATION VALVE	8	4	13	6	20	9	24	11	24	11	24	11
OPTIONAL DISCHARGE ISOLATION VALVE	26	12	46	21	74	34	108	49	93	42	93	42
STD TIER VFD — 380, 400, AND 460-V (230, 335, 445 A)	650	295	650	295	_	_	_	_	_	_	_	
STD TIER VFD — 380, 400, AND 460-V (485, 550 A)	_	_	1035	469	1035	469	_		_	_	_	_
STD TIER VFD — 380, 400, AND 460-V (605, 680 A)	_	_	1600	726	1600	726	_	1	_	_	_	
STD TIER VFD — 380, 400, AND 460-V (765 A)	_	_		_	1600	726	_	_	_	_	_	_
STD TIER VFD — 380, 400, AND 460-V (855, 960, 1070 A)	_	_	1	_	1600	726	1600	726	1600	726	1600	726
STD TIER VFD — 380, 400, AND 460-V (1275 A)	_	_	1	_	3000	1361	3000	1361	3000	1361	3000	1361
STD TIER VFD — 380, 400, AND 460-V (1530 A)	_	_		_		_	3000	1361	3000	1361	3000	1361
LIQUIFLO™ 2 VFD — 380, 400, AND 460-V (442 A)	1600	726	1600	726		_	_	_	_	_	_	_
LIQUIFLO 2 VFD — 380, 400, AND 460-V (608 A)		_	1600	726	1600	726	_	_	_	_	_	_
LIQUIFLO 2 VFD — 380, 400, AND 460-V (900 A)		_		_	2800	1270	2800	1270	2800	1270	2800	1270
LIQUIFLO 2 VFD — 380, 400, AND 460-V (1200 A)		_		_	2850	1293	2850	1293	2850	1293	2850	1293
LIQUIFLO 2 VFD — 575-V (390 A)	2200	998	2200	998				_				
VFD SHELF			_		1049	476	1049	476	1049	476	1049	476

To determine compressor frame size, refer to 19XR,XRV Computer Selection Program.
Included in total cooler weight.

NOTE: VFD sizes are available on select heat exchanger models; consult the 19XR,XRV Computer Selection program.

### Table 6 — 19XR Component Weights

COMPONENT	FRAME 6 C	OMPRESSOR	FRAME 7 CO	OMPRESSOR
COMPONENT	lb	kg	lb	kg
SUCTION PIPE ASSEMBLY (INCLUDES FLANGES)	486	220	613	278
OPTIONAL COOLER INLET ISOLATION VALVE	26	12	28	13
OPTIONAL DISCHARGE ISOLATION VALVE	277	91	324	147
HMI PANEL	25	11	25	11
CONTROL PANEL	190	86	190	86
ECONOMIZER COVER	132	60	182	83
HIGH SIDE FLOAT CHAMBER COVER	132	60	182	83

\*Included in total cooler weight.
NOTE: Variable frequency drive (VFD) sizes are available on select heat exchanger models; consult the 19XR,XRV Computer Selection program.

### Table 7 — 19XR,XRV 19XR,XRV Compressor and Motor Weights\*— Standard and High-Efficiency Motors Compressor Frame Size 2†

			ENGLIS	SH					SI			
		60 H	łz	50 H	łz			60 H	łz	50 H	łz	
MOTOR CODE	Compressor Weight** (lb)	Stator Weight†† (lb)	Rotor Weight (lb)	Stator Weight†† (lb)	Rotor Weight (lb)	End Bell Cover Weight (lb)	Compressor Weight** (kg)	Stator Weight†† (kg)	Rotor Weight (kg)	Stator Weight†† (kg)	Rotor Weight (kg)	End Bell Cover Weight (kg)
			STAN	DARD-EFF	CIENCY	MOTORS /	LOW VOLTAGE	(200-575	V)	•		
BDS	2300	900	190	915	205	185	1043	408	86	415	93	84
BES	2300	915	200	965	220	185	1043	415	91	438	100	84
BFS	2300	975	215	1000	230	185	1043	442	98	454	104	84
BGS	2300	1000	230	1060	250	185	1043	454	104	481	113	84
BHS	2300	1030	240	1105	265	185	1043	467	109	501	120	84
BJS	2300	1105	265	_	_	185	1043	501	120	_	_	84
			HIC	GH-EFFICIE	NCY MC	TORS / LC	W VOLTAGE (2	00-575 V)				
BDH	2300	1030	240	1030	240	185	1043	467	109	467	109	84
BEH	2300	1070	250	1070	250	185	1043	485	113	485	113	84
BFH	2300	1120	265	1120	265	185	1043	508	120	508	120	84
BGH	2300	1175	290	1175	290	185	1043	533	132	533	132	84
внн	2300	1175	290	1175	290	185	1043	533	132	533	132	84
ВЈН	2300	1175	290	_	_	185	1043	533	132	_	_	84
JBH	2300	1003	226	1063	248	185	1043	455	103	482	112	84
JCH	2300	1063	248	1113	263	185	1043	482	112	505	119	84
JDH	2300	1113	263	1149	278	185	1043	505	119	521	126	84
JEH	2300	1149	278	1196	295	185	1043	521	126	542	134	84
JFH	2300	1196	295	_	_	185	1043	542	134	_	_	84

Total compressor weight is the sum of the compressor aerodynamic components (compressor weight column), stator, rotor, and end bell cover weights.

See Model Number Nomenclature.

 <sup>\*\*</sup> Compressor aerodynamic component weight only, motor weight not included. Applicable to standard compressors only. For high lift compressors, contact Carrier Chiller Marketing for weights.
 †† Stator weight includes the stator and shell.

## Table 8 — 19XR,XRV Compressor and Motor Weights\*— Standard and High-Efficiency Motors Compressor Frame Size 3†

			ENGLIS	SH					SI			
		60 H	łz	50 H	łz	End Bell		60 H	łz	50 H	łz	End Bell
MOTOR CODE	Compressor Weight** (lb)	Stator Weight†† (lb)	Rotor Weight (lb)	Stator Weight†† (lb)	Rotor Weight (lb)	Cover Weight (lb)	Compressor Weight** (kg)	Stator Weight†† (kg)	Rotor Weight (kg)	Stator Weight†† (kg)	Rotor Weight (kg)	Cover Weight (kg)
	I	1	STAN	DARD-EFF	CIENCY	MOTORS	LOW VOLTAGE	(200-575	V)	I		
CBS	2816	1146	219	1188	236	274	1277	520	99	539	107	124
ccs	2816	1171	227	1196	242	274	1277	531	103	542	110	124
CDS	2816	1198	237	1258	255	274	1277	543	108	571	116	124
CES	2816	1207	240	1272	258	274	1277	547	109	577	117	124
CLS	2816	1247	249	1328	273	274	1277	566	113	602	124	124
CMS	2816	1270	257	1353	278	274	1277	576	117	614	126	124
CNS	2816	1321	266	1386	282	274	1277	599	121	629	128	124
CPS	2816	1334	269	1401	287	274	1277	605	122	635	130	124
cqs	2816	1353	276	1408	290	274	1277	614	125	639	132	124
CRS	2816	1259	321	_	_	274	1277	571	146	_	_	124
CRS (380V)	2816	1328	346	_	_	274	1277	602	157	_	_	124
			HIC	GH-EFFICIE	ENCY MO	TORS / LC	W VOLTAGE (2	00-575 V)				
СВН	2816	1235	239	1290	254	274	1277	560	108	585	115	124
ССН	2816	1260	249	1295	259	274	1277	572	113	587	117	124
CDH	2816	1286	258	1358	273	274	1277	583	117	616	124	124
CEH	2816	1305	265	1377	279	274	1277	592	120	625	127	124
CLH	2816	1324	271	1435	292	274	1277	601	123	651	132	124
СМН	2816	1347	275	1455	298	274	1277	611	125	660	135	124
CNH	2816	1358	278	1467	301	274	1277	616	126	665	137	124
СРН	2816	1401	290	1479	304	274	1277	635	132	671	138	124
CQH	2816	1455	304	1479	304	274	1277	670	138	671	138	124
KBH	2816	1313	276	1353	285	274	1277	596	125	614	129	124
КСН	2816	1353	285	1381	291	274	1277	614	129	626	132	124
KDH	2816	1381	291	1417	307	274	1277	626	132	643	139	124
KEH	2816	1417	307	1441	313	274	1277	643	139	654	142	124
KFH	2816	1441	313	1470	320	274	1277	654	142	667	145	124
KGH	2816	1470	320	1505	333	274	1277	667	145	683	151	124
KHH	2816	1505	333	_	_	274	1277	683	151	_	_	124
UB	2816	1371	316	1391	330	274	1277	622	143	631	150	124
UC	2816	1391	330	1419	344	274	1277	631	150	644	156	124
UD	2816	1419	344	1455	372	274	1277	644	156	660	169	124
UE	2816	1455	372	1479	386	274	1277	660	169	671	175	124
UF	2816	1479	386	1508	400	274	1277	671	175	684	181	124
UG	2816	1508	400	1543	421	274	1277	684	181	700	191	124
UH	2816	1543	421			274	1277	700	191	_	_	124
ODII	0040	1 4444					UM VOLTAGE (2			T 50.4	440	101
CBH	2816	1114	242	1156	255	274	1277	505	110	524	116	124
	2816	1129	247	1163	257	274	1277	512	112	528	117	124
CDH	2816	1155	253	1190	263	274	1277	524	115	540	119	124
CEH	2816	1175	263	1236	276	274	1277	533	119	561	125	124
CLH	2816	1242	280	1305	296	274	1277	563	127	592	134	124
CMH	2816	1321	303	1305	296	274	1277	599	137	592	134	124
СРН	2816	1369	316	1386	316	274	1277	621	143	629	143	124
CQH	2816	1411	329	1386	316	274	1277	640	149	629	143	124
CUH	2816	1411	329	1428	329	274	1277	640	149	648	149	124

Total compressor weight is the sum of the compressor aerodynamic components (compressor weight column), stator, rotor, and end bell cover weights.
See Model Number Nomenclature.

 <sup>\*\*</sup> Compressor aerodynamic component weight only, motor weight not included. Applicable to standard compressors only. For high lift compressors, contact Carrier Chiller Marketing for weights.
 †† Stator weight includes the stator and shell.

### Table 9 — 19XR,XRV Compressor and Motor Weights\*— Standard and High-Efficiency Motors Compressor Frame Size 4†

1			ENG	LISH					S	SI .		
MOTOR	Compressor Weight**	60 H	łz	50 H	łz	End Bell	Compressor Weight**	60 H	łz	50 H	łz	End Bell
CODE	(lb) Fixed Ring/ Split Ring	Stator Weight†† (lb)	Rotor Weight (lb)	Stator Weight†† (lb)	Rotor Weight (lb)	Cover Weight (lb)	(kg) Fixed Ring/ Split Ring	Stator Weight†† (kg)	Rotor Weight (kg)	Stator Weight†† (kg)	Rotor Weight (kg)	Cover Weight (kg)
			STA	NDARD-EF	FICIENC	Y MOTORS /	LOW VOLTAG	E (200-575	V)			
DBS	3425 / 4211	1570	324	1725	347	236	1554 / 1910	712	147	782	157	107
DCS	3425 / 4211	1580	326	1737	352	236	1554 / 1910	717	148	788	160	107
DDS	3425 / 4211	1595	329	1749	357	236	1554 / 1910	723	149	793	162	107
DES	3425 / 4211	1685	345	1762	365	236	1554 / 1910	764	156	799	166	107
DFS	3425 / 4211	1690	348	1801	372	236	1554 / 1910	767	158	817	169	107
DGS	3425 / 4211	1692	352	1858	386	236	1554 / 1910	767	160	843	175	107
DHS	3425 / 4211	1774	366	1904	398	236	1554 / 1910	805	166	864	181	107
DJS	3425 / 4211	_	_	2020	401	318	1554 / 1910	_	_	916	182	142
	i -		STAND	ARD-EFFIC	CIENCY	MOTORS / ME	DIUM VOLTAC	E (2400-4	160 V)	<del>i</del>	1	
DBS	3425 / 4211	1524	296	1637	327	236	1554 / 1910	691	134	743	148	107
DCS	3425 / 4211	1569	307	1685	354	236	1554 / 1910	712	139	764	161	107
DDS	3425 / 4211	1588	313	1713	357	236	1554 / 1910	720	142	777	162	107
DES	3425 / 4211	1613	324	1746	360	236	1554 / 1910	732	147	792	163	107
DFS	3425 / 4211	1675	347	1811	381	236	1554 / 1910	760	157	821	173	107
DGS	3425 / 4211	1704	355	1998	422	236 (60 Hz) 318 (50 Hz)	1554 / 1910	773	161	906	191	107 (60 Hz) 142 (50 Hz)
DHS	3425 / 4211	1737	361	2056	443	236 (60 Hz) 318 (50 Hz)	1554 / 1910	788	164	933	201	107 (60 Hz) 142 (50 Hz)
DJS	3425 / 4211	1769	365	2101	464	236 (60 Hz) 318 (50 Hz)	1554 / 1910	802	166	953	210	107 (60 Hz) 142 (50 Hz)
	T	T		ARD-EFFIC	IENCY I	MOTORS / ME	DIUM VOLTAC	E (6300-69	900 V)	ı	I	
DDS	3425 / 4211	1919	423	2069	458	318	1554 / 1910	870	192	938	208	142
DES	3425 / 4211	1939	428	2089	463	318	1554 / 1910	880	194	947	210	142
DFS	3425 / 4211	1989	448	2139	478	318	1554 / 1910	902	203	970	217	142
DGS	3425 / 4211	2054	473	_		318	1554 / 1910	932	215	_		142
DHS	3425 / 4211	2099	488	_		318	1554 / 1910	952	221	_		142
DJS	3425 / 4211	2159	508	_	_	318	1554 / 1910	979	230	_	_	142
	T	1		IIGH-EFFIC	IENCY I	MOTORS / LO	W VOLTAGE (2	200-575 V)	ı	ı	ı	
DBH	3425 / 4211	1773	406	1827	406	318	1554 / 1910	804	184	829	184	142
DCH	3425 / 4211	1827	406	1827	414	318	1554 / 1910	829	184	829	188	142
DDH	3425 / 4211	1827	414	1881	422	318	1554 / 1910	829	188	853	191	142
DEH	3425 / 4211	1881	422	1881	422	318	1554 / 1910	853	191	853	191	142
DFH	3425 / 4211	1881	439	1963	439	318	1554 / 1910	853	199	890	199	142
DGH	3425 / 4211	1963	455	1963	455	318	1554 / 1910	890	206	890	206	142
DHH	3425 / 4211	1963	455	2050	463	318	1554 / 1910	890	206	930	210	142
DJH	3425 / 4211		_	2050	471	318	1554 / 1910	_		930	213	142
DKH	3425 / 4211	2050	471		_	318	1554 / 1910	930	214	_		142
LBH	3425 / 4211	1873	364	1939	389	318	1554 / 1910	850	165	880	176	144
LCH	3425 / 4211	1939	389	2023	406	318	1554 / 1910	880	176	918	184	144
LDH	3425 / 4211	2023	406	2043	417	318	1554 / 1910	918	184	927	189	144
LEH	3425 / 4211	2043	417	2096	434	318	1554 / 1910	927	189	951	197	144
LFH	3425 / 4211	2096	434	2133	444	318	1554 / 1910	951	197	968	201	144
LGH	3425 / 4211	2133	444	2199	458	318	1554 / 1910	968	201	997	208	144
LHH	3425 / 4211	2199	458	2066	437	318	1554 / 1910	997	208	937	198	144

## Table 9 — 19XR,XRV Compressor and Motor Weights\*— Standard and High-Efficiency Motors Compressor Frame Size 4†(cont)

			ENG	LISH					S	i		
MOTOR	Compressor	60 H	łz	50 H	łz	End Bell	Compressor	60 H	łz	50 H	łz	End Bell
CODE	Weight** (lb) Fixed Ring/ Split Ring	Stator Weight†† (lb)	Rotor Weight (lb)	Stator Weight†† (lb)	Rotor Weight (lb)	Cover Weight (lb)	Weight** (kg) Fixed Ring/ Split Ring	Stator Weight†† (kg)	Rotor Weight (kg)	Stator Weight†† (kg)	Rotor Weight (kg)	Cover Weight (kg)
			HIGI	H-EFFICIEI	ICY MO	TORS / MEDIL	JM VOLTAGE (	2400-4160	V)			
DBH	3425 / 4211	1950	405	1950	405	318	1554 / 1910	885	184	885	184	144
DCH	3425 / 4211	1950	405	2025	429	318	1554 / 1910	885	184	919	195	144
DDH	3425 / 4211	1950	405	2025	429	318	1554 / 1910	885	184	919	195	144
DEH	3425 / 4211	2025	429	2100	452	318	1554 / 1910	919	195	953	205	144
DFH	3425 / 4211	2025	429	2100	452	318	1554 / 1910	919	195	953	205	144
DGH	3425 / 4211	2100	452	2200	480	318	1554 / 1910	953	205	998	218	144
DHH	3425 / 4211	2100	452	2320	575	318	1554 / 1910	953	205	1052	261	144
DJH	3425 / 4211	2100	452	2320	587	318	1554 / 1910	953	205	1052	266	144
DKH	3425 / 4211	2320	587	_	_	318	1554 / 1910	1052	266	_	_	144
		•	HIGI	H-EFFICIEI	ICY MO	TORS / MEDIL	JM VOLTAGE (	(6300-6900	V)	•		
DDH	3425 / 4211	2150	536	2250	546	318	1554 / 1910	975	243	1021	248	144
DEH	3425 / 4211	2150	550	2250	550	318	1554 / 1910	975	249	1021	249	144
DFH	3425 / 4211	2250	575	2380	567	318	1554 / 1910	1021	261	1080	261	144
DGH	3425 / 4211	2250	599	2380	599	318	1554 / 1910	1021	272	1080	272	144
DHH	3425 / 4211	2380	604	2380	604	318	1554 / 1910	1080	274	1080	274	144
DJH	3425 / 4211	2380	614	2380	614	318	1554 / 1910	1080	279	1080	279	144
DKH	3425 / 4211	2380	614	_	_	318	1554 / 1910	1080	279	_	_	144

Total compressor weight is the sum of the compressor aerodynamic components (compressor weight column), stator, rotor, and end bell cover weights.
See Model Number Nomenclature.

 <sup>\*\*</sup> Compressor aerodynamic component weight only, motor weight not included. Applicable to standard compressors only. For high lift compressors, contact Carrier Chiller Marketing for weights.
 †† Stator weight includes the stator and shell.

### Table 10 — 19XR,XRV Compressor and Motor Weights\*— Standard and High-Efficiency Motors Compressor Frame Size 5†

-			ENGL	SH					SI			
MOTOR	0	60 1		50 I	Hz	End Bell	0	60 I		50 I	Ηz	End Bell
CODE	Compressor Weight** (lb)	Stator Weight†† (lb)	Rotor Weight (lb)	Stator Weight†† (lb)	Rotor Weight (lb)	Cover Weight (lb)	Compressor Weight** (kg)	Stator Weight†† (kg)	Rotor Weight (kg)	Stator Weight†† (kg)	Rotor Weight (kg)	Cover Weight (kg)
	l	<b>\</b> '-7	_ ` /	. ,	_ ` '	OTORS /	LOW VOLTAG			( 3)	( 3/	
EHS	7285	2843	741	2943	775	414	3304	1290	336	1335	352	188
EJS	7285	2826	741	2943	775	414	3304	1281	336	1335	352	188
EKS	7285	2943	775	2997	810	414	3304	1335	352	1359	367	188
ELS	7285	2932	775	2997	810	414	3304	1330	352	1359	367	188
EMS	7285	2986	810	3096	862	414	3304	1354	367	1404	391	188
ENS	7285	2986	810	3203	914	414	3304	1354	367	1453	415	188
EPS	7285	2986	810	3203	914	414	3304	1354	367	1453	415	188
EQS	7285	3013	621	_	_	414	3304	1367	282	_	_	188
			STANDA	RD-EFFICIE	NCY MOT	ORS / ME	DIUM VOLTA	GE (2400-41	160 V)			
EHS	7285	2744	706	2818	741	414	3304	1245	320	1278	336	188
EJS	7285	2816	741	2892	775	414	3304	1277	336	1312	352	188
EKS	7285	2816	741	2930	775	414	3304	1277	336	1329	352	188
ELS	7285	2808	741	3005	810	414	3304	1274	336	1363	367	188
EMS	7285	2892	775	3005	810	414	3304	1322	352	1363	367	188
ENS	7285	2997	775	3143	879	414	3304	1359	352	1426	399	188
EPS	7285	2967	810	3144	879	414	3304	1346	367	1426	399	188
EQS	7285	3081	872	_		414	3304	1398	396	_		188
	1	Т	STANDA	RD-EFFICIE	NCY MOT	ORS / ME	DIUM VOLTA	GE (6300-69	900 V)	1		
EHS	7285	2773	735	2845	769	414	3304	1258	333	1290	349	188
EJS	7285	2855	769	2855	769	414	3304	1295	349	1295	349	188
EKS	7285	2919	803	2919	803	414	3304	1324	364	1324	364	188
ELS	7285	2908	803	3058	871	414	3304	1319	364	1387	395	188
EMS	7285	3029	854	3068	871	414	3304	1374	387	1392	395	188
ENS	7285	3023	854	3281	974	414	3304	1371	387	1488	442	188
EPS	7285	3068	871	3288	974	414	3304	1392	395	1491	442	188
							W VOLTAGE (	, , ,		1		
EHH	7285	2939	776	2995	810	414	3304	1333	352	1359	367	188
EJH	7285	2944	776	3002	810	414	3304	1335	352	1362	367	188
EKH	7285	2992	810	3110	862	414	3304	1357	367	1411	391	188
ELH	7285	2299	810	3099	862	414	3304	1043	367	1406	391	188
EMH	7285	2965	810	3210	914	414	3304	1345	367	1456	415	188
ENH	7285	3015	855	3293	974	414	3304	1368	388	1494	442	188
EPH	7285	3029	855	3289	974	414	3304	1374	388	1492	442	188
EQH	7285	3162	664		_	414	3304	1434	301	1005	_	188
MBH	7285	2795	645	2856	665	414	3304	1268	293	1295	302	188
MCH	7285	2873	672	2925	693	414	3304	1303	305	1327	314	188
MDH	7285	2906	684	3013	724	414	3304	1318	310	1367	328	188
MEH MFH	7285	2956	704	3071	737	414	3304	1341	319	1392	334	188
	7285	3034	724	3153	791	414	3304	1376	328	1430	359	188
MGH	7285	3071	737		_	414	3304	1393	334	_		188

# Table 10 — 19XR,XRV Compressor and Motor Weights\*— Standard and High-Efficiency Motors Compressor Frame Size 5†(cont)

			ENGLI	SH					SI			
MOTOR	Compressor	60	Hz	50	Hz	End Bell	Compressor	60	Hz	50 I	Hz	End Bell
CODE	Weight** (lb)	Stator Weight†† (lb)	Rotor Weight (lb)	Stator Weight†† (lb)	Rotor Weight (lb)	Cover Weight (lb)	Weight** (kg)	Stator Weight†† (kg)	Rotor Weight (kg)	Stator Weight†† (kg)	Rotor Weight (kg)	Cover Weight (kg)
			HIGH-	EFFICIENC	Y MOTOR	S/MEDIU	M VOLTAGE	(2400-4160	V)		-	
EHH	7285	2939	776	2997	810	414	3304	1333	352	1359	367	188
EJH	7285	2999	810	3108	862	414	3304	1360	367	1410	391	188
EKH	7285	2988	810	3102	862	414	3304	1355	367	1407	391	188
ELH	7285	2981	810	3065	872	414	3304	1352	367	1390	396	188
ЕМН	7285	3031	855	3077	872	414	3304	1375	388	1396	396	188
ENH	7285	3075	872	3260	974	414	3304	1395	396	1479	442	188
EPH	7285	3081	872	3298	974	414	3304	1398	396	1496	442	188
EQH	7285	3195	657	_	_	414	3304	1449	298	_	_	188
			HIGH-	EFFICIENC	Y MOTOR	S/MEDIU	M VOLTAGE	(6300-6900	V)			-
EHH	7285	2998	810	3097	862	414	3304	1360	367	1405	391	188
EJH	7285	3029	855	3100	862	414	3304	1374	388	1406	391	188
EKH	7285	3049	855	3064	872	414	3304	1383	388	1390	396	188
ELH	7285	3068	872	3060	872	414	3304	1390	396	1388	396	188
EMH	7285	_		3072	872	414	3304	_	_	1393	396	188
ENH	7285	3075	872	3260	974	414	3304	1395	396	1479	442	188
EPH	7285	3081	872	3288	974	414	3304	1398	396	1491	442	188
EQH	7285	3195	657	_		414	3304	1449	298	_	-	188
			HIGH	-EFFICIENC	у мотог	RS / HIGH	VOLTAGE (10	000-11000	V)			<u></u>
МСН	7285	_	_	3956	678	414	3304	_	_	1794	308	188
MDH	7285	_		3956	678	414	3304	_		1794	308	188
MFH	7285			4062	719	414	3304		_	1842	326	188
MGH	7285	3820	657		_	414	3304	1733	298	_	_	188
МНН	7285	3820	657			414	3304	1733	298	_		188
			HI	GH-EFFICIE	ENCY MO	TORS / HIG	GH VOLTAGE	(13800 V)				
МНН	7285	3779	646			414	3304	1714	293			188

Total compressor weight is the sum of the compressor aerodynamic components (compressor weight column), stator, rotor, and end bell cover weights.
See Model Number Nomenclature.

 <sup>\*\*</sup> Compressor aerodynamic component weight only, motor weight not included. Applicable to standard compressors only. For high lift compressors, contact Carrier Chiller Marketing for weights.
 †† Stator weight includes the stator and shell.

Table 11 — 19XR,XRC Compressor and Motor Weights\*— Standard and High-Efficiency Motors Compressor Frame Size C†

			ENGL	ISH					SI			
Motor		50			)Hz		Compres-	50H	Z	60	Hz	
Code	Compressor Weight (lb)	Stator Weight (lb)	Rotor Weight (lb)	Stator Weight (lb)	Rotor Weight (lb)	End Cover (lb)	sor Weight (kg)	Stator Weight (kg)	Rotor Weight (kg)	Stator Weight (kg)	Rotor Weight (kg)	End Cover (kg)
	I	( ' )				/ LOW VOLT	TAGE (230 -		\ 3/	( 3)	( 3)	
VB	3265	1936	474	1876	459	317	1481	878	215	851	208	144
VC	3265	2008	494	1936	474	317	1481	911	224	878	215	144
VD	3265	2057	518	2008	494	317	1481	933	235	911	224	144
VE	3265	2092	534	2057	518	317	1481	949	242	933	235	144
VF	3265	2156	558	2092	534	317	1481	978	253	949	242	144
VG	3265	2200	591	2156	558	317	1481	998	268	978	253	144
VH	3265	2200	591	2200	591	317	1481	998	268	998	268	144
LB	3265	1935	387	1875	373	317	1481	878	176	851	169	144
LC	3265	2008	405	1935	387	317	1481	911	184	878	176	144
LD	3265	2056	417	2008	405	317	1481	933	189	911	184	144
LE	3265	2092	433	2056	417	317	1481	949	196	933	189	144
LF	3265	2156	444	2092	433	317	1481	978	201	949	196	144
LG	3265	2199	458	2156	444	317	1481	997	208	978	201	144
LH	3265	2230	458	2199	458	317	1481	1012	208	997	208	144
	1		HIG	H EFFICIEI	NCY MOTOR	RS / LOW VO	DLTAGE (40	0 V)	I	I	l l	
VB	3678	1936	474	_	_	317	1668	878	215	_	_	144
VC	3678	2008	494	_	_	317	1668	911	224	_	_	144
VD	3678	2057	518	_	_	317	1668	933	235	_	_	144
VE	3678	2092	534	_	_	317	1668	949	242	_	_	144
VF	3678	2156	558	_	_	317	1668	978	253	_	_	144
VG	3678	2200	591	_	_	317	1668	998	268	_	_	144
VH	3678	2200	591	_	_	317	1668	998	268	_	_	144
	I	HIGH EI		MOTORS	/ LOW VOL	TAGE (380/3	3/60 or 460/3	3/60 or 575/3	3/60 V)	I	1	
VB	3678	1876	459	_	_	317	1668	851	208	_	_	144
VC	3678	1936	474	_	_	317	1668	878	215	_	_	144
VD	3678	2008	494	_	_	317	1668	911	224	_	_	144
VE	3678	2057	518	_	_	317	1668	933	235	_	_	144
VF	3678	2092	534	_	_	317	1668	949	242	_	_	144
VG	3678	2156	558	_	_	317	1668	978	253	_	_	144
VH	3678	2200	591	_	_	317	1668	998	268	_	_	144
	+		HIGH EFF	ICIENCY N	OTORS / M	EDIUM VOL	TAGE (3000	- 6900 V)	2	!	<u>,                                      </u>	
DB	3265	1950	405	1950	405	338	1481	885	184	885	184	153
DD	3265	2025	429	2025	429	338	1481	919	195	919	195	153
DF	3265	2100	452	2100	452	338	1481	953	205	953	205	153
DH	3265	2380	522	2250	480	338	1481	1080	237	1021	218	153
	1		HIGH			S / HIGH VO			I.	l	l	
LD	3265	2659	646	_	_	413	1481	1206	293	_	_	187
LF	3265	2665	646	_	_	413	1481	1209	293	<u> </u>	_	187
LH	3265	2760	666	_	_	413	1481	1252	302	_	_	187
	•		HIGH	EFFICIEN	CY MOTORS	S / HIGH VO	LTAGE (110	00 V)		•		
LD	3678	2659	646	_	_	413	1668	1206	293	_	_	187
LF	3678	2659	646	_	_	413	1668	1209	293	_	_	187
LH	3678	2754	666	_	_	413	1668	1252	302	_	_	187

 <sup>\*</sup> Total compressor weight is the sum of the compressor aerodynamic components (compressor weight column), stator, rotor, and end bell cover weights.
 † See Model Number Nomenclature.

 <sup>\*\*</sup> Compressor aerodynamic component weight only, motor weight not included. Applicable to standard compressors only.
 †† Stator weight includes the stator and shell.

### Table 12 — 19XR,XRV Compressor and Motor Weights\*— Standard and High-Efficiency Motors Compressor Frame Size E†

			ENGLI	SH					SI			
MOTOR	0	60 I	Hz	50 I	-lz	End Bell	0	60	Hz	50 I	Hz	End Bell
CODE	Compressor Weight** (lb)	Stator Weight†† (lb)	Rotor Weight (kg)	Stator Weight†† (lb)	Rotor Weight (kg)	Cover Weight (lb)	Compressor Weight** (lb)	Stator Weight†† (lb)	Rotor Weight (kg)	Stator Weight†† (lb)	Rotor Weight (kg)	Cover Weight (lb)
			STANI	DARD-EFFI	CIENCY M	IOTORS /	LOW VOLTAG	E (380-575	V)	_		
6H	4853	2843	741	2943	775	414	2201	1290	336	1335	352	188
6J	4853	2826	741	2943	775	414	2201	1281	336	1335	352	188
6K	4853	2943	775	2997	810	414	2201	1335	352	1359	367	188
6L	4853	2932	775	2997	810	414	2201	1330	352	1359	367	188
6M	4853	2986	810	3096	862	414	2201	1354	367	1404	391	188
6N	4853	2986	810	3203	914	414	2201	1354	367	1453	415	188
6P	4853	2986	810	3203	914	414	2201	1354	367	1453	415	188
			STANDA	RD-EFFICIE	NCY MOT	ORS / ME	DIUM VOLTA	GE (2400-41	160 V)			
6H	4853	2744	706	2818	741	414	2201	1245	320	1278	336	188
6J	4853	2816	741	2892	775	414	2201	1277	336	1312	352	188
6K	4853	2816	741	2930	775	414	2201	1277	336	1329	352	188
6L	4853	2808	741	3005	810	414	2201	1274	336	1363	367	188
6M	4853	2892	775	3005	810	414	2201	1322	352	1363	367	188
6N	4853	2997	775	3143	879	414	2201	1359	352	1426	399	188
6P	4853	2967	810	3144	879	414	2201	1346	367	1426	399	188
6Q	4853	3081	872	_	_	414	2201	1398	396	_		188
	•		HIC	H-EFFICIE	NCY MOT	ORS / LO	V VOLTAGE (	380-460 V)		•		
EH	4853	2939	776	2995	810	414	2201	1333	352	1359	367	188
EJ	4853	2944	776	3002	810	414	2201	1335	352	1362	367	188
EK	4853	2992	810	3110	862	414	2201	1357	367	1411	391	188
EL	4853	2299	810	3099	862	414	2201	1043	367	1406	391	188
EM	4853	2965	810	3210	914	414	2201	1345	367	1456	415	188
EN	4853	3015	855	3293	974	414	2201	1368	388	1494	442	188
EP	4853	3029	855	3289	974	414	2201	1374	388	1492	442	188
			HIC	H-EFFICIE	NCY MOT	ORS / LO	W VOLTAGE (	l .				
MB	4853	2795	645	2856	665	414	2201	1268	293	1295	302	188
MC	4853	2873	672	2925	693	414	2201	1303	305	1327	314	188
MD	4853	2906	684	3013	724	414	2201	1318	310	1367	328	188
ME	4853	2956	704	3071	737	414	2201	1341	319	1392	334	188
MF	4853	3034	724	3153	791	414	2201	1376	328	1430	359	188
MG	4853	3071	737	_	_	414	2201	1393	334	_	_	188
			HIGH-	EFFICIENC	Y MOTOR	S / MEDIU	M VOLTAGE	(2400-4160	V)	·		
EH	4853	2939	776	2997	810	414	2201	1333	352	1359	367	188
EJ	4853	2999	810	3108	862	414	2201	1360	367	1410	391	188
EK	4853	2988	810	3102	862	414	2201	1355	367	1407	391	188
EL	4853	2981	810	3065	872	414	2201	1352	367	1390	396	188
EM	4853	3031	855	3077	872	414	2201	1375	388	1396	396	188
EN	4853	3075	872	3260	974	414	2201	1395	396	1479	442	188
EP	4853	3081	872	3298	974	414	2201	1398	396	1496	442	188
			HIGH-	EFFICIENC	Y MOTOR	S / MEDIU	M VOLTAGE	(6300-6900	V)			
EH	4853	2998	810	3097	862	414	2201	1360	367	1405	391	188
EJ	4853	3029	855	3100	862	414	2201	1374	388	1406	391	188
EK	4853	3049	855	3064	872	414	2201	1383	388	1390	396	188
EL	4853	3068	872	3060	872	414	2201	1390	396	1388	396	188
EM	4853	_	_	3072	872	414	2201	_	_	1393	396	188
EN	4853	3075	872	3260	974	414	2201	1395	396	1479	442	188
EP	4853	3081	872	3288	974	414	2201	1398	396	1491	442	188

## Table 12 — 19XR,XRV Compressor and Motor Weights\*— Standard and High-Efficiency Motors Compressor Frame Size E†(cont)

-			ENGLI	SH					SI			
MOTOR	Compressor	60 I	Hz	50	Hz	End Bell	Compressor	60 I	Hz	50 I	Ηz	End Bell
CODE	Weight** (lb)	Stator Weight†† (lb)	Rotor Weight (kg)	Stator Weight†† (lb)	Rotor Weight (kg)	Cover Weight (lb)	Compressor Weight** (lb)	Stator Weight†† (lb)	Rotor Weight (kg)	Stator Weight†† (lb)	Rotor Weight (kg)	Cover Weight (lb)
			HIGH-	-EFFICIENC	у мотог	RS / HIGH	VOLTAGE (10	000-11000	V)			
MD	4853	_		3956	678	414	2201			1794	308	188
MF	4853	_	_	4062	719	414	2201	_	_	1842	326	188
МН	4853	3820	657	_	_	414	2201	1733	298	_	_	188
		•	HI	GH-EFFICIE	ENCY MO	TORS / HIG	GH VOLTAGE	(13800 V)	•			
МН	4853	3779	646	_		414	2201	1714	293	_	_	188

Total compressor weight is the sum of the compressor aerodynamic components (compressor weight column), stator, rotor, and end bell cover weights.
See Model Number Nomenclature.

 <sup>\*\*</sup> Compressor aerodynamic component weight only, motor weight not included. Applicable to standard compressors only. For high lift compressors, contact Carrier Chiller Marketing for weights.
 †† Stator weight includes the stator and shell.

Table 13 — 19XR Compressor and Motor Weights\* — High-Efficiency Motors Two-Stage Compressor Frame Size 6, 60 Hz

		ENGLISH	!			SI		
MOTOR CODE	COMPRESSOR WEIGHT† (lb)	STATOR AND HOUSING WEIGHT (lb)	ROTOR AND SHAFT WEIGHT (lb)	END BELL COVER WEIGHT (lb)	COMPRESSOR WEIGHT† (kg)	STATOR AND HOUSING WEIGHT (kg)	ROTOR AND SHAFT WEIGHT (kg)	END BELI COVER WEIGHT (kg)
/oltage: 380	)-3-60	<b>.</b>	1			_		
N	10,287	1153	5928	1021	4666	2689	523	463
Р	10,287	1153	5928	1021	4666	2689	523	463
Q	10,287	1179	6107	1021	4666	2770	535	463
R	10,287	1153	6109	1021	4666	2771	523	463
S	10,287	1153	6144	1021	4666	2787	523	463
T	10,287	1179	6151	1021	4666	2790	535	463
oltage: 460	)-3-60	1	1			_	, ,	
N	10,287	1153	5946	1021	4666	2697	523	463
P	10,287	1153	5948	1021	4666	2698	523	463
Q	10,287	1179	6107	1021	4666	2770	535	463
R	10,287	1179	6111	1021	4666	2772	535	463
S	10,287	1188	6149	1021	4666	2789	539	463
Т	10,287	1188	6153	1021	4666	2791	539	463
oltage: 240	0-3-60							
N	10,287	5929	1212	1021	4666	2689	550	463
Р	10,287	6021	1230	1021	4666	2731	558	463
Q	10,287	6112	1248	1021	4666	2772	566	463
R	10,287	6190	1264	1021	4666	2808	573	463
S	10,287	6268	1280	1021	4666	2843	581	463
Т	10,287	6259	1280	1021	4666	2839	581	463
oltage: 330	00-3-60							
N	10,287	5927	1212	1021	4666	2688	550	463
P	10,287	6019	1230	1021	4666	2730	558	463
Q	10,287	6110	1248	1021	4666	2771	566	463
R	10,287	6187	1264	1021	4666	2806	573	463
S	10,287	6263	1280	1021	4666	2841	581	463
T	10,287	6277	1280	1021	4666	2847	581	463
/oltage: 416	60-3-60							
N	10,287	6103	1247	1021	4666	2768	566	463
Р	10,287	6103	1248	1021	4666	2768	566	463
Q	10,287	6103	1248	1021	4666	2768	566	463
R	10,287	6185	1264	1021	4666	2805	573	463
s	10,287	6268	1280	1021	4666	2843	581	463
Т	10,287	6268	1280	1021	4666	2843	581	463
/oltage: 690	00-3-60							
N	10,287	6558	1316	1021	4666	2975	600	463
P	10,287	6559	1316	1021	4666	2975	600	463
Q	10,287	6559	1316	1021	4666	2975	600	463
R	10,287	6566	1316	1021	4666	2978	600	463
s	10,287	6574	1316	1021	4666	2982	600	463
T	10,287	6604	1351	1021	4666	2996	613	463
/oltage: 110	000-3-60		·	·				
N	10,287	6587	1351	1021	4666	2988	613	463
Р	10,287	6587	1351	1021	4666	2988	613	463
Q	10,287	6587	1351	1021	4666	2988	613	463
R	10,287	6716	1385	1021	4666	3036	628	463
S	10,287	6844	1419	1021	4666	3104	644	463
Т	10,287	6844	1419	1021	4666	3104	644	463

Table 13 — 19XR Compressor and Motor Weights\* — High-Efficiency Motors Two-Stage Compressor Frame Size 6, 60 Hz (cont)

		ENGLISH	1		SI						
MOTOR CODE	COMPRESSOR WEIGHT† (lb)	STATOR AND HOUSING WEIGHT (lb)	ROTOR AND SHAFT WEIGHT (lb)	END BELL COVER WEIGHT (lb)	COMPRESSOR WEIGHT† (kg)	STATOR AND HOUSING WEIGHT (kg)	ROTOR AND SHAFT WEIGHT (kg)	END BELL COVER WEIGHT (kg)			
Voltage: 138	300-3-60										
N	10,287	6554	1351	1021	4666	2973	613	463			
Р	10,287	6554	1351	1021	4666	2973	613	463			
Q	10,287	6554	1351	1021	4666	2973	613	463			
R	10,287	6709	1385	1021	4666	3043	628	463			
S	10,287	6864	1419	1021	4666	3113	644	463			
Т	10,287	6864	1419	1021	4666	3113	644	463			

Total compressor weight is the sum of the compressor aerodynamic components (compressor weight column), stator, rotor, and end bell cover weights.

<sup>†</sup> Compressor aerodynamic component weight only, motor weight not included. Applicable to standard compressors only.

Table 14 — 19XR Compressor and Motor Weights\* — High-Efficiency Motors Two-Stage Compressor Frame Size 6, 50 Hz

		ENGLISH	1		SI					
MOTOR CODE	COMPRESSOR WEIGHT† (lb)	STATOR AND HOUSING WEIGHT (lb)	ROTOR AND SHAFT WEIGHT (lb)	END BELL COVER WEIGHT (lb)	COMPRESSOR WEIGHT† (kg)	STATOR AND HOUSING WEIGHT (kg)	ROTOR AND SHAFT WEIGHT (kg)	END BELL COVER WEIGHT (kg)		
Voltage: 40	0-3-50	, ,					, ,,			
N	10,287	1153	5917	1021	4666	2684	523	463		
Р	10,287	1153	5919	1021	4666	2685	523	463		
Q	10,287	1179	6105	1021	4666	2769	535	463		
R	10,287	1179	6107	1021	4666	2770	535	463		
S	10,287	1188	6149	1021	4666	2789	539	463		
Т	10,287	1188	6151	1021	4666	2790	539	463		
Voltage: 30	00-3-50	1				1				
N	10,287	5918	1212	1021	4666	2684	550	463		
Р	10,287	6006	1230	1021	4666	2724	558	463		
Q	10,287	6094	1248	1021	4666	2764	566	463		
R	10,287	6184	1264	1021	4666	2805	573	463		
S	10,287	6274	1280	1021	4666	2846	581	463		
Т	10,287	6296	1280	1021	4666	2856	581	463		
Voltage: 33	,			-						
N	10,287	5913	1212	1021	4666	2682	550	463		
Р	10,287	6007	1230	1021	4666	2725	558	463		
Q	10,287	6101	1248	1021	4666	2767	566	463		
R	10,287	6192	1264	1021	4666	2809	573	463		
S	10,287	6283	1280	1021	4666	2850	581	463		
Т	10,287	6266	1280	1021	4666	2842	581	463		
Voltage: 63		1								
N	10,287	6277	1280	1021	4666	2847	581	463		
Р	10,287	6333	1298	1021	4666	2873	589	463		
Q	10,287	6389	1316	1021	4666	2898	600	463		
R	10,287	6473	1316	1021	4666	2936	600	463		
S	10,287	6556	1316	1021	4666	2974	600	463		
Т	10,287	6609	1351	1021	4666	2998	613	463		
Voltage: 10	000-3-50	-								
N	10,287	6281	1280	1021	4666	2849	581	463		
Р	10,287	6281	1281	1021	4666	2849	581	463		
Q	10,287	6281	1281	1021	4666	2849	581	463		
R	10,287	6441	1316	1021	4666	2922	600	463		
S	10,287	6600	1351	1021	4666	2994	613	463		
Т	10,287	6156	1351	1021	4666	2792	613	463		
Voltage: 11	•	1				1				
N	10,287	6600	1351	1021	4666	2994	613	463		
Р	10,287	6600	1351	1021	4666	2994	613	463		
Q	10,287	6600	1351	1021	4666	2994	613	463		
R	10,287	6765	1385	1021	4666	3069	628	463		
S	10,287	6930	1419	1021	4666	3143	644	463		
T	10,287	6930			.500	0110	V 1 1	.00		

<sup>\*</sup> Total compressor weight is the sum of the compressor aerodynamic components (compressor weight column), stator, rotor, and end bell cover weights.

<sup>†</sup> Compressor aerodynamic component weight only, motor weight not included. Applicable to standard compressors only.

Table 15 — 19XR Compressor and Motor Weights\* — High-Efficiency Motors Two-Stage Compressor Frame Size 7, 60 Hz

		ENGLISH	<u> </u>			SI		
MOTOR CODE	COMPRESSOR WEIGHT† (lb)	STATOR AND HOUSING WEIGHT (lb)	ROTOR AND SHAFT WEIGHT (Ib)	END BELL COVER WEIGHT (Ib)	COMPRESSOR WEIGHT† (kg)	STATOR AND HOUSING WEIGHT (kg)	ROTOR AND SHAFT WEIGHT (kg)	END BELL COVER WEIGHT (kg)
Voltage: 2400	0-3-60							
U	16,024	6719	1443	983	7268	3048	654	446
٧	16,024	6718	1443	983	7268	3047	654	446
W	16,024	6717	1443	983	7268	3047	654	446
Х	16,024	6811	1460	983	7268	3089	662	446
Υ	16,024	6906	1476	983	7268	3132	670	446
Z	16,024	7073	1509	983	7268	3208	684	446
/oltage: 3300	0-3-60	•						
U	16,024	6723	1443	983	7268	3049	654	446
٧	16,024	6730	1443	983	7268	3053	654	446
W	16,024	6736	1443	983	7268	3055	654	446
Х	16,024	6816	1460	983	7268	3092	662	446
Υ	16,024	6895	1476	983	7268	3128	670	446
Z	16,024	7055	1509	983	7268	3200	684	446
Voltage: 4160	0-3-60							
U	16,024	6739	1443	983	7268	3057	654	446
٧	16,024	6721	1443	983	7268	3049	654	446
W	16,024	6703	1443	983	7268	3040	654	446
Х	16,024	6778	1460	983	7268	3074	662	446
Υ	16,024	6853	1476	983	7268	3108	670	446
Z	16,024	7069	1509	983	7268	3206	684	446
/oltage: 6900		1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1						
U	16,024	6730	1443	983	7268	3053	654	446
V	16,024	6909	1476	983	7268	3134	670	446
w	16,024	7088	1509	983	7268	3215	684	446
x	16,024	7076	1509	983	7268	3210	684	446
Y	16,024	7064	1509	983	7268	3204	684	446
z	16,024	7141	1542	983	7268	3239	699	446
Voltage: 1100		7141	1342	903	7200	3239	099	440
G G	16,024	7434	1700	983	7268	3372	771	486
		+				+		
н .	16,024	7602	1768	983	7268	3448	802	486
J	16,024	7602	1768	983	7268	3448	802	486
K	16,024	7602	1768	983	7268	3448	802	446
L	16,024	7602	1768	983	7268	3448	802	486
М	16,024	7767	1837	983	7268	3523	833	486
U	16,024	7042	1509	983	7268	3194	684	446
٧	16,024	7085	1526	983	7268	3214	692	446
W	16,024	7128	1542	983	7268	3233	699	446
X	16,024	7131	1542	983	7268	3235	699	446
Υ	16,024	7135	1542	983	7268	3236	699	446
Z	16,024	7313	1575	983	7268	3317	714	446
/oltage: 1380			1	,		1	1	
U	16,024	7073	1509	983	7268	3208	684	446
V	16,024	7109	1526	983	7268	3225	692	446
W	16,024	7146	1542	983	7268	3241	699	446
X	16,024	7146	1542	983	7268	3241	699	446
Υ	16,024	7146	1542	983	7268	3241	699	446
Z	16,024	7295	1575	983	7268	3309	714	446

<sup>\*</sup> Total compressor weight is the sum of the compressor aerodynamic components (compressor weight column), stator, rotor, and end bell cover weights.

<sup>†</sup> Compressor aerodynamic component weight only, motor weight not included. Applicable to standard compressors only.

Table 16 — 19XR Compressor and Motor Weights\* — High-Efficiency Motors Two-Stage Compressor Frame Size 7, 50 Hz

		ENGLISH	l			SI		
MOTOR CODE	COMPRESSOR WEIGHT† (lb)	STATOR AND HOUSING WEIGHT (lb)	ROTOR AND SHAFT WEIGHT (Ib)	END BELL COVER WEIGHT (Ib)	COMPRESSOR WEIGHT† (kg)	STATOR AND HOUSING WEIGHT (kg)	ROTOR AND SHAFT WEIGHT (kg)	END BELL COVER WEIGHT (kg)
Voltage: 300	0-3-50	•						
U	16,024	6725	1443	983	7268	3050	654	446
٧	16,024	6716	1443	983	7268	3046	654	446
W	16,024	6706	1443	983	7268	3042	654	446
Х	16,024	6802	1460	983	7268	3085	662	446
Υ	16,024	6899	1476	983	7268	3129	670	446
Z	16,024	7066	1509	983	7268	3205	684	446
Voltage: 330	0-3-50							
U	16,024	6743	1443	983	7268	3059	654	446
V	16,024	6739	1443	983	7268	3057	654	446
W	16,024	6734	1443	983	7268	3054	654	446
Х	16,024	6826	1460	983	7268	3096	662	446
Υ	16,024	6917	1476	983	7268	3137	670	446
Z	16,024	7075	1509	983	7268	3209	684	446
Voltage: 630	0-3-50							
U	16,024	6743	1443	983	7268	3059	654	446
٧	16,024	6900	1476	983	7268	3130	670	446
W	16,024	7058	1509	983	7268	3201	684	446
Х	16,024	7130	1526	983	7268	3234	692	446
Υ	16,024	7203	1542	983	7268	3267	699	446
Z	16,024	7203	1542	983	7268	3267	699	446
Voltage: 100	00-3-50							
G	16,024	7269	1631	983	7268	3297	740	446
Н	16,024	7269	1631	983	7268	3297	740	446
J	16,024	7269	1631	983	7268	3297	740	446
К	16,024	7602	1768	983	7268	3448	802	446
L	16,024	7602	1768	983	7268	3448	802	446
М	16,024	7769	1837	983	7268	3523	833	446
U	16,024	6904	1476	983	7268	3132	670	446
٧	16,024	6907	1476	983	7268	3133	670	446
W	16,024	6910	1476	983	7268	3134	670	446
Х	16,024	7074	1509	983	7268	3209	684	446
Υ	16,024	7238	1542	983	7268	3283	699	446
Z	16,024	7401	1575	983	7268	3357	714	446
Voltage: 110	00-3-50	•						
G	16,024	7434	1700	983	7268	3372	771	446
Н	16,024	7602	1768	983	7268	3448	802	446
J	16,024	7602	1768	983	7268	3448	802	446
К	16,024	7602	1768	983	7268	3448	802	446
L	16,024	7602	1768	983	7268	3448	802	446
М	16,024	7767	1837	983	7268	3523	833	446
U	16,024	7139	1509	983	7268	3238	684	446
V	16,024	7186	1526	983	7268	3260	692	446
w	16,024	7234	1542	983	7268	3281	699	446
X	16,024	7234	1542	983	7268	3281	699	446
Υ	16,024	7234	1542	983	7268	3281	699	446
Z	16,024	7383	1575	983	7268	3349	714	446

<sup>\*</sup> Total compressor weight is the sum of the compressor aerodynamic components (compressor weight column), stator, rotor, and end bell cover weights.

<sup>†</sup> Compressor aerodynamic component weight only, motor weight not included. Applicable to standard compressors only.

Table 17 — Economizer Weight

FRAME SIZE	DRY WEIGHT (lb)*	REFRIGERANT WEIGHT (Ib)	OPERATION WEIGHT (lb)	DRY WEIGHT (kg)*	REFRIGERANT WEIGHT (kg)	OPERATION WEIGHT (kg)
XRC (fr 5 HX)	1019	210	1229	462	95	557
XRC (fr 6,7 HX)	1252	250	1502	568	113	681
XRE	1054	283	1337	478	128	606
XR6	1589	360	1949	721	163	884
XR7	2749	646	3395	1247	293	1540

<sup>\*</sup> Includes economizer weight and all connecting piping to compressor.

Table 18 — 19XR Additional Data for Marine Waterboxes (19XR2-E)\*

			ENGLISH	ł				SI		
HEAT EXCHANGER FRAME, PASS	2010	RIGGING	WEIGHT (LB)	WATER V	OLUME (GAL)	1/0.4	RIGGING	WEIGHT (KG)	WATER VOLUME (L)	
FRAME, FASS	PSIG	COOLER	CONDENSER	COOLER	CONDENSER	KPA	COOLER	CONDENSER	COOLER	CONDENSER
FRAME 2, 1 AND 3 PASS		730	_	84	_		331		318	_
FRAME 2, 2 PASS		365	365	42	42		166	166	159	159
FRAME 3, 1 AND 3 PASS		730	_	84	_		331	1	318	
FRAME 3, 2 PASS		365	365	42	42		166	166	159	159
FRAME 4, 1 AND 3 PASS		1888		109	_		856	1	412	1
FRAME 4, 2 PASS		944	989	54	54		428	449	205	205
FRAME 5, 1 AND 3 PASS	150	2445	_	122	_	1034	1109	ı	462	_
FRAME 5, 2 PASS	150	1223	1195	61	60	1034	555	542	231	226
FRAME 6, 1 AND 3 PASS		2860	_	139	_		1297	1	524	
FRAME 6, 2 PASS		1430	1443	69	69		649	655	262	262
FRAME 7, 1 AND 3 PASS		3970	_	309	_		1801	1	1170	_
FRAME 7, 2 PASS		1720	1561	155	123		780	708	585	465
FRAME 8, 1 AND 3 PASS		5048	_	364	_		2290		1376	_
FRAME 8, 2 PASS		2182	1751	182	141		990	794	688	532
FRAME 2, 1 AND 3 PASS		860	_	84	_		390	1	318	
FRAME 2, 2 PASS		430	430	42	42		195	195	159	159
FRAME 3, 1 AND 3 PASS		860	_	84	_		390	1	318	_
FRAME 3, 2 PASS		430	430	42	42		195	195	159	159
FRAME 4, 1 AND 3 PASS		2162	_	109	_		981		412	_
FRAME 4, 2 PASS		1552	1641	47	47		704	744	178	178
FRAME 5, 1 AND 3 PASS	300	2655	_	122	_	2068	1204	-	462	_
FRAME 5, 2 PASS	300	1965	1909	53	50	2000	891	866	199	190
FRAME 6, 1 AND 3 PASS		3330	_	139	_		1510	1	524	_
FRAME 6, 2 PASS		2425	2451	58	58		1100	1112	218	218
FRAME 7, 1 AND 3 PASS		5294	_	309	_		2401	_	1170	
FRAME 7, 2 PASS		4140	4652	146	94		1878	2110	553	356
FRAME 8, 1 AND 3 PASS	]	6222	_	364	_		2822		1376	
FRAME 8, 2 PASS		4952	4559	161	94		2246	2068	609	355

<sup>\*</sup> Add to heat exchanger data for total weights or volumes.

NOTE: For the total weight of a vessel with a marine waterbox, add these values to the heat exchanger weights (or volumes).

Table 19 — 19XRV Additional Data for Marine Waterboxes (19XR6/7)\*

				ENGLISH	(lb)			SI (kg)					
HEAT EXCHANGER FRAME, PASS	COUPLING TYPE	psig	Riggi	ng Weight	Wate	er Weight	kPa	Riggi	ng Weight	Wate	er Weight		
TRAME, TAGO		psig	Cooler	Condenser	Cooler	Condenser	кРа	Cooler	Condenser	Cooler	Condenser		
SIZE 6,	Victaulic		2,794	2,582	6,515	5,648		1267	1171	2955	2562		
FRAME A, 1 PASS	Flange		3,124	2,912	0,515	5,046		1417	1321	2900	2502		
SIZE 6,	Victaulic		2,454	2,236	0.070	0.040		1113	1014	0070	4405		
FRAME A, 2 PASS	Flange		2,650	2,432	2,979	2,613		1202	1103	2979	1185		
SIZE 6,	Victaulic	Ī	2,771	2,840	4.400	0.050	1	1157	1288	4000	4700		
FRAME A, 3 PASS	Flange	Ī	2,899	3,020	4,190	3,950		1315	1370	1900	1792		
SIZE 6,	Victaulic	Ī		2,604		0.075	1		1181		0.400		
FRAME B, 1 PASS	Flange	Ť	_	2,934	_	6,975		_	1331	_	3162		
SIZE 6,	Victaulic	Ť		2,459		2 222			1115		4000		
FRAME B, 2 PASS	Flange	Ť	_	2,719	_	3,600		_	1233	_	1633		
SIZE 6,	Victaulic	Ť		2,770					1256		2222		
FRAME B, 3 PASS	Flange	Ť	_	2,950	_	4,858		_	1338	_	2203		
SIZE 7	Victaulic		4,045	_			Ī	1835					
FRAME B, 1 PASS	Flange	t	4,375	_	8,103	_		1984	_	3675	_		
SIZE 7	Victaulic	t	3,648	_				1655	_				
FRAME B, 2 PASS	Flange	150	3,908	_	4,139	_	1034	1773		1877	_		
•	Victaulic	t	4,160	_			1	1887					
SIZE 7 FRAME B, 3 PASS	Flange	†	4,340	_	5,633	_		1969		2555	_		
	Victaulic	†	4,828	4,273			1	2190	1938				
SIZE 7 FRAME C, 1 PASS	Flange	ł	5,158	4,273	10,264	9,858		2340	2138	4655	4472		
	Victaulic	†	4,375	3,714			1	1984	1685				
SIZE 7 FRAME C, 2 PASS	Flange	•	4,635	4,044	5,201	4,826		2102	1834	2359	2189		
	Victaulic	•	4,957	4,434			1	2248	2011				
SIZE 7 FRAME C, 3 PASS	Flange	•	5,137	4,630	7,144	6,819		2330	2100	3240	3093		
	Victaulic	ł	5,137	4,863			1	2330	2206				
SIZE 7 FRAME D, 1 PASS				·	_	12,530				_	5684		
	Flange	ł		5,303			1	_	2405				
SIZE 7 FRAME D, 2 PASS	Victaulic			4,243	_	6,074	_	_	1925	_	2755		
· · · · · · · · · · · · · · · · · · ·	Flange			4,573					2074		<u> </u>		
SIZE 7 FRAME D, 3 PASS	Victaulic		_	5,079	_	8,659		_	2303	-	3928		
	Flange			5,275				_	2393				
SIZE 6,	Victaulic		2,794	2,582	6,515	5,648			1171	2955	2562		
FRAME A, 1 PASS	Flange		3,124	2,912			_	1417	1321				
SIZE 6, FRAME A, 2 PASS	Victaulic		2,454	2,236	2,979	2,613		1113	1014	2979	1185		
·	Flange		2,650	2,432			_	1202	1103				
SIZE 6, FRAME A, 3 PASS	Victaulic		2,771	2,840	4,190	3,950		1157	1288	1900	1792		
FRANC A, 3 PASS	Flange		2,899	3,020		•	4	1315	1370				
SIZE 6,	Victaulic		_	2,604	_	6,975		_	1181	_	3162		
FRAME B, 1 PASS	Flange			2,934		-,-	4		1331				
SIZE 6,	Victaulic		_	2,459	_	3,600		_	1115	_	1633		
FRAME B, 2 PASS	Flange			2,719		-,	1		1233		,		
SIZE 6,	Victaulic	<b>.</b>	_	2,770	_	4,858		_	1256	_	2203		
FRAME B, 3 PASS	Flange	<b>.</b>		2,950		,	1		1338				
SIZE 7	Victaulic	<b>.</b>	8,305	_	5,783	_		3767	_	2623	_		
FRAME B, 1 PASS	Flange	<b>.</b>	8,635	_	-,		1	3917					
SIZE 7	Victaulic	300	7,426	_	2,382	_	2068	3368		1080	_		
FRAME B, 2 PASS	Flange		7,686	_	,			3486	_				
SIZE 7	Victaulic	ļ	7,785		3,268	_		3531		1482	_		
FRAME B, 3 PASS	Flange	ļ	7,965	_	-,		1	3612	_				
SIZE 7	Victaulic	ļ	11,001	9,228	7,030	7,591		4990	4186	3188	3443		
FRAME C, 1 PASS	Flange	Flange Victaulic Flange Victaulic Flange Victaulic Flange	11,331	9,668	. ,000	7,001		5140	4385	3,00	00		
SIZE 7			9,829	8,003	2,708	3,061		4458	3630	1228	1388		
FRAME C, 2 PASS	-		10,089	8,333	_,, 50	3,001		4576	3682	0	.000		
SIZE 7			10,343	8,647	3,866	4,468		4692	3922	1753	_		
FRAME C, 3 PASS	Flange		10,053	8,843	5,500	1, 100		4773	_	1,00			
SIZE 7	Victaulic		_	12,940	_	9,365		_	5869		4248		
FRAME D, 1 PASS	Flange		_	13,380		9,303		_	5927	_	7240		
SIZE 7	Victaulic	Victaulic		11,170		3,607			<b>- </b>	_	5067		1925
FRAME D, 2 PASS	Flange Victaulic			11,500		3,007	_		5102	_	1920		
SIZE 7				12,042		F 000		_	5462				
FRAME D, 3 PASS	Flange			12,238		5,398							

<sup>\*</sup> Add to heat exchanger data for total weights or volumes.

NOTE: For the total weight of a vessel with a marine waterbox, add these values to the heat exchanger weights (or volumes).

Table 20 — Additional Weights for 19XR 150 psig (1034 kPa) Marine Waterboxes\*
Two-Stage Compressors, Frame Size 6†

-				ENGLI	SH (LB)			METRIC (KG)						
FRAME	NUMBER OF		COOLER		CC	NDENSER		(	COOLER		CONDENSER			
FRAIME	PASSES	RIGGING	WEIGHT	WATER	RIGGING WEIGHT		WATER	RIGGING WEIGHT		WATER	RIGGING WEIGHT WA		WATER	
		VICTAULIC	FLANGE	WEIGHT	VICTAULIC	FLANGE	WEIGHT	VICTAULIC	FLANGE	WEIGHT	VICTAULIC	FLANGE	WEIGHT	
	1	2794	3124	6515	2582	2912	5648	1267	1417	2955	1171	1321	2562	
Α	2	2454	2650	2979	2236	2432	2613	1113	1202	2979	1014	1103	1185	
	3	2771	2899	4190	2840	3020	3950	1157	1315	1900	1288	1370	1792	
	1	_	_	_	2604	2934	6975	_	_	_	1181	1331	3162	
В	2	_	_	_	2459	2719	3600	_	_	1	1115	1233	1633	
	3	_	_	_	2770	2950	4858	_	_	_	1256	1338	2203	

<sup>\*</sup> Add to cooler and condenser weights for total weights. Cooler and condenser weights may be found in Tables 7-16. The first digit of the heat exchanger code (first column) is the heat exchanger frame size.

Table 21 — Additional Weights for 19XR 300 psig (2068 kPa) ASME Marine Waterboxes\*
Two-Stage Compressors, Frame Size 6

				ENGLI	SH (LB)			METRIC (KG)						
FRAME	NUMBER OF		COOLER		CONDENSER			(	COOLER		CONDENSER			
FRAIVIE	PASSES	RIGGING	WEIGHT	WATER	RIGGING WEIGHT		WATER	RIGGING WEIGHT		WATER	RIGGING WEIGHT		WATER	
		VICTAULIC	FLANGE	WEIGHT	VICTAULIC	FLANGE	WEIGHT	VICTAULIC	FLANGE	WEIGHT	VICTAULIC	FLANGE	WEIGHT	
	1	6379	6709	5058	5573	5903	4426	2893	3043	2294	2528	2678	2008	
Α	2	5594	5790	2101	4834	5030	1890	2537	2626	953	2193	2282	857	
	3	6031	6159	3005	5310	5490	2688	2736	2794	1363	2409	2490	1219	
	1	_	_	_	7084	7414	5509	_	_	_	3213	3363	2499	
В	2	_	-	-	6474	6734	2577	_	_	_	2937	3054	1169	
	3	_	_	_	6816	6996	3340	_	_	_	3092	3173	1515	

ASME — American Society of Mechanical Engineers

Table 22 — Additional Weights for 19XR 150 psig (1034 kPa) Marine Waterboxes\*
Two-Stage Compressors, Frame Size 7†

				ENGLI	SH (LB)			METRIC (KG)						
FRAME	NUMBER OF		COOLER		CC	NDENSER		(	COOLER		CC	NDENSER		
FRAIVIE	PASSES	RIGGING	WEIGHT	WATER	RIGGING \	WEIGHT	WATER	RIGGING \	RIGGING WEIGHT		RIGGING WEIGHT		WATER	
		VICTAULIC	FLANGE	WEIGHT	VICTAULIC	FLANGE	WEIGHT	VICTAULIC	FLANGE	WEIGHT	VICTAULIC	FLANGE	WEIGHT	
	1	4045	4375	8103		_	_	1835	1984	3675	_	_	_	
В	2	3648	3908	4139	-	1	_	1655	1773	1877	_	_	_	
	3	4160	4340	5633	_	_	_	1887	1969	2555	_	_	_	
	1	4828	5158	10,264	4273	4713	9858	2190	2340	4655	1938	2138	4472	
С	2	4375	4635	5201	3714	4044	4826	1984	2102	2359	1685	1834	2189	
	3	4957	5137	7144	4434	4630	6819	2248	2330	3240	2011	2100	3093	
	1	_	_	_	4863	5303	12,530	_	_	_	2206	2405	5684	
D	2		_	_	4243	4573	6074	_	-	_	1925	2074	2755	
	3	_	_	_	5079	5275	8659	_	_	_	2303	2393	3928	

Add to cooler and condenser weights for total weights. Cooler and condenser weights may be found in Tables 7-16. The first digit of the heat exchanger code (first column) is the heat exchanger frame size.

Table 23 — Additional Weights for 19XR 300 psig (2068 kPa) ASME Marine Waterboxes\*
Two-Stage Compressors, Frame Size 7

				ENGLI	SH (LB)			METRIC (KG)						
FRAME	NUMBER OF		COOLER		CONDENSER				COOLER		CONDENSER			
FRAME	PASSES	RIGGING	WEIGHT	WATER	RIGGING V	NEIGHT	WATER	RIGGING \	RIGGING WEIGHT		RIGGING WEIGHT		WATER	
		VICTAULIC	FLANGE	WEIGHT	VICTAULIC	FLANGE	WEIGHT	VICTAULIC	FLANGE	WEIGHT	VICTAULIC	FLANGE	WEIGHT	
	1	8305	8635	5783	_	_	_	3767	3917	2623	_	_	_	
В	2	7426	7686	2382		_	_	3368	3486	1080		_	_	
	3	7785	7965	3268	ı	1	_	3531	3612	1482	-	_	_	
	1	11,001	11,331	7030	9228	9668	7591	4990	5140	3188	4186	4385	3443	
С	2	9829	10,089	2708	8003	8333	3061	4458	4576	1228	3630	3682	1388	
	3	10,343	10,053	3866	8647	8843	4468	4692	4773	1753	3922	6069	2027	
	1	_	_	_	12,940	13,380	9365	_	_	_	5869	5927	4248	
D	2	_	_	_	11,170	11,500	3607	_	_	ı	5067	5102	1925	
	3	_			12,042	12,238	5398	_	-	-	5462	5551	2448	

Add to cooler and condenser weights for total weights. Cooler and condenser weights may be found in Tables 7-16. The first digit of the

<sup>†</sup> Values are for Victaulic nozzles, two-pass dished head design.

<sup>\*</sup> Add to cooler and condenser weights for total weights. Cooler and condenser weights may be found in Tables 7-16. The first digit of the heat exchanger code (first column) is the heat exchanger frame size.

<sup>†</sup> Values are for Victaulic nozzles, two-pass dished head design.

heat exchanger code (first column) is the heat exchanger frame size.

Table 24 — 19XR Waterbox Cover Weights Cooler Frames 2, 3

		ENGLI	SH (LB)		METRIC (KG)					
		cod	DLER		COOLER					
WATERBOX DESCRIPTION	FR/	ME 2	FRA	ME 3	FRA	ME 2	FRAME 3			
	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED		
NIH, 1 Pass Cover, 150 psig (1034 kPa)	287	318	287	318	130	144	130	144		
NIH, 2 Pass Cover, 150 psig (1034 kPa)	287	340	287	340	130	154	130	154		
NIH, 3 Pass Cover, 150 psig (1034 kPa)	294	310	294	310	133	141	133	141		
MWB End Cover, 150 psig (1034 kPa)	315	315	315	315	143	143	143	143		
NIH/MWB Return Cover, 150 psig (1034 kPa)	243	243	243	243	110	110	110	110		
NIH, 1 Pass Cover, 300 psig (2068 kPa)	411	486	411	486	186	220	186	220		
NIH, 2 Pass Cover, 300 psig (2068 kPa)	411	518	411	518	186	235	186	235		
NIH, 3 Pass Cover, 300 psig (2068 kPa)	433	468	433	468	196	212	196	212		
NIH Plain End Cover, 300 psig (2068 kPa)	291	291	291	291	132	132	132	132		
MWB End Cover, 300 psig (2068 kPa)	619	619	619	619	281	281	281	281		
MWB Return Cover, 300 psig (2068 kPa)	445	445	445	445	202	202	202	202		

NIH — Nozzle-in-Head MWB — Marine Waterbox STD — Standard NOTE: Weight for NIH 2-pass cover, 150 psig (1034 kPa), is included in the heat exchanger weights shown in the heat exchanger weight tables.

Table 25 — 19XR Waterbox Cover Weights Condenser Frames 2, 3

		ENGLI	SH (LB)			METR	IC (KG)	
		COND	ENSER			COND	ENSER	
WATERBOX DESCRIPTION	FRA	ME 2	FRAME 3		FR.A	ME 2	FRAME 3	
	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED
NIH, 1 Pass Cover, 150 psig (1034 kPa)	260	297	260	297	118	135	118	135
NIH, 2 Pass Cover, 150 psig (1034 kPa)	265	318	265	318	120	144	120	144
NIH, 3 Pass Cover, 150 psig (1034 kPa)	272	288	272	288	123	131	123	131
MWB End Cover, 150 psig (1034 kPa)	234	234	234	234	106	106	106	106
NIH/MWB Return Cover, 150 psig (1034 kPa)	225	225	225	225	102	102	102	102
NIH, 1 Pass Cover, 300 psig (2068 kPa)	379	454	379	454	172	206	172	206
NIH, 2 Pass Cover, 300 psig (2068 kPa)	379	486	379	486	172	220	172	220
NIH, 3 Pass Cover, 300 psig (2068 kPa)	401	436	401	436	182	198	182	198
NIH Plain End Cover, 300 psig (2068 kPa)	270	270	270	270	122	122	122	122
MWB End Cover, 300 psig (2068 kPa)	474	474	474	474	215	215	215	215
MWB Return Cover, 300 psig (2068 kPa)	359	359	359	359	163	163	163	163

**LEGEND** 

NIH — Nozzle-in-Head MWB — Marine Waterbox STD — Standard

Table 26 — 19XR Waterbox Cover Weights Cooler Frames 4, 5

		ENGLIS	SH (LB)		METRIC (KG)					
		COO	LER		COOLER					
WATERBOX DESCRIPTION	FR.	FRAME 4		FRAME 5		ME 4	FRAME 5			
	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED		
NIH, 1 Pass Cover, 150 psig (1034 kPa)	148	185	168	229	67	84	76	104		
NIH, 2 Pass Cover, 150 psig (1034 kPa)	202	256	224	276	92	116	102	125		
NIH, 3 Pass Cover, 150 psig (1034 kPa)	473	489	617	634	215	222	280	288		
MWB End Cover, 150 psig (1034 kPa)	317	317	393	393	144	144	178	178		
MWB Return Cover, 150 psig (1034 kPa)	138	138	154	154	63	63	70	70		
NIH, 1 Pass Cover, 300 psig (2068 kPa)	633	709	764	839	287	322	347	381		
NIH, 2 Pass Cover, 300 psig (2068 kPa)	626	689	761	867	284	313	345	394		
NIH, 3 Pass Cover, 300 psig (2068 kPa)	660	694	795	830	299	315	361	376		
NIH/MWB End Cover, 300 psig (2068 kPa)	522	522	658	658	237	237	298	298		

NIH — Nozzle-in-Head MWB — Marine Waterbox STD — Standard NOTE: Weight for NIH 2-pass cover, 150 psig (1034 kPa), is included in the heat exchanger weights shown in the heat exchanger weight tables.

Table 27 — 19XR Waterbox Cover Weights Condenser Frames 4, 5

		ENGLIS	SH (LB)		METRIC (KG)					
		COND	ENSER		CONDENSER					
WATERBOX DESCRIPTION	FRAME 4		FRAME 5		FR.A	ME 4	FRAME 5			
	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED		
NIH, 1 Pass Cover, 150 psig (1034 kPa)	148	185	168	229	67	84	76	104		
NIH, 2 Pass Cover, 150 psig (1034 kPa)	191	245	224	298	87	111	102	135		
NIH, 3 Pass Cover, 150 psig (1034 kPa)	503	519	629	655	228	235	285	297		
MWB End Cover, 150 psig (1034 kPa)	317	317	393	393	144	144	178	178		
MWB Return Cover, 150 psig (1034 kPa)	138	138	154	154	63	63	70	70		
NIH, 1 Pass Cover, 300 psig (2068 kPa)	633	709	764	839	287	322	347	381		
NIH, 2 Pass Cover, 300 psig (2068 kPa)	622	729	727	878	282	331	330	393		
NIH, 3 Pass Cover, 300 psig (2068 kPa)	655	689	785	838	297	313	356	376		
NIH/MWB End Cover, 300 psig (2068 kPa)	522	522	658	658	237	237	298	298		

LEGEND

NIH — Nozzle-in-Head MWB — Marine Waterbox STD — Standard

Table 28 — 19XR Waterbox Cover Weights Cooler Frames 6, 7

		ENGLIS	SH (LB)		METRIC (KG)					
		COC	LER		COOLER					
WATERBOX DESCRIPTION	FRA	ME 6	FRAME 7		FR.A	ME 6	FRAME 7			
	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED		
NIH, 1 Pass Cover, 150 psig (1034 kPa)	187	223	329	441	85	101	149	200		
NIH, 2 Pass Cover, 150 psig (1034 kPa)	257	330	426	541	117	150	193	245		
NIH, 3 Pass Cover, 150 psig (1034 kPa)	765	791	1250	1291	347	359	567	586		
MWB End Cover, 150 psig (1034 kPa)	487	487	844	844	221	221	383	383		
MWB Return Cover, 150 psig (1034 kPa)	172	172	315	315	78	78	143	143		
NIH, 1 Pass Cover, 300 psig (2068 kPa)	978	1053	1712	1883	444	478	777	854		
NIH, 2 Pass Cover, 300 psig (2068 kPa)	927	1078	1662	1908	420	489	754	865		
NIH, 3 Pass Cover, 300 psig (2068 kPa)	997	1050	1724	1807	452	476	782	820		
NIH/MWB End Cover, 300 psig (2068 kPa)	834	834	1378	1378	378	378	625	625		

NIH — Nozzle-in-Head MWB — Marine Waterbox STD — Standard NOTE: Weight for NIH 2-pass cover, 150 psig (1034 kPa), is included in the heat exchanger weights shown in the heat exchanger weight tables.

Table 29 — 19XR Waterbox Cover Weights Condenser Frames 6, 7

		ENGLIS	SH (LB)			METR	IC (KG)		
		COND	ENSER		CONDENSER				
WATERBOX DESCRIPTION	FRAME 6		FRAME 7		FRAME 6		FRAME 7		
	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	
NIH, 1 Pass Cover, 150 psig (1034 kPa)	187	223	329	441	85	101	149	200	
NIH, 2 Pass Cover, 150 psig (1034 kPa)	245	330	404	520	111	150	183	236	
NIH, 3 Pass Cover, 150 psig (1034 kPa)	772	843	1222	1280	350	382	554	580	
MWB End Cover, 150 psig (1034 kPa)	487	487	781	781	221	221	354	354	
MWB Return Cover, 150 psig (1034 kPa)	172	172	700	700	78	78	318	318	
NIH, 1 Pass Cover, 300 psig (2068 kPa)	978	1053	315	315	444	478	143	143	
NIH, 2 Pass Cover, 300 psig (2068 kPa)	923	1074	1690	1851	419	487	767	840	
NIH, 3 Pass Cover, 300 psig (2068 kPa)	995	1049	1628	1862	451	476	738	845	
NIH/MWB End Cover, 300 psig (2068 kPa)	834	834	1714	1831	378	378	777	831	

**LEGEND** 

NIH — Nozzle-in-Head MWB — Marine Waterbox STD — Standard

Table 30 — 19XR Waterbox Cover Weights Cooler Frames 8

	ENGL	ISH (LB)	METR	RIC (KG)		
	CO	OLER	COOLER			
WATERBOX DESCRIPTION	FR	AME 8	FRA	AME 8		
	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED		
NIH, 1 Pass Cover, 150 psig (1034 kPa)	417	494	189	224		
NIH, 2 Pass Cover, 150 psig (1034 kPa)	540	693	245	314		
NIH, 3 Pass Cover, 150 psig (1034 kPa)	1629	1687	739	765		
MWB End Cover, 150 psig (1034 kPa)	1125	1125	510	510		
MWB Return Cover, 150 psig (1034 kPa)	404	404	183	183		
NIH, 1 Pass Cover, 300 psig (2068 kPa)	2359	2523	1070	1144		
NIH, 2 Pass Cover, 300 psig (2068 kPa)	2369	2599	1075	1179		
NIH, 3 Pass Cover, 300 psig (2068 kPa)	2353	2516	1067	1141		
NIH/MWB End Cover, 300 psig (2068 kPa)	1951	1951	885	885		

NIH — Nozzle-in-Head MWB — Marine Waterbox STD — Standard NOTE: Weight for NIH 2-pass cover, 150 psig (1034 kPa), is included in the heat exchanger weights shown in the heat exchanger weight tables.

Table 31 — 19XR Waterbox Cover Weights Condenser Frames 8

	ENGL	ISH (LB)	METR	RIC (KG)		
	CONE	DENSER	CONDENSER			
WATERBOX DESCRIPTION	FRA	AME 8	FRA	AME 8		
	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED		
NIH, 1 Pass Cover, 150 psig (1034 kPa)	417	494	189	224		
NIH, 2 Pass Cover, 150 psig (1034 kPa)	508	662	245	314		
NIH, 3 Pass Cover, 150 psig (1034 kPa)	1469	1527	739	765		
MWB End Cover, 150 psig (1034 kPa)	1007	1007	510	510		
MWB Return Cover, 150 psig (1034 kPa)	1307	1307	183	183		
NIH, 1 Pass Cover, 300 psig (2068 kPa)	404	404	1070	1144		
NIH, 2 Pass Cover, 300 psig (2068 kPa)	1986	2151	1075	1179		
NIH, 3 Pass Cover, 300 psig (2068 kPa)	1893	2222	1067	1141		
NIH/MWB End Cover, 300 psig (2068 kPa)	1993	2112	885	885		

**LEGEND** 

NIH — Nozzle-in-Head MWB — Marine Waterbox STD — Standard

Table 32 — 19XR Waterbox Cover Weights, Two-Stage Compressor Frame 6 Two-Stage Compressor Frame 6; Cooler Frame A

		ENGLIS	H (LB)	METRIC	(KG)	
		COOL	.ER	COOLER FRAME A		
WATERBOX DESCRIPTION	PASSES	FRAM	ΕA			
		STANDARD NOZZLES	FLANGED	STANDARD NOZZLES	FLANGED	
Dished Head, 150 psig	1	1006	1171	456	531	
MWB End Cover, 150 psig	1	976	976	443	443	
MWB End Cover (ASME), 300 psig	1	2460	2460	1116	1116	
Dished Head, 150 psig	2	1140	1336	517	606	
Dished Head (Return Cover), 150 psig	2	976	976	443	443	
MWB End Cover, 150 psig	2	1068	1068	484	484	
MWB End Cover (Return Cover), 150 psig	2	976	976	443	443	
MWB End Cover (ASME), 300 psig	2	2460	2460	1116	1116	
MWB End Cover (ASME) (Return Cover), 300 psig	2	2460	2460	1116	1116	
Dished Head, 150 psig	3	1048	1112	475	504	
MWB End Cover, 150 psig	3	1030	1030	467	467	
MWB End Cover (ASME), 300 psig	3	2460	2460	1116	1116	

**ASME**— American Society of Mechanical Engineers **MWB**— Marine Waterbox

NOTES:

1. Consult factory for 1 and 3 pass data.

2. Weights for dished head cover and MWB end cover 150 psig (1034 kPa) are included in the heat exchanger weights shown in the heat exchanger weight tables.

Table 33 — 19XR Waterbox Cover Weights, Two-Stage Compressor Frame 6 Two-Stage Compressor Frame 6; Condenser Frame A and B

			ENGLIS	SH (LB)			METRI	C (KG)		
			COND	ENSER		CONDENSER				
WATERBOX DESCRIPTION	PASSES	FRAN	/IE A	FRAM	IE B	FRAN	IE A	FRAME B		
		STANDARD NOZZLES	FLANGED	STANDARD NOZZLES	FLANGED	STANDARD NOZZLES	FLANGED	STANDARD NOZZLES	FLANGED	
Dished Head, 150 psig	1	895	1060	1006	1171	406	481	473	547	
MWB, 150 psig	1	859	859	1075	1075	390	390	488	488	
MWB (ASME), 300 psig	1	2117	2117	2744	2744	960	960	1292	1292	
Dished Head, 150 psig	2	981	1179	1140	1400	445	535	574	633	
Dished Head (Return Cover), 150 psig	2	824	824	976	976	374	374	481	481	
MWB 150 psig	2	907	907	1075	1075	411	411	630	630	
MWB (Return), 150 psig	2	824	824	976	976	374	411	488	488	
MWB (ASME), 300 psig	2	2117	2117	2744	2744	960	1083	1440	1440	
MWB Return Cover (ASME), 300 psig	2	2117	2117	2744	2744	960	960	1245	1245	
Dished Head, 150 psig	3	1067	1157	1050	1140	484	525	476	517	
MWB End Cover, 150 psig	3	942	942	1020	1020	427	427	463	463	
MWB End Cover (ASME), 300 psig	3	2117	2177	2744	2744	960	987	1245	1245	

**LEGEND** 

**ASME**— American Society of Mechanical Engineers **MWB**— Marine Waterbox

NOTES:

 Consult factory for 1 and 3 pass data.
 Weights for dished head cover and MWB end cover 150 psig (1034 kPa) are included in the heat exchanger weights shown in the heat exchanger weight tables.

Table 34 — 19XR Waterbox Cover Weights, Two-Stage Compressor Frame 7 Two-Stage Compressor Frame 7; Cooler Frames B, C

			ENGLIS	SH (LB)		METRIC (KG)					
			coc	LER		COOLER					
WATERBOX DESCRIPTION	PASSES	FRA	ME B	FRAME C		FRAME B		FRA	ME C		
		STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED		
Dished Head, 150 psig (1034 kPa)	1	1380	1545	1849	2014	626	701	839	914		
MWB End Cover, 150 psig (1034 kPa)	1	1366	1366	1835	1835	620	620	832	832		
MWB End Cover (ASME), 300 psig (2068 kPa)	1	3425	3425	4805	4805	1554	1554	2180	2180		
Dished Head, 150 psig (1034 kPa)	2	1589	1849	2076	2336	721	839	942	1060		
Dished Head (Return Cover), 150 psig (1034 kPa)	2	1367	1367	1836	1836	620	620	833	833		
MWB End Cover, 150 psig (1034 kPa)	2	1489	1489	1987	1987	675	675	901	901		
MWB (Return Cover), 150 psig (1034 kPa)	2	1367	1367	1836	1836	620	620	833	833		
MWB End Cover (ASME), 300 psig (2068 kPa)	2	3425	3425	4805	4805	1554	1554	2180	2180		
MWB (Return Cover), 300 psig (2068 kPa)	2	3425	3425	4805	4805	1554	1554	2180	2180		
Dished Head, 150 psig (1034 kPa)	3	1514	1604	2028	2118	687	728	920	961		
MWB End Cover, 150 psig (1034 kPa)	3	1506	1506	1995	1995	683	683	905	905		
MWB End Cover (ASME), 300 psig (2068 kPa)	3	3425	3425	4805	4805	1554	1554	2180	2180		

ASME— American Society of Mechanical Engineers
MWB — Marine Waterbox
STD — Standard

NOTES:

Consult factory for 1 and 3 pass data.
 Weights for dished head cover and MWB end cover 150 psig (1034 kPa) are included in the heat exchanger weights shown in the heat exchanger weight tables.

Table 35 — 19XR Waterbox Cover Weights, Two-Stage Compressor Frame 7 Two-Stage Compressor Frame 7; Condenser Frames C, D

			ENGLI	SH (LB)			METRI	IC (KG)		
			COND	ENSER		CONDENSER				
WATERBOX DESCRIPTION	PASSES	FRA	ME C	FRAME D		FRAME C		FRAME D		
		STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	STD NOZZLES	FLANGED	
Dished Head, 150 psig (1034 kPa)	1	1380	1600	1849	2029	626	726	839	920	
MWB End Cover, 150 psig (1034 kPa)	1	1367	1367	1835	1835	620	620	832	832	
MWB End Cover (ASME), 300 psig (2068 kPa)	1	3639	3639	5249	5249	1651	1651	2353	2353	
Dished Head, 150 psig (1034 kPa)	2	1589	1919	2076	2406	721	870	942	1091	
Dished Head (Return Cover), 150 psig (1034 kPa)	2	1367	1367	1836	1836	620	620	833	833	
MWB End Cover, 150 psig (1034 kPa)	2	1497	1497	1988	1988	679	679	902	902	
MWB (Return Cover), 150 psig (1034 kPa)	2	1367	1367	1836	1836	620	620	833	833	
MWB End Cover (ASME), 300 psig (2068 kPa)	2	3639	3639	5249	5249	1651	1651	2381	2381	
MWB (Return Cover) (ASME), 300 psig (2068 kPa)	2	3639	3639	5249	5249	1651	1651	2381	2381	
Dished Head, 150 psig (1034 kPa)	3	1514	1612	2028	2126	687	731	920	964	
MWB End Cover, 150 psig (1034 kPa)	3	1493	1493	1993	1993	677	677	904	904	
MWB End Cover (ASME), 300 psig (2068 kPa)	3	3639	3639	5249	5249	1651	1651	2381	2381	

**LEGEND** 

ASME— American Society of Mechanical Engineers

MWB — Marine Waterbox

STD — Standard

#### NOTES:

 Consult factory for 1 and 3 pass data.
 Weights for dished head cover and MWB end cover 150 psig (1034 kPa) are included in the heat exchanger weights shown in the heat exchanger weight tables.

#### 19XR2-E RIG MACHINE COMPONENTS

Refer to instructions below to disassemble a chiller with an LF2 442A or 608A VFD or Standard Tier VFD (230, 335, 445, 485, 550, 605, 680A). Special instructions for chillers with a 900A or 1200A LF2 VFD or Standard Tier VFD (765, 855, 960, 1070, 1275, 1530A) start on page 46.

Disassemble a Chiller with a 442A or 608A LF2 VFD or Standard Tier VFD (230, 335, 445, 485, 550, 605, 680A)

IMPORTANT: Only a qualified service technician should perform this operation.

### **MARNING**

Do not attempt to disconnect flanges while the machine is under pressure. Failure to relieve pressure can result in personal injury or damage to the unit.

### **A** CAUTION

Before rigging the compressor, disconnect all wires entering the power panel to avoid unit damage.

#### Remove the VFD Enclosure

Confirm that the power supply disconnect is open and all safety procedures are observed before removing the VFD. This procedure minimizes the number of sensors and cables that need to be disconnected.

### **⚠ WARNING**

Do not attempt to remove the VFD without first closing the refrigerant isolation valves. Failure to do so during VFD removal will result in an uncontrolled refrigerant leak. A refrigerant leak can damage the unit as well as displace oxygen, causing asphyxiation.

- 1. Close the 2 filter drier isolation valves and the VFD refrigerant drain isolation valve. Evacuate the VFD coldplate through the Schrader valve next to the filter/drier.
- Remove any field wiring conduits that bring power to the VFD.
- 3. Remove the terminal box transition piece.
- 4. Label and disconnect the motor leads from the motor terminals. Note the position of the motor terminal cable lugs so they can be reinstalled with sufficient clearance away from the surrounding structure.
- 5. Remove the motor ground lead. Note the position of the ground lead so it can be reinstalled with sufficient clearance away from the surrounding structure.
- 6. Label and disconnect the power cables, interlock cable, and communication cable between the VFD enclosure and the power panel.
- 7. Remove the access panels on the back of the VFD enclosure and disconnect the VFD cooling lines. Cover all openings.

#### Lifting the VFD

Care should be used to prevent damage due to dropping or jolting when moving the VFD. A fork truck or similar means of lifting and transporting may be used. Sling the VFD in a manner that will equalize the load at the pickup joints. Use a spreader bar if the angle of the sling is less than 45 degrees relative to horizontal. Do not jolt while lifting.

Use the following procedure to lift the VFD:

- 1. Attach a sling to the four lifting holes in the lifting brackets (lifting brackets are factory-installed on top of the VFD enclosure). Make certain that the angle of the sling is not less than 45 degrees relative to horizontal.
- Using an overhead or portable hoist (minimum 2 ton rated capacity), attach a free-fall chain to the sling secured to the drive. Take up any slack in the chain.
- 3. Rig the control center and remove the bolts that secure it to the VFD mounting brackets on the condenser. See Fig. 15.

NOTE: To reassemble, follow steps in reverse order. Connect sensors and cables after major components have been secured to reduce the risk of damaging them.




Fig. 15 — 442A and 608A LF2 VFD Enclosure Lifting Points

#### To Separate Cooler and Condenser

NOTE: If the cooler and condenser vessels must be separated, the heat exchangers should be kept level by placing a support plate under the tube sheets. The support plate will also help to keep the vessels level and aligned when the vessels are bolted back together.

Remove all transducer and sensor wires at the sensor. Clip all wire ties necessary to pull heat exchangers apart.

#### **⚠ CAUTION**

900A or 1200A LF2 VFD, Standard Tier VFD (765, 855, 960, 1070, 1275, 1530A) — Do not separate the cooler and condenser until the VFD is removed. The VFD/condenser assembly has a high center of gravity and may tip over when the cooler and condenser are separated, which could result in equipment damage and/or serious personal injury. See page 46 for special instructions on VFD removal for these sizes.

- 1. Place a support plate under each tube sheet to keep each vessel level (Fig. 16, Item 4).
- 2. Cut the refrigerant motor cooling line at the location shown (Fig. 16, Item 2).
- Disconnect the compressor discharge elbow at the compressor (Fig. 17, Item 6).
- 4. Unbolt the cooler liquid feed line at the location shown (Fig. 16, Item 8).
- Cover all openings.

- Disconnect all wires and cables that cross from the cooler side of the machine to the condenser side, including:
  - a. temperature sensor cable at the waterbox (Fig. 18, Item 5)
  - b. water-side transducer cables at the transducer (Fig. 18, Item 4)
  - c. condenser transducer cable at the transducer (Fig. 17, Item 7)
  - d. motor power wires at the motor terminal box (Fig. 16, Item 3)
  - wires and cable housings at the power panel that cross from the VFD to the power panel (Fig. 17, Item 2).
- Install dowel pins before separating the heat exchangers at the tube sheet mounting brackets to ensure accurate alignment when reassembling.
- Disconnect the tube sheet mounting brackets on the tube sheets (Fig. 16, Item 5).
- Rig the vessels apart.

### To Separate Compressor from Cooler

- Unbolt the compressor suction and discharge elbows (Fig. 16, Items 1 and 10).
- Cut the refrigerant motor cooling line at the location shown (Fig. 16, Item 2).
- Disconnect the motor refrigerant return line (Fig. 16, Item 6). 3.
- Disconnect the following:
  - a. compressor oil sump temperature sensor cable (Fig. 19, Item 4)
  - b. bearing temperature sensor cable (Fig. 19, Item 2)
  - c. motor temperature sensor cable (Fig. 19, Item 1)
  - d. wires and cable housings that cross from the power panel to VFD and control panel (Fig. 17, Item 2)
  - e. discharge temperature sensor cable (Fig. 19, Item 6)
  - f. compressor oil sump pressure cable (Fig. 19, Item 3)


- compressor oil discharge pressure cable (Fig. 19, Item 5)
- guide vane actuator cable (Fig. 17, Item 1)
- diffuser actuator cable (Frame 5 compressor and Frame 4 units with split ring diffuser — Fig. 18, Item 2)
- diffuser pressure cable (Frame 5 compressor and Frame 4 units with split ring diffuser — Fig. 19, Item 8).
- 5. Disconnect the flared fitting for the oil reclaim line (Fig. 16, Item 9).
- Unbolt the compressor discharge elbow (Fig. 17, Item 6).
- Cover all openings.
- Disconnect motor power cables at the VFD lugs (Fig. 16, Item 3).
- Install dowel pins between the compressor base and mounting base before separating from the cooler to ensure accurate alignment when reassembling.
- 10. Unbolt the compressor mounting from the cooler (Fig. 16, Item 7).
- 11. Rig the compressor.

### To Rig Compressor


NOTE: The motor end of the 19XRV compressor is heavy and will tip backwards unless these directions are followed:

- Cut two 4 in. x 6 in. wooden beams to the same length as the compressor.
- Drill holes into the beams and bolt them to the base of the 2. compressor using the compressor base mounting holes.

- Use O-ring lubricant on new O-rings when refitting.
- Use gasket sealant on new gaskets when refitting.
- Cooler and condenser vessels may be rigged vertically. Rigging should be fixed to the tube sheets of all 4 corners of the vessel.

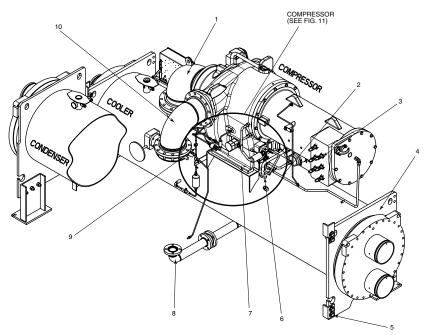

- Compressor Suction Elbow (Unbolt)
- Motor Cooling Line (Cut)
   Motor Terminal Box (Unbolt)
   Tube Sheet
- Tube Sheet Mounting Brackets (Unbolt 4 Places)
- Motor Cooling Drain Line (Unbolt) Compressor Mounting Bolt (Unbolt 4 Places) Cooler Liquid Feed Line (Unbolt)
- 8
- Öil Reclaim Line (Uпрон)
   Compressor Discharge Elbow (Unbolt) 10

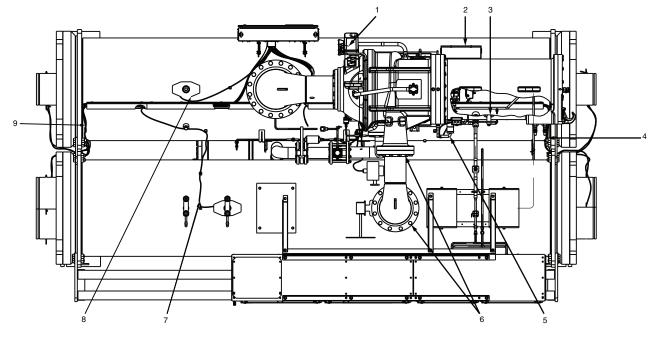

- Guide Vane Actuator Cable

- 1 Guide Valle Actuator Cable
  2 Power Panel
  3 Communication Cable
  4 Water Sensor Cables
  5 Motor Winding Temperature Cable

- Compressor Discharge Elbow Joints Condenser Pressure Cable
- Cooler Pressure Connection Water Sensor Cables

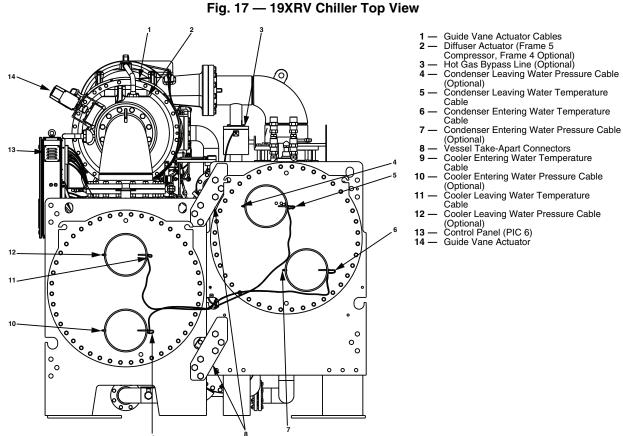


Fig. 18 — Chiller End View

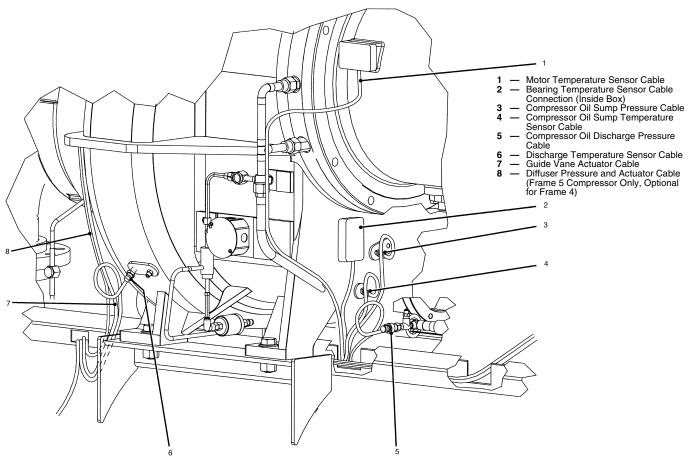


Fig. 19 — Compressor Detail

Special Instructions to Disassemble a Chiller with a 900A or 1200A LF2 VFD or Standard Tier VFD (765, 855, 960, 1070, 1275, 1530A)

### **⚠ WARNING**

Do not attempt to disconnect flanges while the machine is under pressure. Failure to relieve pressure can result in personal injury or damage to the unit.

NOTE: Label each wire before removal when wiring must be disconnected. Clip all wire ties necessary when removing pressure and temperature sensors. Disconnect all pressure transducer wires at the sensor. Temperature sensors cannot be disconnected from their cables; remove temperature sensors from their thermowells and label as required.

### **MARNING**

900A or 1200A LF2 VFD, Standard Tier VFD (765, 855, 960, 1070, 1275, 1530A) — Do not separate the cooler and condenser until the VFD enclosure is removed. The VFD/cooler assembly has a high center of gravity and may tip over when the cooler and condenser are separated which could result in equipment damage and/or serious personal injury. See Fig. 20.




Fig. 20 — Removal Warning Label

#### Remove the VFD Enclosure from the Condenser

Confirm that the power supply disconnect is open and all safety procedures are observed before removing the VFD. This procedure minimizes the number of sensors and cables that need to be disconnected.

### **<b>⚠WARNING**

Do not attempt to remove the VFD without first closing the VFD refrigerant isolation valves. Failure to do so during VFD removal will result in an uncontrolled refrigerant leak. A refrigerant leak can damage the unit as well as displace oxygen, causing asphyxiation.

- 1. Close the 2 filter drier isolation valves (Fig. 21) and the VFD refrigerant drain isolation valve. Evacuate the VFD coldplate through the Schrader valve (Fig. 21) next to the filter/drier.
- 2. Remove any conduits that bring power to the VFD. See Fig. 22.

- 3. Remove the terminal box transition piece. See Fig. 23.
- 4. Label and disconnect the motor leads from the motor or VFD terminals (Fig. 24 and 25). Note the position of the motor terminal cable lugs so they can be reinstalled with sufficient clearance away from the surrounding structure. When reinstalling the VFD, assemble the back panel, floor, and tray of the motor terminal box transition piece prior to installing the motor leads.

### **A** CAUTION

Use a backing wrench when removing the nuts and bolts that secure the motor leads to the VFD bus bars to prevent damage to the bus bar insulators.

- 5. Remove the motor ground lead. Note the position of the ground lead so it can be reinstalled with sufficient clearance away from the surrounding structure.
- Disconnect the power cables, interlock cable, and communication cable between the VFD enclosure and the power panel. See Fig. 22.
- Remove the access panels on the back of the VFD enclosure and disconnect the VFD cooling lines (Fig. 26). Cover all openings.

#### Lifting the VFD

Care should be used to prevent damage due to dropping or jolting when moving the VFD enclosure. A fork truck or similar means of lifting and transporting may be used. Sling the VFD in a manner that will equalize the load at the pickup joints. Use a spreader bar if the angle of the sling is less than 45 degrees relative to the horizontal. Do not jolt while lifting.

NOTE: The two lifting brackets for the VFD are not installed when they are shipped. They are bolted upside down to the bottom of the VFD support shelf. They must be unbolted and installed on the top of the VFD enclosure with ten <sup>1</sup>/<sub>2</sub>-13 x 1.25-inch-long grade 5 bolts.

Use the following procedure to lift the control center:

- 1. Attach a sling to the 4 lifting holes in the installed lifting brackets. Make certain that the angle of the sling is not less than 45 degrees relative to horizontal.
- 2. Using an overhead or portable hoist (minimum 2-ton rated capacity), attach a free-fall chain to the sling secured drive. Take up any slack in the chain. See Fig. 27.
- 3. The VFD support assembly can be removed from the condenser if it is necessary to reduce the width of the condenser assembly. The eight 1<sup>1</sup>/<sub>8</sub>-7 bolts that secure the VFD support assembly to the tubesheets should be torqued to 750 ft-lb (1017 N-m) when the support assembly is reinstalled. See Fig. 28.

NOTE: To reassemble, follow steps in reverse order. Connect sensors and cables after major components have been secured to reduce the risk of damaging them.

NOTE: If overhead space is limited following reinstallation of the VFD enclosure, the VFD enclosure lifting brackets (Fig. 27) may be removed from the top of the VFD and fastened to the bottom of the VFD support shelf (Fig. 29).

Reinstall the  $^{1}/_{2}$ -13 x 1.25-inch-long grade 5 bolts into the top of the VFD enclosure to prevent debris from falling into the VFD.

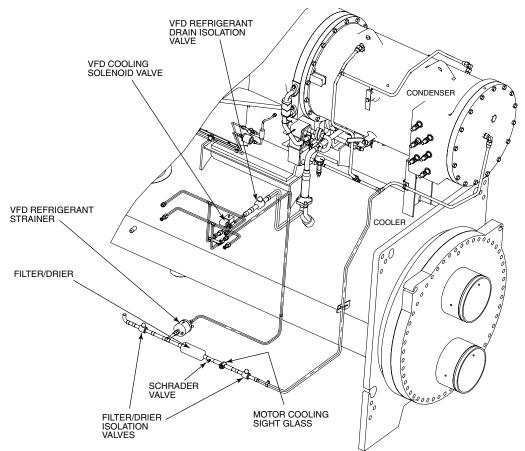


Fig. 21 — 900A or 1200A LF2 VFD or Standard Tier VFD (765, 855, 960, 1070, 1275, 1530A) Isolation Valves — Typical

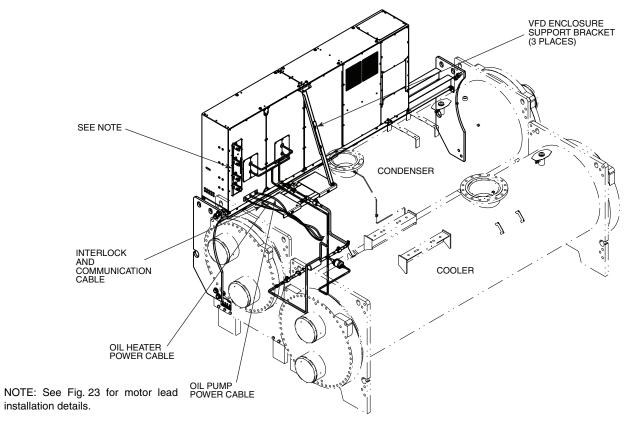


Fig. 22 — 900A or 1200A LF2 VFD or Standard Tier VFD (765, 855, 960, 1070, 1275, 1530A) Installation — Typical

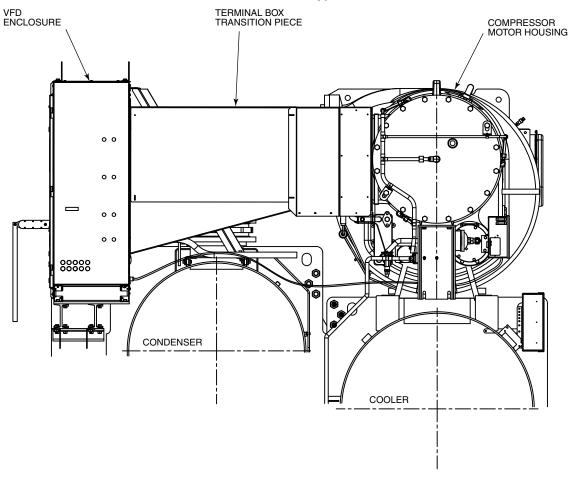
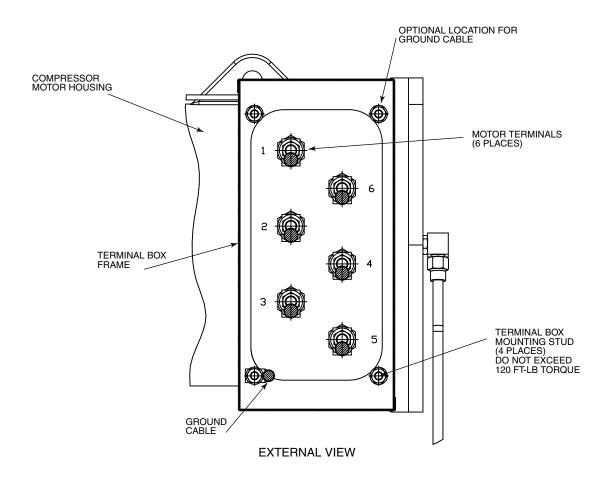


Fig. 23 — 900A or 1200A LF2 VFD or Standard Tier VFD (765, 855, 960, 1070, 1275, 1530A)

Motor Terminal Box Transition Piece — Typical



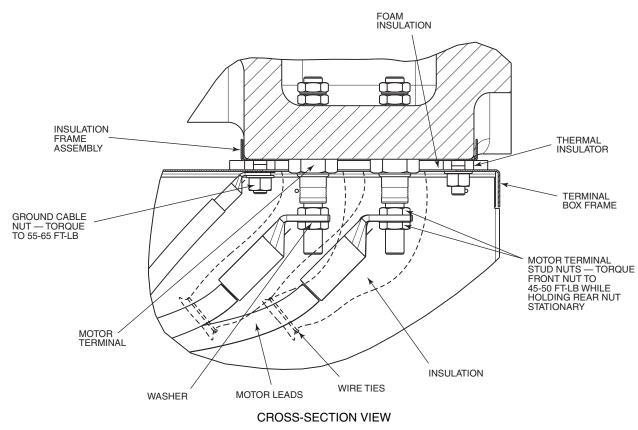


Fig. 24 — Compressor Motor Terminals (Typical)

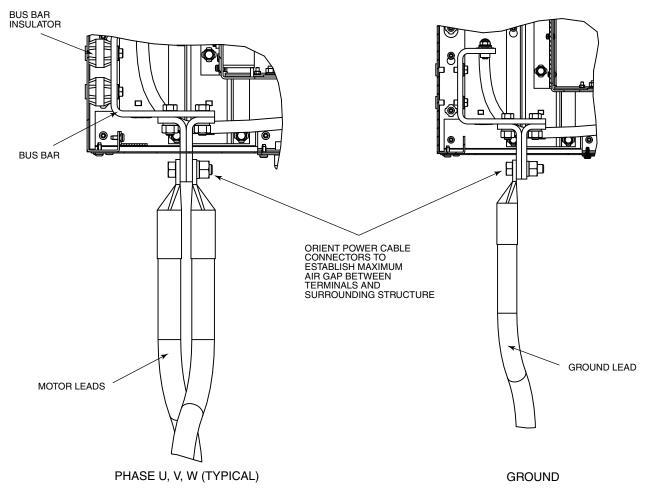


Fig. 25 — Motor Lead Installation (View Looking Down)

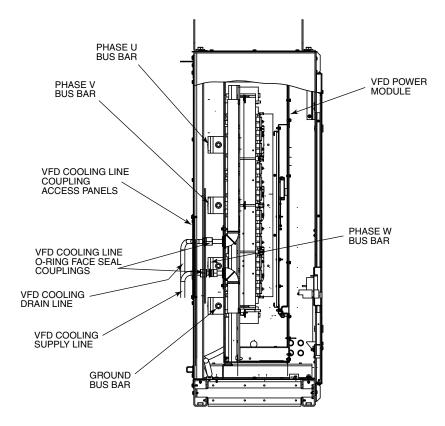


Fig. 26 — 900A or 1200A VFD Refrigerant Cooling Lines

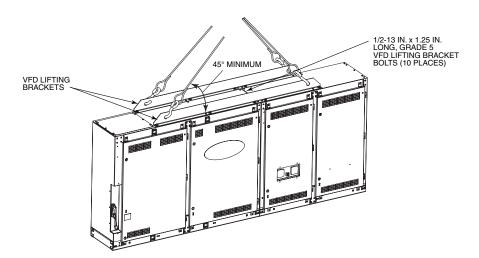


Fig. 27 — 900A or 1200A VFD Enclosure Lifting Points

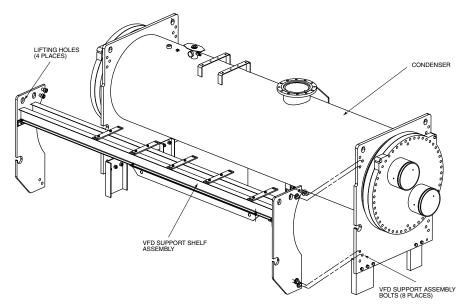


Fig.  $28 - 900 \mathrm{A}$  or 1200 A VFD Support Assembly Installation

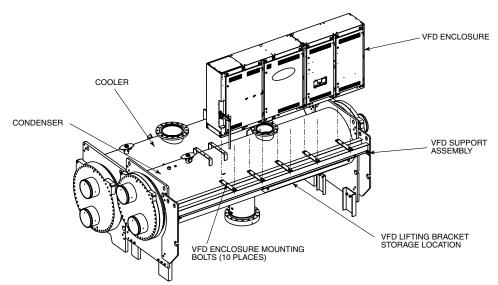


Fig. 29 — 900A or 1200A VFD Enclosure Installation

#### Install VFD

- Install terminal box frame mounting studs into tapped holes using short threaded end. Do not exceed 120 ft-lb (163 N-m). See Fig. 24.
- Install thermal insulators, insulation frame assembly, and terminal box frame prior to attaching motor power cables.
   Assemble the back panel, floor, and tray of the motor terminal box transition piece before installing the motor leads.
- 3. Tighten Frame 2 and Frame 3 motor terminals into the motor housing with 25 to 40 ft-lb (34 to 52 N-m) of torque. Tighten Frame 4 and Frame 5 motor terminals into the motor housing with 50 to 75 ft-lb (68 to 102 N-m) of torque.
- 4. There may be 1 or 2 motor power cables per terminal identified as T1, T2, and T3. Position motor end lugs on terminal studs with Belleville washer located against the front terminal lug with the convex side facing toward the front terminal nut. Clinch the two cables together with wire ties before tightening terminal nuts. Install front terminal nut finger tight. Hold rear terminal nut stationary while tightening front terminal nut to 45 to 50 ft-lb (61 to 68 N-m). See Fig. 24.
- 5. Check all terminal connections for proper installation.

IMPORTANT: Do not insulate terminals until wiring arrangement has been checked and approved by Carrier start-up personnel. Motor terminals must be insulated in acceptance with national and local electrical codes.

#### **Insulate Motor Terminals and Lead Wire Ends**

Locate heat shrink tubing (RCD P/N LF33MM114) over power connections so that they are completely covered and tubing is against motor housing. Shrink into position. Slide foam tubing (3 in. inner diameter closed cell vinyl, neoprene, or nitrile foam) partway over the heat shrink tubing. Apply adhesive for closed-cell foam insulation to motor-side end of the foam tubing, and push tubing the rest of the way over the terminal and against the sheet insulation on the motor side. Secure the opposite end of the foam tubing with a wire tie as shown in Fig. 24.

### Alternate Insulation for Motor Terminals and Lead Wire Ends

Insulate compressor motor terminals, lead wire ends, and electrical wires to prevent moisture condensation and electrical arcing. Obtain Carrier-approved insulation material from RCD (Replacement Components Division), consisting of 3 rolls of insulation putty and one roll of vinyl tape.

- a. Insulate each terminal by wrapping with one layer of insulation putty (RCD P/N 19EA411-1102).
- b. Overwrap putty with 4 layers of vinyl tape.
- Orient PE/ground lug as shown in Fig. 24. Assemble internal/ external tooth lock washer between the terminal box frame and the PE/ground cable. Torque PE/ground lug nut to 55 to 65 ft-lb (75 to 89 N-m).
- Complete assembly of the motor terminal box transition piece after all power and ground leads are installed. The motor terminal box transition piece must be adjusted to completely cover the opening on the back of the VFD enclosure. See Fig. 23.
- Install O-rings on VFD refrigerant connections using silicone grease. Using two wrenches, tighten connector to 27 to 33 ftlb (37 to 45 N-m). See Fig. 26.
- Evacuate all piping between the VFD and the VFD isolation valves after assembly and tightening of VFD fittings. When dehydration/evacuation is complete, equalize VFD piping pressure with machine pressure if machine is charged with refrigerant. See Fig. 21.

#### 19XR6/7 RIG MACHINE COMPONENTS

Refer to instructions below, Fig. 30-32, and Carrier Certified Prints for machine component disassembly.

IMPORTANT: Only a qualified service technician should perform this operation.

#### **A** CAUTION

Freezing water can damage equipment. If machine can be or possibly has been exposed to freezing temperatures after water circuits have been installed, open waterbox drains and remove all water from cooler and condenser. Leave drains open until system is filled.

### **A** CAUTION

Before rigging the compressor, disconnect all wires connected to the control panel to avoid damage to electrical components.

NOTE: If the cooler, economizer, and condenser vessels must be separated, the heat exchangers should be kept level by placing a support plate under the tube sheets. The support plate will also help to keep the vessels level and aligned when the vessels are bolted back together.

NOTE: The compressor oil is hygroscopic and absorbs moisture from the atmosphere. Remove the oil charge from the compressor. Either dispose of compressor oil and reinstall a new oil charge after dehydration, or store oil in a clean dry container designed for oil storage; keep the container sealed until ready to re-install oil.

NOTE: Wiring must also be disconnected. Label each wire before removal (see Carrier Certified Prints). In order to disconnect the starter from the machine, remove wiring for the oil pump, oil heater, control wiring at the power panel, and the main motor leads at the starter lugs.

Remove all transducer and sensor wires at the sensor. Clip all wire ties necessary to pull heat exchangers apart.

#### To Separate Cooler and Condenser:

- 1. Place a support plate under each tube sheet leg to keep each vessel level (Item 3, Fig. 30).
- 2. Cut the refrigerant motor cooling line at the location shown (Item 4, Fig. 30).
- Disconnect the compressor discharge pipe at the compressor (Item 14, Fig. 30).
- 4. Disconnect the coupling of the isolation valve near the damper valve as shown in Fig. 30 (Item 12).
- 5. Unbolt the cooler liquid feed line at the location indicated for liquid line isolation valve. Refer to Fig. 6 and 30, Item 8.
- 6. Cover all openings.
- 7. Disconnect all wires and cables that cross from the cooler side of the machine to the condenser side, including:
  - a. temperature sensor cable at the waterbox (Fig. 32 and Fig. 33, Compressor Detail A).
  - b. motor power wires at the starter (Item 1, Fig. 30).
  - c. wires and cable housings at the control panel that cross from the control panel to the cooler vessel (Fig. 31).
- 8. Install dowel pins before separating the heat exchangers at the tube sheet mounting brackets to ensure accurate alignment when reassembling.
- 9. Disconnect the take-apart connectors on the tube sheets (Fig. 32).
- 10. Rig the vessels apart.

#### To Separate the Compressor from the Cooler:

- 1. Unbolt the compressor suction elbow at the cooler flange (Item 13, Fig. 30).
- 2. Cut the refrigerant motor cooling line at the location shown (Item 4, Fig. 30).
- 3. Disconnect the motor refrigerant return line (Item 6, Fig. 30).
- 4. Disconnect all wires going to the control panel.
- 5. Disconnect the following:
  - a. compressor oil sump temperature sensor cable (Fig. 33, Compressor Detail B)
  - b. bearing temperature sensor cables (Fig. 33, Compressor Detail B)
  - c. motor temperature sensor cable (Fig. 33, Compressor Detail A)
  - d. wires and cable housings that cross from the power panel to the starter and control panel (Fig. 31)
  - e. compressor discharge temperature sensor cable (Fig. 33, Compressor Detail A)
  - f. compressor oil sump pressure cable (Fig. 33, Compressor Detail B)
  - g. compressor oil supply pressure cable (Fig. 33, Compressor Detail A)
  - h. bearing displacement switch (Fig. 33, Compressor Detail D)
  - i. oil heater (Fig. 33, Compressor Detail B).

- j. guide vane actuator cable (Fig. 33, Compressor Detail D)
- Disconnect the flared fitting for the oil reclaim line (Item 11, Fig. 30).
- 7. Unbolt the compressor discharge coupling (Item 14, Fig. 30).
- 8. Cover all openings.
- 9. Disconnect motor power cables at the starter lugs (Item 1, Fig. 30).
- 10. Install dowel pins between the compressor base and mounting base before separating from the cooler to ensure accurate alignment when reassembling.
- 11. Unbolt the compressor mounting from the cooler (Item 7, Fig. 30).


### To Rig Compressor:

NOTE: The motor end of the 19XR compressor is heavy and will tip backwards unless these directions are followed:

- 1. Cut two 6 in. x 8 in. wooden beams to the same length as the compressor.
- 2. Drill holes into the beams and bolt them to the base of the compressor.

#### Additional Notes


- 1. Use silicone grease on new O-rings when refitting.
- 2. Use gasket sealant on new gaskets when refitting.
- 3. Cooler and condenser vessels may be rigged vertically. Rigging should be fixed to all 4 corners of the tube sheet.

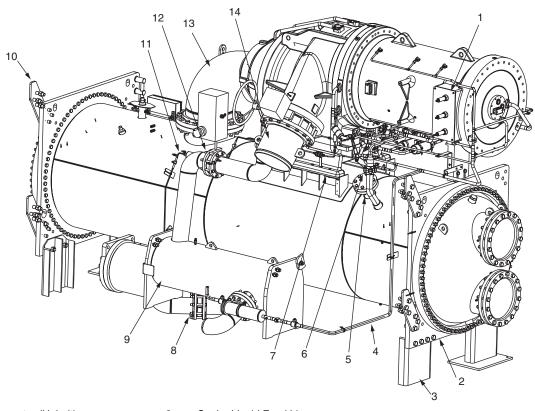

- Starter Connector (Unbolt)
- 2 Tube Sheet
- 3 Tube Sheet Leg Option (Unbolt)
  4 Refrigerant Motor Cooling Line (Cut)
- Terrigerant Motor Cooling Line (CityDescription of the CityDescription of the Cooling Line (CityDescription of the CityDescription of the City<
- 6 Motor Drain
- 7 Compressor Mounting


- 8 Cooler Liquid Feed Line
- 9 Economizer
- 10 Vessel Connectors (Unbolt)
- 11 Oil Reclaim Line
- 12 Refrigerant Isolation Valve
  13 Compressor Suction Elbow
- 14 Compressor Discharge Pipe

Fig. 30 — Cooler, Side View (Compressor Frame Size 6 Shown), 19XR6/7

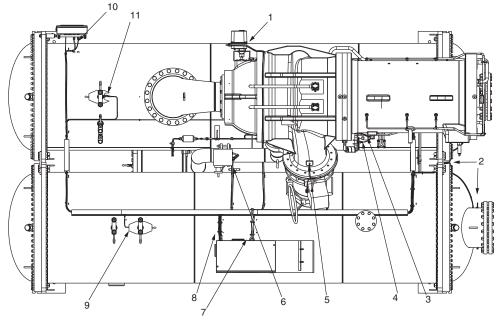

- Guide Vane Actuator Cable
  Water Temperature Sensor Cables
  Motor Winding Temperature Cables
  Compressor Oil Supply Pressure Cable
  Compressor Discharge Temperature Sensor Cable
- Damper Valve CablesControl Panel Power Supply Cables
- Condenser Pressure Cables
   Condenser Pressure Cable
   HMI Communications and Power Supply Cables
   Cooler Pressure cable 10


Fig. 31 — Chiller Top View (Compressor Frame Size 6 Shown), 19XR6/7

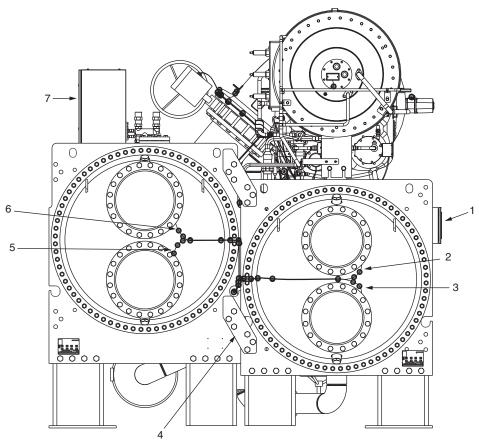


- HMI Control Box
  Cooler Leaving Water Temperature Cable
  Cooler Entering Water Temperature Cable
  Vessel Take-Apart Connectors

- Condenser Entering Water Temperature Cable Condenser Leaving Water Temperature Cable
- Condense.Control Box


Fig. 32 — Chiller End View

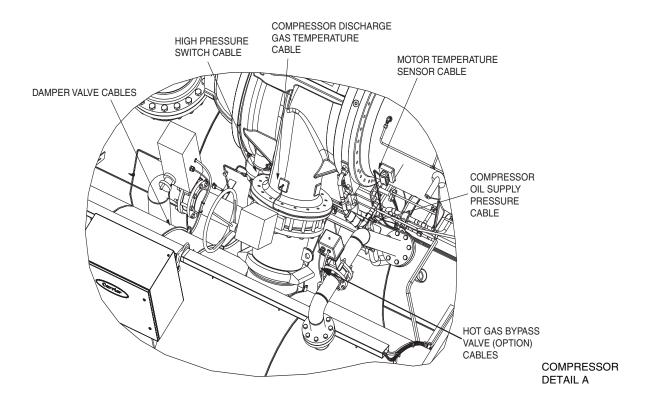

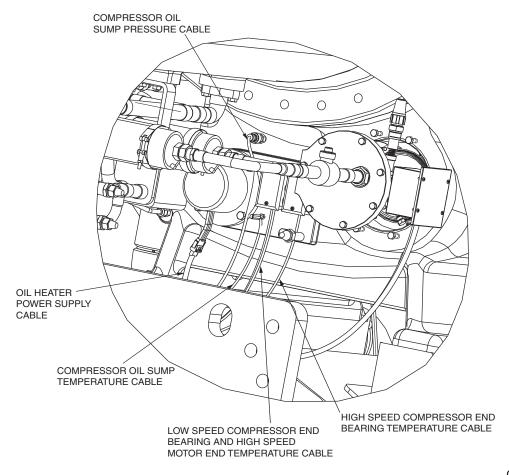

COMPRESSOR DETAIL B

Fig. 33 — 19XR6/7 Compressor Detail

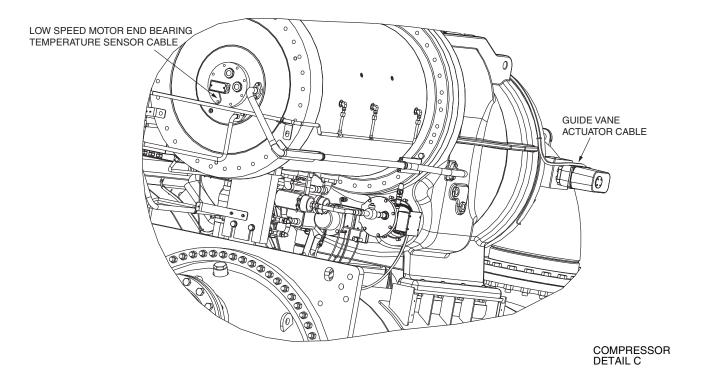

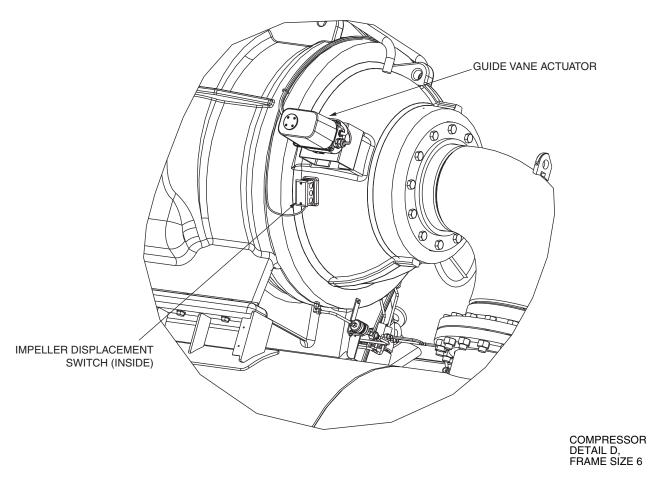


Fig. 33 — 19XR6/7 Compressor Detail (cont)

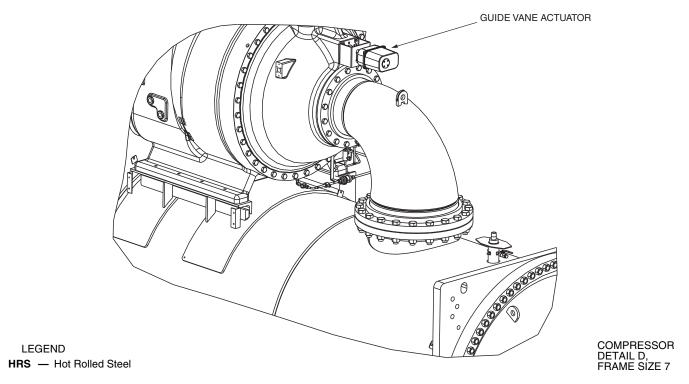


Fig. 33 — 19XR6/7 Compressor Detail (cont)


### Step 3 — Install Machine Supports

### INSTALL STANDARD ISOLATION

Figures 34 and 35 show positions of support plates and shear flex pads, which together form the standard machine support system.

IMPORTANT: Chiller housekeeping pad, anchor bolts, and attachment points that are designed by others must be in accordance with all applicable national and local codes.

						D	IMENSIONS							
19XRV HEAT EXCHANGER SIZE	Α		В		С		D		Е		F		G	
EXCITANGEN SIZE	ft-in.	mm	ft-in.	mm	ft-in.	mm	ft-in.	mm	ft-in.	mm	ft-in.	mm	ft-in.	mm
20-22	10- 71/4	3232	5- 41/4	1632	0- 1	25	0- 35/8	92	1- 31/4	387	0- 9	229	0- 1/2	13
30-32	12-103/4	3931	5- 51/4	1657	0	0	0- 35/8	92	1- 31/4	387	0- 9	229	0- 1/2	13
35-37	14- 71/4	4451	5- 51/4	1657	0	0	0- 35/8	92	1- 31/4	387	0- 9	229	0- 1/2	13
40-42	12-10 <sup>3</sup> / <sub>4</sub>	3931	6- 0	1829	0- 11/2	38	0- 35/8	92	1- 31/4	387	0- 9	229	0- 1/2	13
45-47	14- 71/4	4451	6- 0	1829	0- 11/2	38	0- 35/8	92	1- 31/4	387	0- 9	229	0- 1/2	13
50-54, 5A-5C, 5K-5R	12-103/4	3931	6- 51/2	1969	0- 1/2	13	0- 35/8	92	1- 31/4	387	0- 9	229	0- 1/2	13
55-59, 5F-5H, 5T-5Z	14- 7 <sup>1</sup> / <sub>4</sub>	4451	6- 5 <sup>1</sup> / <sub>2</sub>	1969	0- 1/2	13	0- 35/8	92	1- 31/4	387	0- 9	229	0- 1/2	13
60-64, 6K-6R	12-103/4	3931	6- 91/2	2070	0- 1/2	13	0- 35/8	92	1- 31/4	387	0- 9	229	0- 1/2	13
65-69, 6T-6Z	14- 71/4	4451	6- 91/2	2070	0- 1/2	13	0- 35/8	92	1- 31/4	387	0- 9	229	0- 1/2	13
70-74, 7K-7R	15- 1 <sup>7</sup> / <sub>8</sub>	4620	7- 10 <sup>1</sup> / <sub>2</sub>	2401	0- 1/4	6	0- 615/16	176	1-10	559	1- 4	406	0- 3/4	19
75-79, 7T-7Z	17- 1 <sup>7</sup> / <sub>8</sub>	5230	7- 10 <sup>1</sup> / <sub>2</sub>	2401	0- 1/4	6	0- 615/16	176	1-10	559	1- 4	406	0- 3/4	19
80-84, 8K-8R	15- 1 <sup>7</sup> / <sub>8</sub>	4620	8- 93/4	2686	0- 15/16	24	0- 615/16	176	1-10	559	1- 4	406	0- 1/16	2
85-89, 8T-8Z	17- 1 <sup>7</sup> / <sub>8</sub>	5230	8- 93/4	2686	0- 15/16	24	0- 615/16	176	1-10	559	1- 4	406	0- 1/16	2
A4	14- 87/8	4492	10- 01/8	3051	0- 47/16	113	1-10	559	1- 4	406		1	_	_
B4	14- 8 <sup>7</sup> / <sub>8</sub>	4492	10- 5 <sup>3</sup> / <sub>8</sub>	3177	0- 47/16	113	1-10	559	1- 4	406		1	_	_
A6	16- 8 <sup>7</sup> / <sub>8</sub>	5102	10- 0 <sup>1</sup> / <sub>8</sub>	3051	0- 47/16	113	1-10	559	1- 4	406	_	_	_	_
B6	16 - 8 <sup>7</sup> / <sub>8</sub>	5102	10- 53/8	3177	0- 47/16	113	1-10	559	1- 4	406		1	_	_
C6	16 - 8	5080	11-11	3632	0- 4	102	1-10	559	1- 4	406			0- 1	25
C8	18 - 8	5690	11-11	3632	0- 4	102	1-10	559	1- 4	406	_	-	0- 1	25
C6	16 - 8	5080	12- 41/2	3662	0- 4	102	1-10	559	1- 4	406	_	-	0- 1	25
D6	16 - 8	5080	13- 2	4013	0- 4	102	1-10	559	1- 4	406	_	_	_	
C8	18 - 8	5691	13-2	4013	0- 4	102	1-10	559	1- 4	406	_		_	_
D8	18 - 8	5691	13- 2	4013	0- 4	102	1-10	559	1- 4	406		_	_	

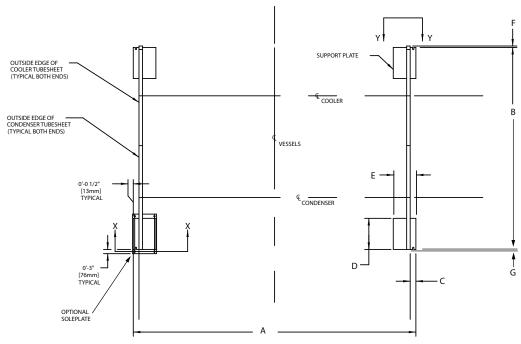

### NOTES:

- Y-Y dimension refers to standard soleplate. See Fig. 35.
   X-X dimension refers to accessory soleplate. See Fig. 36.
   For B6/C6 and C6/C6 cooler/condenser combinations, the tubesheet overhangs the foot plates.

Fig. 34 — 19XR Machine Footprint


#### INSTALL ACCESSORY ISOLATION (IF REQUIRED)

Uneven floors or other considerations may dictate the use of accessory soleplates (supplied by Carrier for field installation) and leveling pads. Refer to Fig. 36.

Level machine by using jacking screws in isolation soleplates. Use a level at least 24 in. (600 mm) long.

For adequate and long lasting machine support, proper grout selection and placement is essential. Carrier recommends that only pre-mixed, epoxy type, non-shrinking grout be used for machine installation. Follow manufacturer's instructions in applying grout.

- 1. Check machine location prints for required grout thickness.
- 2. Carefully wax jacking screws for easy removal from grout.
- 3. Grout must extend above the base of the soleplate and there must be no voids in grout beneath the plates.
- Allow grout to set and harden, per manufacturer's instructions, before starting machine.
- Remove jacking screws from leveling pads after grout has hardened.




#### NOTES:


- 1. Dimensions in ( ) are in millimeters.
- 2. Isolation package includes 4 elastomeric pads.

### Fig. 35 — Standard Isolation

#### SOLEPLATE DIMENSIONS

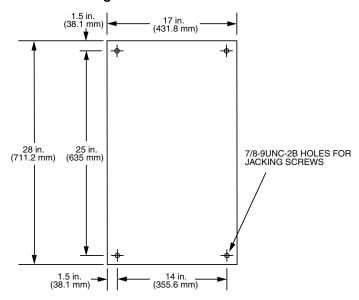


#### ACCESSORY SOLEPLATE DETAIL

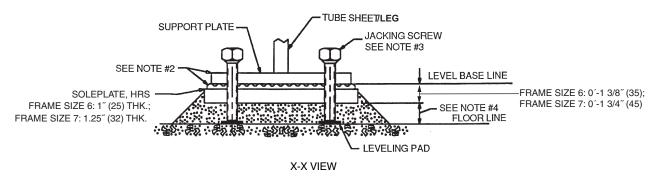

#### NOTES:

- 1. Dimensions in ( ) are in millimeters.
- Accessory (Carriér supplied, field installed) soleplate package includes 4 soleplates, 16 jacking screws and leveling pads. Isolation package is also required.
- 3. Jacking screws to be removed after grout has set.
- Thickness of grout will vary, depending on the amount necessary to level chiller. Use only pre-mixed non-shrinking grout, Ceilcote 748 or Embeco 636 Plus Grout, 1½ in. (38.1 mm) to 2¼ in. (57.2 mm) thick.

Fig. 36 — Accessory Isolation

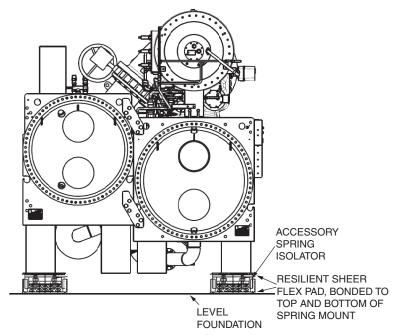

NOTE: The accessory spring isolators are supplied by Carrier for installation in the field if the accessory is purchased.

### Fig. 37 — 19XR Accessory Spring Isolation (Shown with Accessory Soleplates)

### INSTALL SPRING ISOLATION

Spring isolation may be purchased as an accessory from Carrier for field installation. It may also be field supplied and installed. Spring isolators may be placed directly under machine support plates or located under machine soleplates. See Fig. 37. Consult job data for specific arrangement. Low profile spring isolation assemblies can be field supplied to keep the machine at a convenient working height.

Obtain specific details on spring mounting and machine weight distribution from job data. Also, check job data for methods to support and isolate pipes that are attached to spring isolated machines.

NOTE: It is recommended that any installation other than the ground floor should have spring isolation for the chiller and piping vibration isolation.

NOTE: These isolators are not intended for seismic duty, but are intended to reduce the vibration and noise levels transmitted from the chiller to the surrounding environment. For installations adjacent to areas that are sensitive to noise and/or vibration, use the services of a qualified consulting engineer or acoustics expert to determine whether these springs will provide adequate noise/vibration suppression.

### Step 4 — Connect Piping

INSTALL WATER PIPING TO HEAT EXCHANGERS

#### **↑** CAUTION

Factory-supplied insulation is not flammable but can be damaged by welding sparks and open flame. Protect insulation with a wet canvas cover.

#### **A** CAUTION

To prevent damage to sensors, remove cooler and condenser water temperature sensors before welding connecting piping to water nozzles. Refer to Fig. 32. Replace sensors after welding is complete.

#### **⚠** CAUTION

When flushing the water systems, isolate the chiller from the water circuits to prevent damage to the heat exchanger tubes.

- Offset pipe flanges to permit removal of waterbox cover for maintenance and to provide clearance for pipe cleaning. No flanges are necessary with marine waterbox option; however, water piping should not cross in front of the waterbox or compressor because service access will be blocked.
- 2. Provide openings in water piping for required pressure gages and thermometers. For thorough mixing and temperature stabilization, wells in the leaving water pipe should extend inside pipe at least 2 in. (50 mm).
- Install air vents at all high points in piping to remove air and prevent water hammer.
- 4. Field-installed piping must be arranged and supported to avoid stress on the equipment and transmission of vibration from the equipment. Piping must be installed to prevent interference with routine access for the reading, adjusting, and servicing of the equipment. Provisions should be made for adjusting the piping in each plane for periodic and major servicing of the equipment.
- 5. See Fig. 38 for typical nozzle piping. Water flow direction must be as specified in Fig. 39-41.
  - NOTE: Entering water is always the lower of the 2 nozzles. Leaving water is always the upper nozzle for cooler or condenser.
- Install waterbox vent and drain piping in accordance with individual job data. Consult certified drawings for connection size
- Install waterbox drain plugs in the unused waterbox drains and vent openings.
- 8. Install optional pumpout system as shown in Fig. 42 and 43. See Tables 36 and 37 for dimensions.
- 9. Isolation valves are recommended on the cooler and condenser piping to each chiller for service.
- 10. Apply appropriate torque on the retaining bolts in a crisscross pattern for the water box covers before insulating the water box cover. The gasket can relax during transportation and storage and the water box cover requires retightening of the bolts.


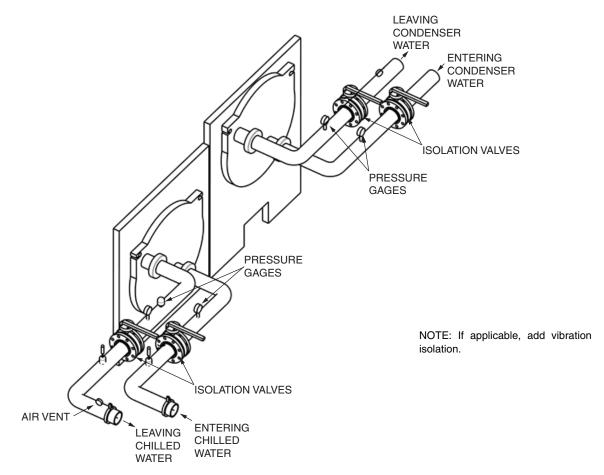


Fig. 38 — Typical Nozzle Piping

## **NOZZLE-IN-HEAD (NIH) WATERBOXES**

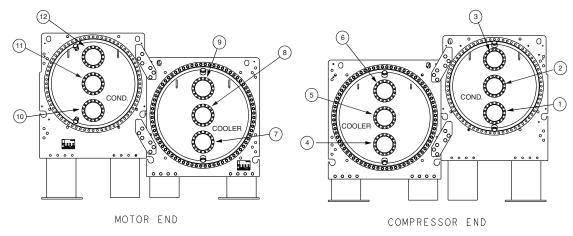


### **NOZZLE ARRANGEMENT CODES**

		COOLER	WATERBOXES	CONDENSER WATERBOXES				
PASS	In	Out	Arrangement Code*	In	Out	Arrangement Code*		
	8	5	Α	11	2	Р		
'	5	8	В	2	11	Q		
	7	9	С	10	12	R		
2	4	6	D	1	3	S		
	7	6	E	10	3	Т		
<u> </u>	4	9	F	1	12	U		

<sup>\*</sup>Refer to certified drawings.

Fig. 39 — 19XR Frame 1-8 (19XR2-E) and A-D (19XR6-7) Piping Flow Data (NIH)

### **MARINE WATERBOXES (MWB)**

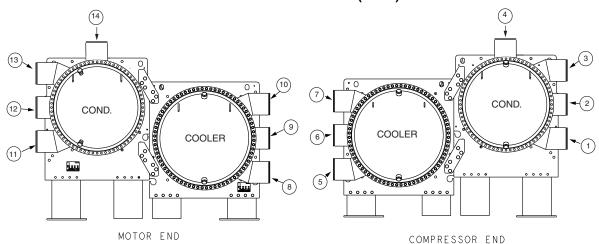


	ARRANGEME	*NIT ^^ DEC
N()//  F		'NI L.CHDES

	COOLER MARINE WATERBOXES							
PASS	In	Out	Arrangement Code*					
-	9	6	A					
	6	9	В					
2	8	10	С					
2	5	7	D					
2	8	7	E					
3	5	10	F					

(	CONDENSER MARINE WATERBOXES						
PASS	In	Out	Arrangement Code*				
-	12	2	Р				
	2	12	Q				
	11	13	R				
2	1	3	S				
2	11	14	V				
	1	4	W				
3	11	3	T				
	1	13	U				

Fig. 40 — 19XR Frame 1-8 (19XR2-E) and A-D (19XR6-7) (MWB)

MARINE WATERBOXES (MWB)

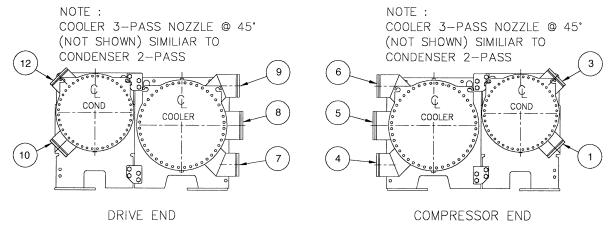



# FRAMES 2 AND 3 NOZZLE ARRANGEMENT CODES


		COOLE	R WATERBOXES	CONDENSER WATERBOXES					
PASS	IN	ОИТ	ARRANGEMENT CODE	IN	OUT	ARRANGEMENT CODE			
	8	5	А	_	_	_			
•	5	8	В	_	_	_			
2	7	9	С	10	12	R			
2	4	6	D	1	3	S			
3	7	6	E	_	_	_			
3	4	9	F	_	_	_			

Fig. 41 — 19XR Frame 2-3 (19XR2-3) Piping Flow Data (MWB)

<sup>\*</sup>Refer to certified drawings. Note that not all nozzle arrangements are available as standard.

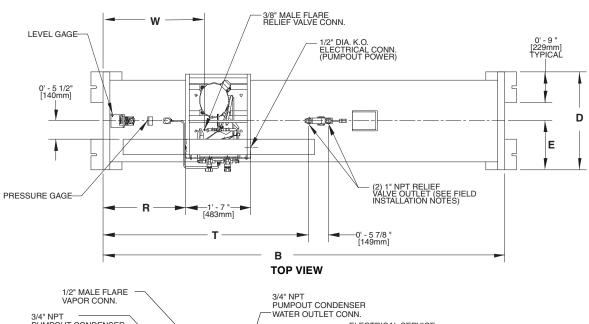

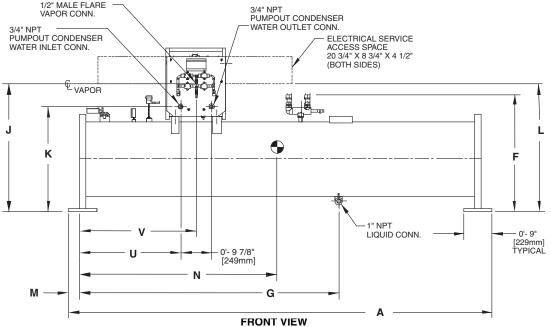



### **AVAILABLE CONDUIT** KNOCKOUT SIZES

TRADE SIZE	QTY	LOCATION
1/2"	1	TOP
3/4"	1	воттом
1″	1	MIDDLE
<b>1</b> 1/4"	1	MIDDLE

### NOTES:

- 1. See Tables 36 and 37 for pumpout unit dimensions.
- Denotes center of gravity.
- Dimensions in [] are in millimeters.
   For additional information on the pumpout unit, see certified drawings.
   Conduit knockout is located on the cide of the certain law.
- side of the control box.

**LEFT SIDE VIEW** 

Fig. 42 — 19XR Optional Pumpout Unit

Table 36 — Pumpout Unit Dimensions (ft-in.)

TANK SIZE*	Α	В	С	D	E	F	G	Н	J	K
0428	10-5	9-10	4-41/4	2-43/4	1-23/8	3-11/4	6-43/16	3-113/8	3-47/8	2-99/16
0452	14-11 <sup>1</sup> / <sub>4</sub>	14- 4 <sup>1</sup> / <sub>2</sub>	4-8 <sup>1</sup> / <sub>4</sub>	2-81/2	1-41/4	3-41/2	7-21/4	4- 31/4	3-83/4	3-1 <sup>7</sup> / <sub>16</sub>
TANK SIZE*	L	M	N	Р	R	S	T	U	V	W
0428	3-4 <sup>5</sup> / <sub>8</sub>	0-31/2	4- 9 <sup>1</sup> / <sub>2</sub>	1-7 <sup>7</sup> / <sub>8</sub>	2-03/8	3-9	5-0 <sup>1</sup> / <sub>4</sub>	2-5	2- 9 <sup>7</sup> / <sub>8</sub>	2-53/4
0452	3-81/2	0-33/8	6-11 <sup>5</sup> / <sub>8</sub>	1-83/4	2-05/8	4-1	5-01/2	2-51/4	2-10 <sup>1</sup> / <sub>8</sub>	2-6

<sup>\*</sup> Refer to Fig. 42.

Table 37 — Pumpout Unit Dimensions (mm)

TANK SIZE*	Α	В	С	D	E	F	G	Н	J	K
0428	3175	2997	1327	730	365	946	1935	1203	1038	852
0452	4553	4381	1429	826	413	1029	2191	1302	1137	951
TANK SIZE*	L	М	N	Р	R	S	Т	U	V	W
0428	1032	89	1451	505	619	1143	1530	737	860	756
0452	1130	86	2124	527	625	1225	1537	742	867	762

<sup>\*</sup> Refer to Fig. 42.

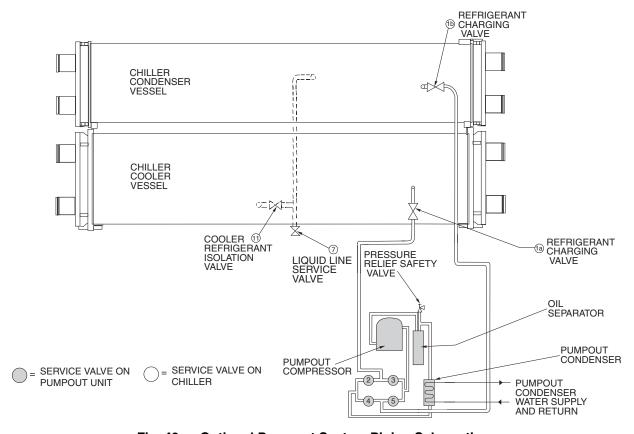


Fig. 43 — Optional Pumpout System Piping Schematic

#### INSTALL VENT PIPING TO RELIEF VALVES

The 19XR chiller is factory equipped with relief valves on the cooler and condenser shells. Refer to Tables 38 and 39 and Fig. 44-46 for size and location of relief devices, and Table 40 for cooler/relief valve arrangements. Vent relief devices (including fusible plugs) are to be vented to the outdoors in accordance with ANSI/ASHRAE 15 (latest edition) Safety Code for Mechanical Refrigeration and all other applicable codes.

#### **⚠ DANGER**

Refrigerant discharged into confined spaces can displace oxygen and cause asphyxiation.

- If relief devices are manifolded, the cross-sectional area of the relief pipe must at least equal the sum of the areas required for individual relief pipes.
- Provide a pipe plug near outlet side of each relief device for leak testing. Provide pipe fittings that allow vent piping to be disconnected periodically for inspection of valve mechanism.
- Piping to relief devices must not apply stress to the device. Adequately support piping. A length of flexible tubing or piping near the device is essential on spring-isolated machines.
- Cover the outdoor vent with a rain cap and place a condensation drain at the low point in the vent piping to prevent water build-up on the atmospheric side of the relief device.

#### Table 38 — 19XR Relief Valve Locations

LOCATION	FRAME SIZE	RELIEF VALVE OUTLET SIZE		
	Two-Stage 6—A	11/4-in. NPT FEMALE CONNECTOR		
COOLER	Two-Stage 7—B	11/4-in. NPT FEMALE CONNECTOR		
	Two-Stage 7—C	11/4-in. NPT FEMALE CONNECTOR		
	Two-Stage 6—A	11/4-in. NPT FEMALE CONNECTOR		
CONDENSER	Two-Stage 6—B	11/4-in. NPT FEMALE CONNECTOR		
CONDENSER	Two-Stage 7—C	11/4-in. NPT FEMALE CONNECTOR		
	Two-Stage 7—D	11/4-in. NPT FEMALE CONNECTOR		
OPTIONAL STORAGE TANK	N/A	11/4-in. NPT FEMALE CONNECTOR		

NOTE: All valves relieve at 185 psig (1275 kPa).

#### Table 39 — 19XRV Relief Valve Locations


	FRAME		QUANTITY OF RELIEF VALVES			
LOCATION	SIZE	RELIEF VALVE OUTLET SIZE	With Discharge and Cooler Inlet Isolation	Without Discharge and Cooler Inlet Isolation		
	2	1-in. NPT FEMALE CONNECTOR	1	2		
COOLER	3-6	11/4-in. NPT FEMALE CONNECTOR	1	2		
	7,8	11/4-in. NPT FEMALE CONNECTOR	2	4		
	2	1-in. NPT FEMALE CONNECTOR	2	2		
CONDENSER	3-6	11/4-in. NPT FEMALE CONNECTOR	2	2		
	7,8	11/4-in. NPT FEMALE CONNECTOR	4	4		
OPTIONAL STORAGE TANK	_	11/4-in. NPT FEMALE CONNECTOR		2		

NOTE: All valves relieve at 185 psig (1275 kPa).


### Table 40 — Cooler/Relief Valve Arrangement

HEAT EXCHANGER FRAME SIZE	COMPRESSOR FRAME SIZE	ISOLATION VALVES	COOLER ARRANGEMENT SEE FIGURE NO.	CONDENSER ARRANGEMENT SEE FIGURE NO.	
2	2	Yes	44A	44E	
2	2	No	44C	44E	
	2	Yes	44A	44E	
3	2	No	44C	44E	
3	3	Yes	44A	44E	
	3	No	44C	44E	
4	3	Yes	44A	44E	
4	3	No	44C	44E	
5	0	Yes	44A	44E	
	3	No	44C	44E	
	4	Yes	44A	44E	
	4	No	44C	44E	
	С	Yes	44A	44E	
		No	44C	44E	
	4	Yes	44A	44E	
6	4	No	44C	44E	
0	С	Yes	44A	44E	
		No	44C	44E	
	4	Yes	44B	44F	
	4	No	44D	44F	
	С	Yes	44B	44F	
7		No	44D	44F	
,	-	Yes	44B	44F	
	5	No	44D	44F	
	E	Yes	44B	44F	
		No	44D	44F	
	E	Yes	44B	44F	
0	5	No	44D	44F	
8	E	Yes	44B	44F	
		No	44D	44F	

### COOLER RELIEF VALVE ARRANGEMENT WITH OPTIONAL ISOLATION OF DISCHARGE AND COOLER (Fig. A, B)

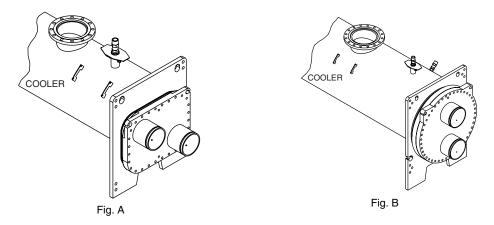

### COOLER RELIEF VALVE ARRANGEMENT WITHOUT ISOLATION OPTION OF DISCHARGE AND COOLER (Fig. C, D)

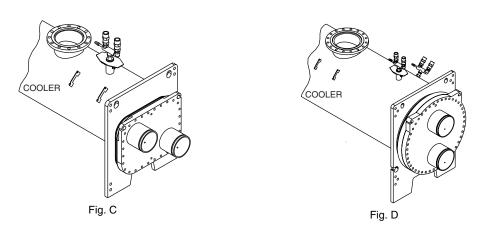

### ${\tt CONDENSER\ RELIEF\ VALVE\ ARRANGEMENT-WITH\ OR\ WITHOUT\ OPTIONAL\ ISOLATION\ (Fig.\ E,\ F)}$



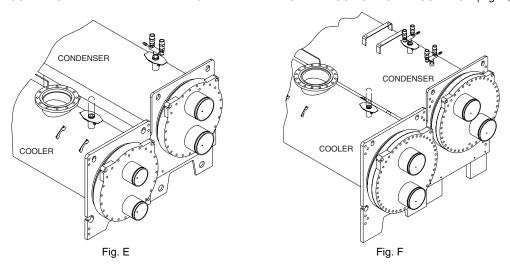



Fig. 44 — 19XRV Relief Valve Arrangements






COOLER HEAT EXCHANGER FRAME SIZE	CONDENSER HEAT EXCHANGER FRAME SIZE	WITH/WITHOUT DISCHARGE ISOLATION VALVE	VIEW CODE	COOLER NO. VALVES	CONDENSER NO. VALVES
<b>A</b> 4	A4	With Optional Isolation Valve	Α	2	4
		Without Optional Isolation Valve	В	4	4
	B4	With Optional Isolation Valve	Α	2	4
		Without Optional Isolation Valve	В	4	4
A6	A6	With Optional Isolation Valve	Α	2	4
		Without Optional Isolation Valve	В	4	4
	В6	With Optional Isolation Valve	Α	2	4
		Without Optional Isolation Valve	В	4	4


Fig. 45 — Relief Valve Arrangements, 19XR Two-Stage Compressor Frame Size 6




C — WITH ISOLATION VALVE



E — WITH ISOLATION VALVE



D — WITHOUT ISOLATION VALVE



F — WITHOUT ISOLATION VALVE

COOLER HEAT EXCHANGER FRAME SIZE	CONDENSER HEAT EXCHANGER FRAME SIZE	WITH/WITHOUT DISCHARGE ISOLATION VALVE	VIEW CODE	COOLER NO. VALVES	CONDENSER NO. VALVES
B6/B8	C6/C8	With Optional Isolation Valve	С	2	6
		Without Optional Isolation Valve	D	4	6
C6	C6	With Optional Isolation Valve	С	2	6
		Without Optional Isolation Valve	D	4	6
	D6	With Optional Isolation Valve	С	2	6
		Without Optional Isolation Valve	D	4	6
C8	C8	With Optional Isolation Valve	Е	3	6
		Without Optional Isolation Valve	F	6	6
	D8	With Optional Isolation Valve	Е	3	6
		Without Optional Isolation Valve	F	6	6

Fig. 46 — Relief Valve Arrangements, 19XR Two-Stage Compressor Frame Size 7

## INSTALL CIRCUIT BREAKER HANDLE EXTENSION — 19XR2-E (FIG. 47)

Unit-mounted Standard Tier Frame E765-E1530 and LF2 Frame 900-1169 Amp VFDs are shipped with handle extension for the VFD main circuit breaker strapped to the VFD mounting frame. This handle extension must be installed by sliding the clip over the circuit breaker handle (Fig. 48).




Fig. 47 — Circuit Breaker Handle Extension




Fig. 48 — Circuit Breaker Handle Extension Installed

### Step 5 — Make Electrical Connections

Field wiring must be installed in accordance with job wiring diagrams and all applicable electrical codes.

### **↑** CAUTION

Do not run any hazardous voltage wiring in the control panel sections associated with extra-low voltage wiring. Damage to machine could occur as a result.

Wiring diagrams in this publication are for reference only and are not intended for use during actual installation; follow job specific wiring diagrams.

### **A** CAUTION

Do not apply power to the compressor motor or oil pump (even for a rotation check) or apply test voltage of any kind while either chiller module is under dehydration vacuum. Motor insulation breakdown and serious damage may result.

NOTE: The dry contacts for the inputs should be located as close to the starter as possible. The wiring should be capable of preventing electrical noise or induced voltage and should not be routed with any wires with voltage over 50 v.


CONNECT CONTROL INPUTS

### **A** CAUTION

Install a relay, provided by the control contractor, at the starter/control panel to connect to the chiller inputs, such as remote start/stop and spare safety, to reduce the potential for electrical noise into the chiller controller.

Wiring may be specified for a spare safety switch, and a remote start/stop contact can be wired to the starter terminal strip. Additional spare sensors and Carrier Comfort Network® modules may be specified as well. These are wired to the machine control panel as indicated in Fig. 49. The control panel optional wiring and power panel component layout are shown in Fig. 50-55.

Both chiller control panel and power panel have knockouts available that fits trade size 1/2 in. conduit.

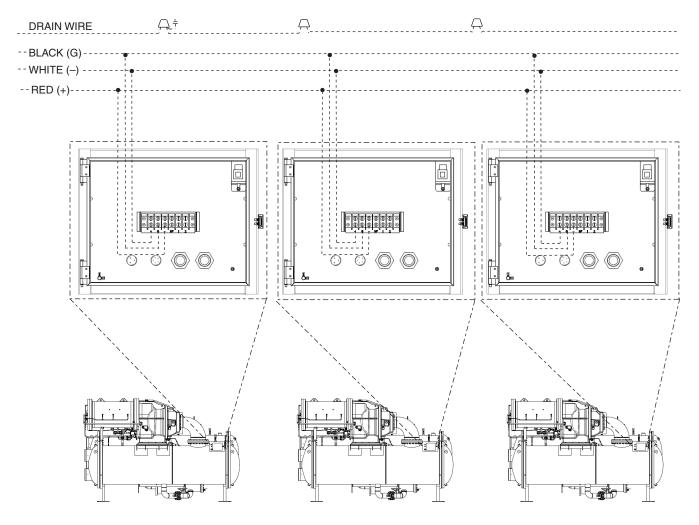

NOTE: Field-supplied terminal strip must be located in control panel.

Fig. 49 — CCN Communication Wiring for Multiple Chillers (Typical for 19XR6/7 Chillers)

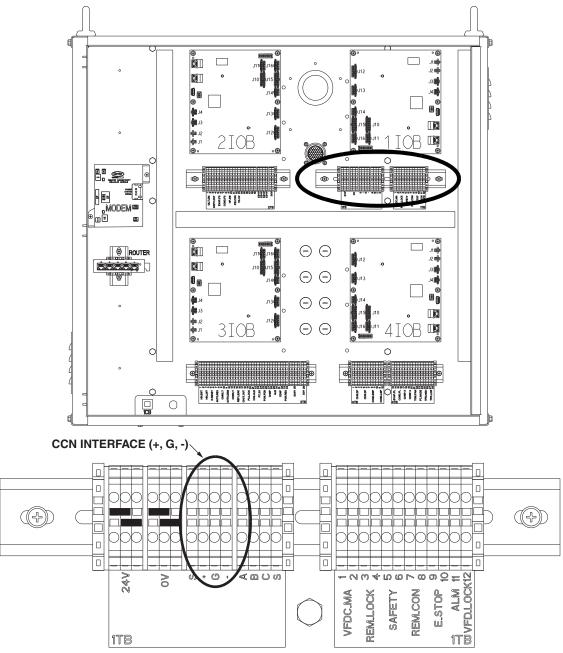


Fig. 50 — 19XR2-E Control Panel — CCN Communication Wiring for Multiple Chillers

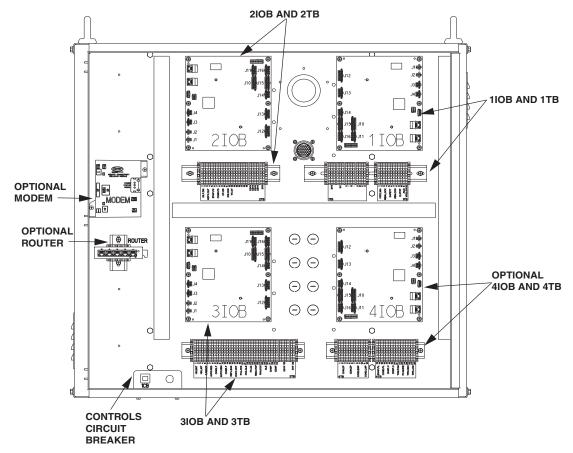


Fig. 51 — 19XR2-E Control Panel Layout and Field Connections

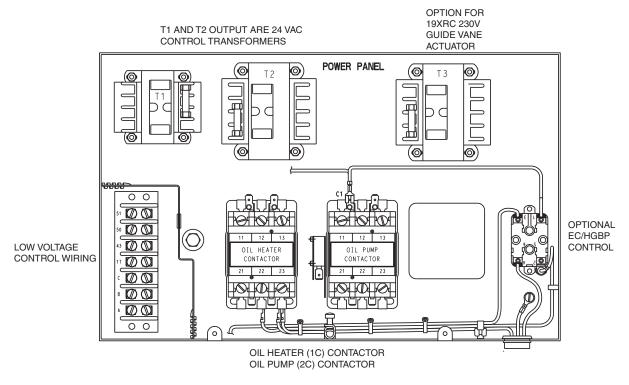


Fig. 52 — 19XR2-E Power Panel Layout

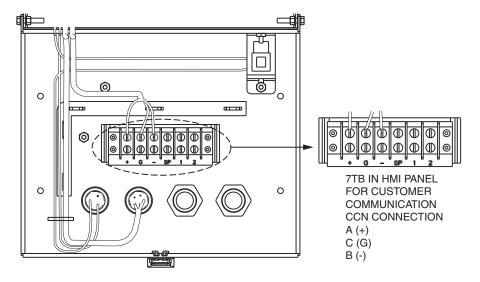


Fig. 53 — 19XR6/7 HMI Panel

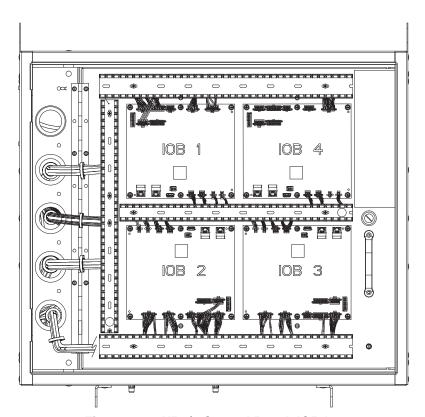


Fig. 54 — 19XR6/7 Control Panel, IOB Layer

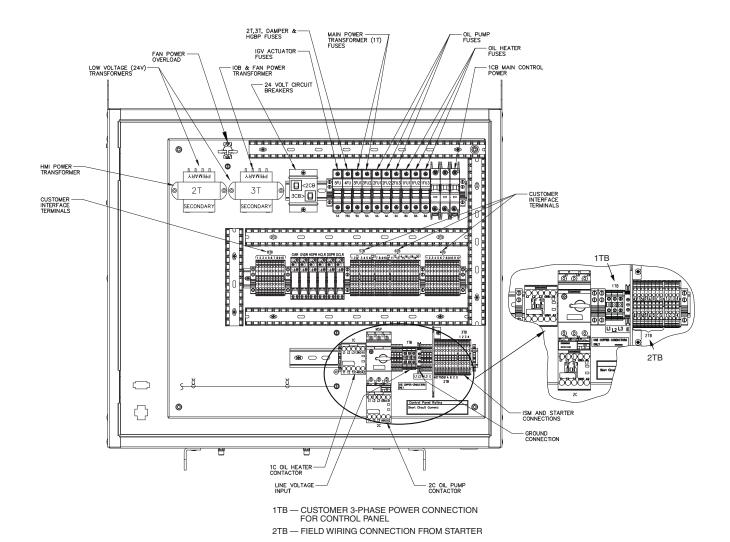


Fig. 55 — 19XR6/7 Control Panel, Bottom Layer

# CONNECT CONTROL OUTPUTS

Connect auxiliary equipment, chilled and condenser water pumps, and spare alarms as required and indicated on job wiring drawings.

# CONNECT STARTER

The 19XR chiller is available with both unit mount (Fig. 56). Models 19XR2-E are available with both unit mount and free-standing fixed speed starters and VFDs. Models 19XR6-7 are available with free-standing starters or VFD only.

IMPORTANT: Be sure to ground the power circuit in accordance with the National Electrical Code (NEC), applicable local codes, and job wiring diagrams. Also, make sure correct phasing is observed for proper rotation.

For free-standing starters assemble and install compressor terminal box in desired orientation, and cut necessary conduit openings in conduit support plates. See Fig. 56. Attach power leads to compressor terminals in accordance with job wiring drawings, observing caution label in terminal box. Use only copper conductors. The motor must be grounded in accordance with NEC, applicable local codes, and job wiring diagrams. Installer is responsible for any damage caused by improper wiring between starter and compressor motor. See Fig. 57-68 for VFD (variable frequency drive), control, IOB (input/output board), and ISM (integrated starter module), MX3 starter wiring diagrams.

IMPORTANT: For free-standing starters do not insulate terminals until wiring arrangement has been checked and approved by Carrier start-up personnel. Refer to torque and connection instructions provided in the Start-up and Operations Manual for motor terminal wiring connections. Also, make sure correct phasing is followed for proper motor rotation.

#### FIELD WIRING


Use field wiring for the following configurations.

# For 19XR2-E:

- Fixed speed low voltage factory unit mounted starter
- Free-standing low voltage starter
- · Free-standing low voltage VFD
- Free-standing medium/high voltage starter
- Free-standing medium voltage VFD
- Fixed speed or VFD factory unit mounted (low voltage).
- Fixed speed free-standing (low voltage)

## For 19XR6-7:

- · Free-standing fixed speed
- Free-standing VFD

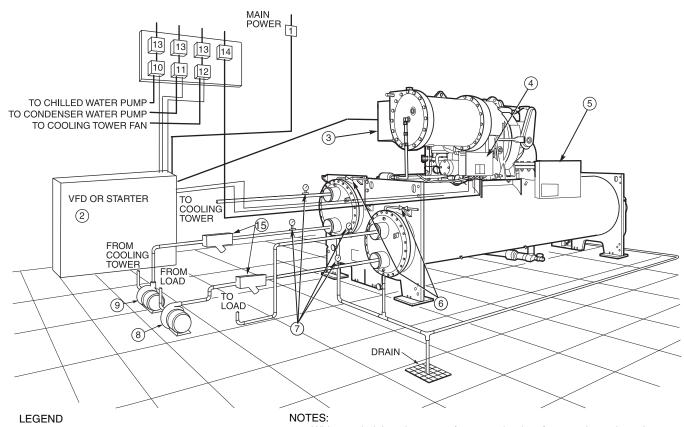

- 1 Disconnect
- 2 Compressor Motor Starter
- Compressor Motor Terminal Box
- Power Panel
- 5 Control Panel
- 6 Vents
- Pressure Gages
- Chilled Water Pump
- Condenser Water Pump
- 10 Chilled Water Pump Starter
- 11 Condensing Water Pump Starter
- 12 Cooling Tower Fan Starter (Low Fan, High Fan)
- 14 Oil Pump Disconnect (See Note 4)
- 15 Strainer
  - ¬ Piping
- Control Wiring
- Power Wiring

- 1. Wiring and piping shown are for general point-of-connection only and are not intended to show details for a specific installation. Certified field wiring and dimensional diagrams are available on request.
- All wiring must comply with applicable codes.
- Wiring not shown for optional devices such as:
  - Remote Start/Stop
  - Remote Alarms
  - Optional Safety Device

  - 4 to 20 mA ResetsOptional Remote Sensors
- 4. Oil pump disconnect may be located within the enclosure of Item 2 regardless if free-standing or unit mounted starter.
- IMPORTANT: Carrier suggests that a structural engineer be consulted if transmission of vibrations from mechanical equipment is of concern.
- Isolation valves are recommended on the cooler and condenser piping to each
- Operating environment Chiller should be installed in an indoor environment where the ambient temperature is 40 to 104°F (4 to 40°C) with a relative humidity (non-condensing) of 95% or less. To ensure that electrical components operate properly, do not locate the chiller in an area exposed to dust, dirt, corrosive fumes, or excessive heat and humidity.

Fig. 56 — 19XR Chiller with Free-Standing Starter

# **LEGEND FOR FIG. 57**

REFERENCE NUMBER	EXPLANATION				
	3 Phase Under/Over Voltage				
	Phase Loss/Imbalance/Reversal				
	Motor Overload Protection				
	Frequency Shift				
	kW Transducer/kW Hours/Demand kW				
	Single Cycle Dropout				
	Motor/Starter Overcurrent				
1	Control Power Transformer (3KVA) (Integral)				
	Controls and Oil Heater Circuit Breaker (integral)				
	Oil Pump Circuit Breaker (integral)				
	3 Phase Analog Volts/Amps Meter Package				
	Power Factor Correction Package				
	Lightning/Surge Arrestor Package				
	Phase to Phase Ground Fault Detection				
	Phase to Ground Fault Detection				
2	Compressor Motor Starter Branch Disconnect				
A	Evaporator Liquid Pump Starter Disconnect				
B	Evaporator Liquid Pump Motor Starter				
C	Condenser Liquid Pump Starter Disconnect				
D	Condenser Liquid Pump Motor Starter				
E	Cooling Tower Fan Motor Starter Disconnect (Low Fan/#1)				
F					
G	Cooling Tower Fan Motor Starter Disconnect (High/#2)				
н	Cooling Tower Fan Motor Starter (High Fan/#2)				
J	See Note 3.1 [N.O.] — Field Control Wiring (Spare safety (N.O), Remote Start/Stop (N.O), Alarm				
N	Lug Adapters See Note 2.1				

See Notes on page 78.

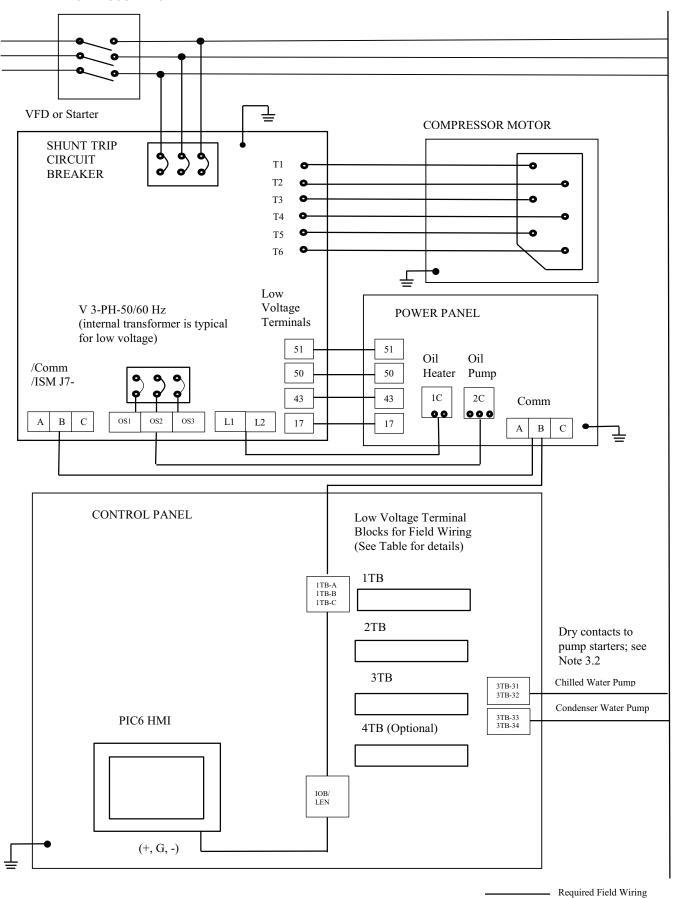


Fig. 57 — Typical 19XR2-E Fixed Speed or VFD — Factory Unit Mounted (Low Voltage)
Unit with Integrated Starter Module (ISM)

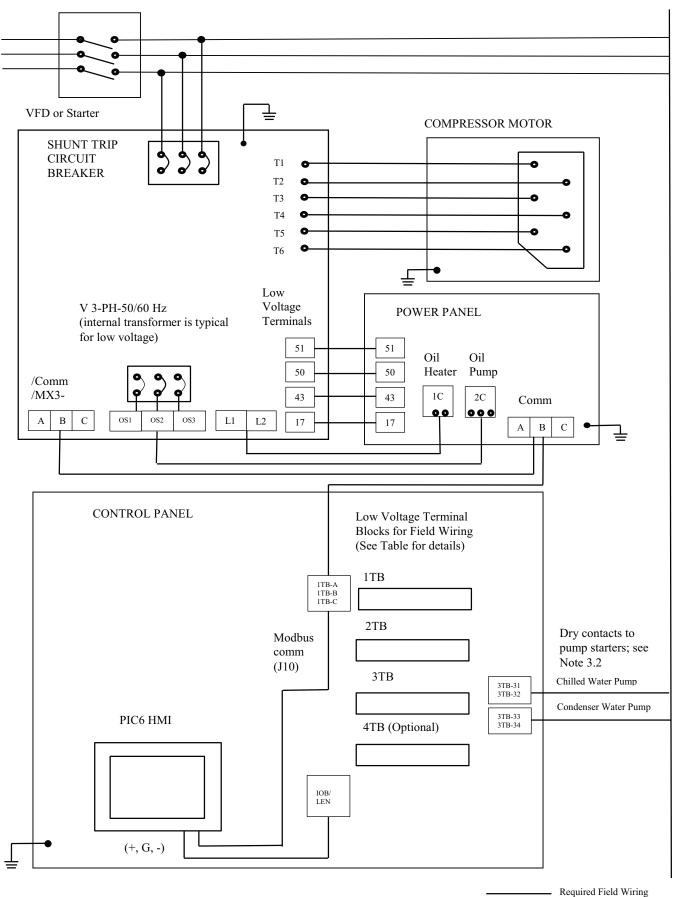


Fig. 58 — Typical 19XR2-E Fixed Speed or VFD — Factory Unit Mounted (Low Voltage) Unit with Modbus Communication between PIC6 HMI and Starter/VFD

# NOTES FOR Fig. 57 19XR2-E with Unit-Mounted Starter 19XR2-E Fixed Speed or VFD (with ISM) — Factory Unit Mounted (Low Voltage)

#### I. GENERAL

- 1.0 Starters shall be designed and manufactured in accordance with Carrier Engineering Requirement Z-415.
- 1.1 All field-supplied conductors, devices, and the field-installation wiring, and termination of conductors and devices, must be in compliance with all applicable codes and job specifications.

#### **A**CAUTION

To prevent damage to machine, do NOT punch holes or drill into the top surface of the starter enclosure for field wiring. Knockouts are provided on the side of the starter enclosure for field wiring connections.

- 1.2 The routing of field-installed conduit and conductors and the location of field-installed devices must not interfere with equipment access or the reading, adjusting, or servicing of any component.
- 1.3 Equipment installation and all starting and control devices, must comply with details in equipment submittal drawings and literature.
- 1.4 Contacts and switches are shown in the position they would assume with the circuit de-energized and the chiller shut down.
- 1.5 WARNING Do not use aluminum conductors.
- 1.6 Installer is responsible for any damage caused by improper wiring between starter and machine.

#### II. POWER WIRING TO STARTER

- 2.0 Provide a means of disconnecting power to starter.
- Power conductor rating must meet minimum unit nameplate voltage and unit MCA (minimum circuit ampacity).
- 2.2 Lug adapters may be required if installation conditions dictate that conductors be sized beyond the minimum ampacity required. Breaker lugs will accommodate the quantity (#) and size (MCM) cables (per phase) as indicated in tables below.

BENSHAW (SOLID-STATE)*					
CTARTER DI A	LUG CAPACITY (PER PHASE)				
STARTER RLA	# CONDUCTORS	CONDUCTOR RANGE			
95-200A	1	6 AWG — 350 MCM			
201-480A	2	3/0 AWG — 500 MCM			
481-640A	3	1/0 AWG — 500 MCM			
641-739A	4	250 — 500 MCM			
740-808	4	250 — 500 MCM			
809-978	5	300 — 600 MCM			
980-1390A	2	3/0 AWG — 500 MCM			
·	BENGHAW (WVE	DEL TA)*			

STARTER RLA         # CONDUCTORS         CONDUCTOR RANGE           112-217         1         6 AWG — 350 MCM           218-277         2         3/0 AWG — 500 MCM           278-364         2         3/0 AWG — 500 MCM           365-476         2         3/0 AWG — 500 MCM	BENSHAW (WYE-DELTA)"							
112-217         1         6 AWG — 350 MCM           218-277         2         3/0 AWG — 500 MCM           278-364         2         3/0 AWG — 500 MCM		PACITY (PER PHASE)	STARTER					
218-277         2         3/0 AWG — 500 MCM           278-364         2         3/0 AWG — 500 MCM		CONDUCTOR RANGE	# CONDUCTORS	RLA				
<b>278-364</b> 2 3/0 AWG — 500 MCM	-	6 AWG — 350 MCM	1	112-217				
		3/0 AWG — 500 MCM	2	218-277				
365-476 2 3/0 AWG — 500 MCM		3/0 AWG — 500 MCM	2	278-364				
000 470 E	-	3/0 AWG — 500 MCM	2	365-476				
<b>477-606</b> 4 250 — 500 MCM		250 — 500 MCM	4	477-606				
<b>607-779</b> 4 250 — 500 MCM		250 — 500 MCM	4	607-779				
<b>780-1143</b> 5 300 — 600 MCM		300 — 600 MCM	5	780-1143				
<b>1144-1551</b> 5 300 — 600 MCM		300 — 600 MCM	5	1144-1551				

 Benshaw unit mounted starters communicate via Modbus between PIC 6 and starter MX3.

- 2.3 Power conductors to starter must enter through top of enclosure. Flexible conduit should be used for the last few feet to the enclosure to provide unit vibration isolation.
- 2.4 Compressor motor and controls must be grounded by using equipment grounding lugs provided inside unit-mounted starter enclosure.
- 2.5 Starters with "Rated Load Amps" (RLA) greater than 740 require the assembly and the installation of a "Top Hat" (located inside enclosure) to provide the required wire bending space for incoming power leads.
- 2.6 Metering current transformers (CTs), if present, have an inner diameter of 2<sup>3</sup>/<sub>4</sub> inches. Caution should be taken when selecting power wiring so that all power cables can pass through the CTs.

#### III. CONTROL WIRING

- 3.0 Field-supplied control conductors to be at least 18 AWG or larger. It is recommended to connect all input/output field control wiring to Carrier Input/Output boards (IOBs) inside Carrier control panel.
- 3.1 Optional input device contacts (devices not supplied by Carrier), must have 24 VAC rating. MAX current is 60 mA, nominal current is 10 mA. The field wiring should be designed/installed in such a manner as to prevent electrical noise from being introduced into the chiller controller. Switches with gold plated bifurcated contacts are recommended.
- 3.2 Each integrated contact output can control loads (VA) for evaporator pump, condenser pump, tower fan low, tower fan high, and alarm annunciator devices rated 1 amp AC RMS steady-state and 4 amps surge. Coil voltage of relay is 24 vac. Be sure to use pilot relays to avoid damage to the IOBs. Suggested rating of pilot relay is 10 amps; for example, 19XV05005503.

#### **⚠** CAUTION

Control wiring for Carrier to start water pumps and establish flows must be provided to assure machine protection. If primary pump, tower fan, and flow control is by other means, also provide parallel means for control by Carrier. Failure to do so could result in machine freeze-up or overpressure and loss of warranty.

Do not use control transformers in the control center as the power source for external or field-supplied contactor coils, actuator motors or any other loads.

- 3.3 For tower fan control IOB4 (option) must be enabled. If one single speed fan is used, connect fan control leads to control panel 4IOB-25 and 4IOB-26, jumper 4IOB-25 to 4IOB-27, and jumper 4IOB-26 to 4IOB-28. This will allow the fan to be actuated by closure of either "low fan" or "high fan" 4IOB channel contact.
- 3.4 Do not route control wiring carrying 30 v or less within a conduit which has wires carrying 50 v or higher or along side wires carrying 50 v or higher.
- 3.5 Control wiring between starter and power panel must be separate shielded cables with minimum rating of 600 v, 80 C. Ground shield at starter.
- 3.6 Head Pressure 4-20 mA output signal is designed for controllers with a non-grounded 4-20 mA input signal and a maximum input impedance of 500 ohms.

# NOTES FOR Fig. 58

# 19XR2-E Unit Mount VFD (Low Voltage)

## 19XR2-E Fixed Speed or VFD with Modbus communication between PIC 6 HMI and starter/VFD Factory Unit Mounted (Low Voltage)

#### I General

- 1.0 Variable Frequency Drive (VFD) shall be designed and manufactured in accordance with Carrier engineering requirement Z-417 or Z-420. Fixed speed starters are designed and manufactured in accordance with Carrier engineering requirement Z-415.
- 1.1 All field-supplied conductors and devices must be compliant and be installed in compliance with all applicable codes and job specifications.

### **⚠** CAUTION

To prevent damage to machine, do NOT punch holes or drill into the top surface of the starter enclosure for field wiring. Knockouts are provided on the side of the starter enclosure for field wiring connections

- The routing of field-installed conduit and conductors and the location of field-installed devices must not interfere with equipment access or the reading, adjusting, or servicing of any component.
- Equipment installation and all starting and control devices must comply with details in equipment submittal drawings and literature.
- Contacts and switches are shown in the position they would assume with the circuit de-energized and chiller shut down.
- 1.5 Warning Do not use aluminum conductors.
  1.6 Warning Remove panel above VFD main circuit breaker before drilling. Do not drill into any other VFD cabinet panels.

#### II Power Wiring to VFD

- Provide a means of disconnecting branch feeder power to VFD. Provide short circuit protection and interrupt capacity for branch feeder in compliance with all applicable codes.
- 2.1 Metal conduit must be used for the power wires from VFD to branch feeder.
- 2.2 Line side power conductor rating must meet VFD nameplate volt-
- age and chiller full load amps (minimum circuit ampacity).

  2.3 Lug adapters may be required if installation conditions dictate that conductors be sized beyond the minimum ampacity required. Circuit breaker lugs will accommodate the quantity (#) and size cables (per phase) as follows.

ROCKWELL LF2 WIRE LUGS									
VFD MAX INPUT	LUG (	STANDARD 65KAIC OPTIONAL 1 LUG CAPACITY LUG CAPA (PER PHASE) (PER PHA		CAPACITY					
AMPS No. of Conductor		Conductor Range	No. of Conductors	Conductor Range					
442A	3	2/0 — 400MCM	3	2/0 — 400MCM					
608A	3	2/0 — 400MCM	3	2/0 — 400MCM					
900A	4	1/0 — 750MCM	4	1/0 — 750MCM					
1200A	4	1/0 — 750MCM	4	1/0 — 750MCM					

RC	ROCKWELL/ALLEN BRADLEY STANDARD TIER WIRE LUGS						
CARRIER VFD MAX INPUT AMPS	VOLTAGE	STANDARD ABB LUG	STANDARD LUG CABLE RANGE	ALTERNATE ABB LUG	ALTERNATE LUG CABLE RANGE		
230	480	KT5400	(2) 3/0 - 250 MCM	KT5300	(1) 250 - 500 MCM		
335	480	K6TJ	(3) 2/0 - 400 MCM	K6TH	(2) 250 - 500 MCM		
445	480	K6TJ	(3) 2/0 - 400 MCM	K6TH	(2) 250 - 500 MCM		
230	380/404/ 415	KT400	(2) 3/0 - 250 MCM	KT5300	(1) 250 - 500 MCM		
335	380/404/ 415	K6TJ	(3) 2/0 - 400 MCM	K6TH	(2) 250 - 500 MCM		
445	380/404/ 415	K6TJ	(3) 2/0 - 400 MCM	K6TH	(2) 250 - 500 MCM		
263	600	KT400	(2) 3/0 - 250 MCM	KT5300	(1) 250 - 500 MCM		

	EATON STANDARD TIER WIRE LUG SIZES						
		STAN	IDARD	ALTERNATE			
EATON FRAME SIZE	CARRIER VFD PART NO.	Line Terminal Lugs	AWG/MCM Wire Range (No. of Conductors)	Line Terminal Lugs	AWG/MCM Wire Range (No. of Conductors)		
	19XVE0485						
CH72	19XVE0550	TA1200NB1	4/0-500 (4)	TA1200NB1	1-600 (4)		
011/2	19XVE0605						
	19XVE0680						
	19XVE0765						
CH63	19XVE0855	TA1200NB1	4/0-500 (4)	TA1200NB1	1-600 (4)		
СПОЗ	19XVE0960						
	19XVE1070	TA1600RD	500-1000 (4)	TA1600RD*	1-600 (4)		
CH74	19XVE1275	TA1600RD	500-1000 (4)	TA1600RD*	1-600 (4)		
UH/4	19XVE1530	TA2000RD	2-600 (6)	N/A	N/A		

Terminal lug is suitable for copper wire only.

If larger lugs are required, they can be purchased from the manufacturer of the circuit breaker.

Compressor motor and controls must be grounded by using equipment grounding lug provided inside unit-mounted VFD enclosure.

#### **III Control Wiring**

- 3.0 Field-supplied control conductors to be at least 18 AWG or larger. It is recommended to connect all input/output field control wiring to Carrier Input/Output boards (IOBs) inside Carrier control panel.
- Optional Input device contacts (devices not supplied by Carrier) must have 24 vac rating. Max current is 60 mA; nominal current is 10 mA. The field wiring should be designed/installed in such a manner as to prevent electrical noise from being introduced into the chiller controller. Switches with gold-plated bifurcated contacts are recommended.
- 3.2 Each integrated contact output can control loads (VA) for evaporator pump, condenser pump, tower fan low, tower fan high, and alarm annunciator devices rated 1 amp AC RMS steady-state and 4 amps surge. Coil voltage of relay is 24 vac. Be sure to use pilot relays to avoid damage to the IOBs. Suggested rating of pilot relay is 10 amps; for example, 19XV05005503.

#### **A**CAUTION

Control wiring for Carrier to start water pumps and establish flows must be provided to assure machine protection. If primary pump, tower fan, and flow control is by other means, also provide parallel means for control by Carrier. Failure to do so could result in machine freeze-up or overpressure and loss of warranty.

Do not use control transformers in the VFD enclosure or power panel as the power source for external or field-supplied contactor coils, actuator motors, or any other loads.

- 3.3 Do not route control wiring carrying 30 v or less within a conduit which has wires carrying 50 v or higher or along side wires carrying 50 v or higher.
- Spare 4 to 20 mA output signal is designed for controllers with a non-grounded 4 to 20 mA input signal and a maximum input impedance of 500 ohms.

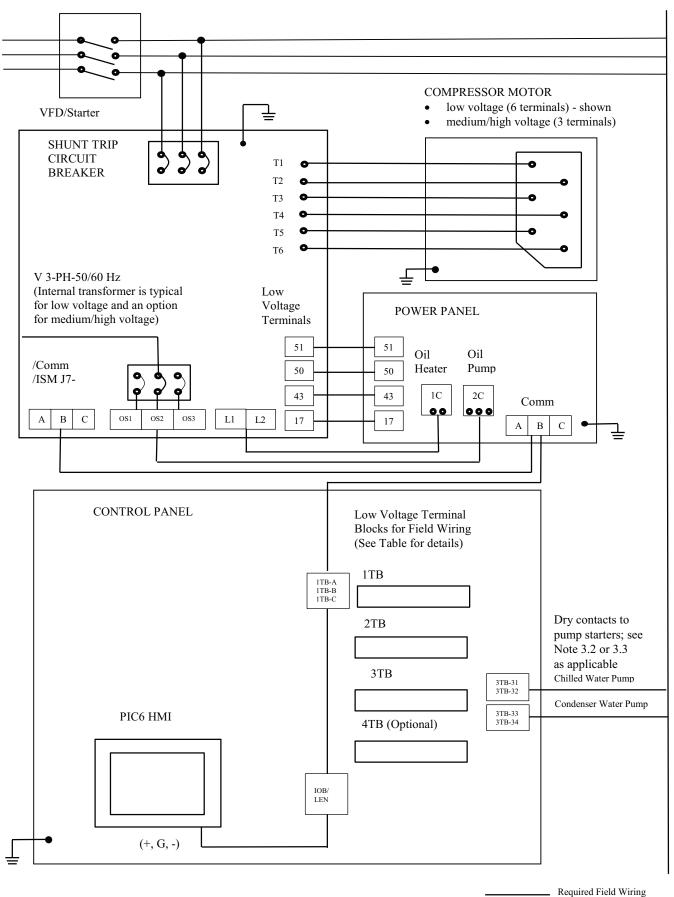


Fig. 59 — 19XR2-E with Free-Standing Low Voltage Starter; 19XR2-E with Free-Standing Low Voltage VFD; 19XR2-E with Free-Standing Medium Voltage Starter with Integrated Starter Module (ISM)

### NOTES FOR Fig. 59 19XR2-E with Free-Standing Low Voltage Starter

#### I. GENERAL

- 1.0 Starters shall be designed and manufactured in accordance with Carrier Engineering Requirement Z-415.
- 1.1 All field-supplied conductors, devices, and the field installation wiring, termination of conductors and devices, must be in compliance with all applicable codes and job specifications.

#### **↑** CAUTION

To prevent damage to machine, do NOT punch holes or drill into the top surface of the starter enclosure for field wiring. Knockouts are provided on the side of the starter enclosure for field wiring connections.

- 1.2 The routing of field-installed conduit and conductors and the location of field-installed devices must not interfere with equipment access or the reading, adjusting, or servicing of any component.
- 1.3 Equipment installation and all starting and control devices, must comply with details in equipment submittal drawings and literature.
- 1.4 Contacts and switches are shown in the position they would assume with the circuit de-energized and the chiller shut down.
- 1.5 WARNING Do not use aluminum conductors.
- 1.6 Installer is responsible for any damage caused by improper wiring between starter and machine.
- 1.7 All field-installed wiring is field-supplied.

#### II. POWER WIRING TO STARTER

- 2.0 Provide a means of disconnecting power to starter.
- 2.1 Lug adapters may be required if installation conditions dictate that conductors be sized beyond the minimum ampacity required. Contact starter supplier for lug information.
- 2.2 Compressor motor and controls must be grounded by using equipment grounding lug provided inside starter enclosure.

#### III. CONTROL WIRING

- 3.0 Field supplied control conductors to be at least 18 AWG or larger. It is recommended to connect all input/output field control wiring to Carrier Input/Output boards (IOBs) inside Carrier control panel.
- 3.1 Optional input device contacts (devices not supplied by Carrier), must have 24 VAC rating. MAX current is 60 mA, nominal current is 10 mA. The field wiring should be designed/installed in such a manner as to prevent electrical noise from being introduced into the chiller controller. Switches with gold plated bifurcated contacts are recommended.
- 3.2 Each integrated contact output can control loads (VA) for evaporator pump, condenser pump, tower fan low, tower fan high, and alarm annunciator devices rated 1 amp AC RMS steady-state and 4 amps surge. Coil voltage of relay is 24 vac. Be sure to use pilot relays to avoid damage to the IOBs. Suggested rating of pilot relay is 10 amps; for example, 19XV05005503.

#### **⚠** CAUTION

Control wiring for Carrier to start water pumps and establish flows must be provided to assure machine protection. If primary pump, tower fan, and flow control is by other means, also provide parallel means for control by Carrier. Failure to do so could result in machine freeze-up or overpressure and loss of warranty.

Do not use control transformers in the control center as the power source for external or field-supplied contactor coils, actuator motors or any other loads.

3.3 Do not route control wiring carrying 30 v or less within a conduit which has wires carrying 50 v or higher or along side wires carrying 50 v or higher.

- 3.4 Control wiring between starter and power panel must be separate shielded cables with minimum rating 600 v, 80 C. Ground shield at starter
- 3.5 If optional pumpout/oil pump circuit breaker is not supplied within the starter enclosure, it must be located within sight of machine with wiring routed to suit.
- 3.6 When providing conductors for oil pump motor and oil heater power, refer to sizing data on label located on the chiller power panel, equipment submittal documentation or equipment product data catalog.
- 3.7 Head Pressure 4-20 mA output signal is designed for controllers with a non-grounded 4-20 mA input signal and a maximum input impedance of 500 ohms.

# IV. POWER WIRING BETWEEN FREE-STANDING STARTER AND COMPRESSOR MOTOR

- 4.0 Low voltage (600 v or less) compressor motors have (6) <sup>5</sup>/<sub>8</sub> in. terminal studs (lead connectors not supplied by Carrier). Either 3 or 6 conductors must be run between compressor motor and starter, depending on the size of the conductors or the type of motor starter employed. If only 3 leads are utilized, jumper motor terminals as follows: 1 to 6, 2 to 4, 3 to 5. Center to center distance between terminals is 3<sup>5</sup>/<sub>32</sub> inches.
- 4.1 Power conductor rating must meet minimum unit nameplate voltage and compressor motor RLA. Refer to the label located on the side of the chiller control panel, equipment submittal documentation or equipment product data catalog for conductor sizing data. (Conductor as defined below may be a single lead or multiple smaller ampacity leads in parallel for the purpose of carrying the equivalent or higher current of a single larger lead.)

When 3 conductors are used:

Minimum ampacity per conductor = 1.25 x compressor RLA When 6 conductors are used:

Minimum ampacity per conductor = 0.721 x compressor RLA

- 4.2 When more than one conduit is used to run conductors from starter to compressor motor terminal box, an equal number of leads from the following phases (conductor) must be installed in each conduit to prevent excessive heating. Inside delta starters: 1, 3, or multiples of 3 conduits are required. (For example: conductors to motor terminals 1, 2, 3,
  - Inside delta starters: 1, 3, or multiples of 3 conduits are required. (For example: conductors to motor terminals 1, 2, 3, 4, 5 and 6 in a single conduit or conductors to motor terminals 1 and 4 in one conduit, conductors to motor terminals 2 and 5 in one conduit and conductors to motor terminals 3 and 6 in one conduit.)
  - For all other starters: 1, 2, or multiples of 2 are required. (For example: conductors to motor terminals 1, 2, and 3 in one conduit, and conductors to motor terminals 4, 5, and 6 in one conduit).
- 4.3 Compressor motor power conductors may enter terminal box through top, left side or bottom left using holes cut by contractor to suit conduit. Flexible conduit should be used for the last few feet to the terminal box for unit vibration isolation. Use of stress cones or 12 conductors larger than 500 MCM may require an oversize (special) motor terminal box (not supplied by Carrier). Lead connections between 3-phase motors and their starters must not be insulated until Carrier personnel have checked compressor and oil pump rotations.
- 4.4 Compressor motor frame to be grounded in accordance with the National Electrical Code (NFPA-70) and applicable codes. Means for grounding compressor motor is pressure connector for #4 AWG to 500 MCM wire, supplied and located in the lower left side corner of the compressor motor terminal box.
- 4.5 Do not allow motor terminals to support weight of wire cables. Use cable supports and strain reliefs as required.
- 4.6 Use backup wrench when tightening lead connectors to motor terminal studs. Torque to 45 lb-ft max. Use the instructions provided in the Startup and Operations Manual for additional detail for wire connections to the motor terminals.

#### NOTES FOR Fig. 59 19XR2-E with Free-Standing Low Voltage VFD

#### I. GENERAL

- 1.0 Variable frequency drive (VFD) shall be designed and manufactured in accordance with Carrier Engineering Requirement 7-416.
- 1.1 All field-supplied conductors, devices, and the field-installation wiring, termination of conductors and devices, must be in compliance with all applicable codes and job specifications.

#### **⚠** CAUTION

To prevent damage to machine, do NOT punch holes or drill into the top surface of the VFD enclosure for field wiring. Knockouts are provided on the side of the VFD enclosure for field wiring connections.

- 1.2 The routing of field-installed conduit and conductors and the location of field-installed devices must not interfere with equipment access or the reading, adjusting, or servicing of any component.
- 1.3 Equipment installation and all starting and control devices, must comply with details in equipment submittal drawings and literature.
- 1.4 Contacts and switches are shown in the position they would assume with the circuit de-energized and the chiller shut down.

#### 1.5 WARNING — Do not use aluminum conductors.

- 1.6 Installer is responsible for any damage caused by improper wiring between VFD and machine.
- 1.7 All field-installed wiring is field-supplied.

#### II. POWER WIRING TO VFD

- 2.0 Provide a local means of disconnecting power to VFD.
- 2.1 Lug adapters may be required if installation conditions dictate that conductors be sized beyond the minimum ampacity required. Refer to VFD dimensional drawings for lug information
- 2.2 Compressor motor and controls must be grounded by using equipment grounding lugs provided inside VFD enclosure.

#### III. CONTROL WIRING

- 3.0 Field supplied control conductors to be at least 18 AWG or larger. It is recommended to connect all input/output field control wiring to Carrier Input/Output boards (IOBs) inside Carrier control panel.
- 3.1 Optional input device contacts must have 24 VAC rating. MAX current is 60 mA, nominal current is 10 mA. The field wiring should be designed/installed in such a manner as to prevent electrical noise from being introduced into the chiller controller. Switches with gold plated bifurcated contacts are recommended.
- 3.2 Each integrated contact output can control loads (VA) for evaporator pump, condenser pump, tower fan low, tower fan high, and alarm annunciator devices rated 1 amp AC RMS steadystate and 4 amps surge. Coil voltage of relay is 24 vac. Be sure to use pilot relays to avoid damage to the IOBs. Suggested rating of pilot relay is 10 amps; for example, 19XV05005503.

# **⚠** CAUTION

Control wiring for Carrier to start water pumps and establish flows must be provided to assure machine protection. If primary pump, tower fan, and flow control is by other means, also provide parallel means for control by Carrier. Failure to do so could result in machine freeze-up or overpressure and loss of warranty.

Do not use control transformers in the control center as the power source for external or field-supplied contactor coils, actuator motors or any other loads.

3.3 Do not route control wiring carrying 30 v or less within a conduit which has wires carrying 50 v or higher or along side wires carrying 50 v or higher.

- 3.4 Control wiring between starter and power panel must be separate shielded cables with minimum rating 600 v, 80 C. Ground shield at starter
- 3.5 If optional pumpout/oil pump circuit breaker is not supplied within the starter enclosure, it must be located within sight of machine with wiring routed to suit.
- 3.6 When providing conductors for oil pump motor and oil heater power, refer to sizing data on label located on the chiller power panel, equipment submittal documentation or equipment product data catalog.
- 3.7 Head Pressure 4-20 mA output signal is designed for controllers with a non-grounded 4-20 mA input signal and a maximum input impedance of 500 ohms.

# IV. POWER WIRING BETWEEN FREE-STANDING VFD AND COMPRESSOR MOTOR

- 4.0 Low voltage (600 v or less) compressor motors have (6) <sup>5</sup>/<sub>8</sub> in. terminal studs with 19XR frame 2 and 3 compressor or (6) <sup>7</sup>/<sub>8</sub> in. terminal studs with 19XR frame 4 and 5 compressor (lead connectors not supplied by Carrier). Either 3 or 6 leads must be run between compressor motor and VFD, depending on the size of the conductors or the type of motor starter employed. If only 3 leads are utilized, jumper motor terminals as follows: 1 to 6, 2 to 4, 3 to 5. Center to center distance between frame 2 and 3 compressor terminals is 3-5/<sub>32</sub> inches. Center to center distance between frame 4 and 5 compressor terminals is 4-13/<sub>16</sub> inches. Compressor motor VFD must have nameplate stamped as to conforming with Carrier Engineering requirement "Z-416."
- 4.1 Power conductor rating must meet minimum unit nameplate voltage and compressor motor RLA. Refer to the label located on the side of the chiller control panel, equipment submittal documentation or equipment product data catalog for conductor sizing data. (Conductor as defined below may be a single lead or multiple smaller ampacity leads in parallel for the purpose of carrying the equivalent or higher current of a single larger lead.)

When 3 conductors are used:

Minimum ampacity per conductor = 1.25 x compressor RLA When 6 conductors are used:

Minimum ampacity per conductor = 1.25 x compressor RLA / 2.

- 4.2 When more than one conduit is used to run conductors from VFD to compressor motor terminal box, an equal number of leads from each phase (conductor) must be in each conduit to prevent excessive heating. (For example, conductors to motor terminals 1, 2, and 3 in one conduit, and conductors to motor terminals 4, 5, and 6 in another).
- 4.3 Compressor motor power conductors may enter terminal box through top, left side or bottom left using holes cut by contractor to suit conduit. Flexible conduit should be used for the last few feet to the terminal box for unit vibration isolation. Use of stress cones or 12 conductors larger than 500 MCM may require an oversize (special) motor terminal box (not supplied by Carrier). Lead connections between 3-phase motors and VFD must not be insulated until Carrier personnel have checked compressor and oil pump rotations.
- 4.4 Compressor motor frame to be grounded in accordance with the National Electrical Code (NFPA-70) and applicable codes. Means for grounding compressor motor is a pressure connector for #4 AWG to wire, supplied and located in the lower left side corner of the compressor motor terminal box.
- 4.5 Do not allow motor terminals to support weight of wire cables. Use cable supports and strain reliefs as required.
- 4.6 Use backup wrench when tightening lead connectors to motor terminal studs. Torque to 45 lb-ft max. Use the instructions provided in the Startup and Operations Manual for additional detail for wire connections to the motor terminals.
- 4.7 Do not exceed 100 ft. maximum power cable length between the VFD and motor terminals without consulting Carrier for special requirements.

#### NOTES FOR Fig. 59 19XR2-E with Free-Standing Starter (Medium Voltage)

#### I. GENERAL

- 1.0 Starters shall be designed and manufactured in accordance with Carrier Engineering Requirement Z-415.
- 1.1 All field-supplied conductors, devices, and the field installation wiring, termination of conductors and devices, must be in compliance with all applicable codes and job specifications.

#### **⚠** CAUTION

To prevent damage to machine, do NOT punch holes or drill into the top surface of the starter enclosure for field wiring. Knockouts are provided on the side of the starter enclosure for field wiring connections.

- 1.2 The routing of field-installed conduit and conductors and the location of field-installed devices must not interfere with equipment access or the reading, adjusting, or servicing of any component.
- 1.3 Equipment installation and all starting and control devices, must comply with details in equipment submittal drawings and literature.
- 1.4 Contacts and switches are shown in the position they would assume with the circuit de-energized and chiller shutdown.
- 1.5 WARNING Do not use aluminum conductors.
- 1.6 Installer is responsible for any damage caused by improper wiring between starter and machine.
- 1.7 All field-installed wiring is field-supplied.

#### II. POWER WIRING TO STARTER

- 2.0 Provide a means of disconnecting power to starter.
- 2.1 Lug adapters may be required if installation conditions dictate that conductors be sized beyond the minimum ampacity required. Contact starter supplier for lug information.
- 2.2 Compressor motor and controls must be grounded by using equipment grounding lug provided inside starter enclosure.

#### III. CONTROL WIRING

- 3.0 Field supplied control conductors to be at least 18 AWG or larger. It is recommended to connect all input/output field control wiring to Carrier Input/Output boards (IOBs) inside Carrier control panel.
- 3.1 Optional Input device contacts (devices not supplied by Carrier), must have 24 VAC rating. MAX current is 60 mA, nominal current is 10 mA. The field wiring should be designed/installed in such a manner as to prevent electrical noise from being introduced into the chiller controller. Switches with gold plated bifurcated contacts are recommended.
- 3.2 Remove jumper wire between J2-1 and J2-2 before connecting auxiliary safeties between these terminals.
- 3.3 Each integrated contact output can control loads (VA) for evaporator pump, condenser pump, tower fan low, tower fan high, and alarm annunciator devices rated 1 amp AC RMS steady-state and 4 amps surge. Coil voltage of relay is 24 vac. Be sure to use pilot relays to avoid damage to the IOBs. Suggested rating of pilot relay is 10 amps; for example, 19XV05005503.

#### **⚠** CAUTION

Control wiring for Carrier to start water pumps and establish flows must be provided to assure machine protection. If primary pump, tower fan, and flow control is by other means, also provide parallel means for control by Carrier. Failure to do so could result in machine freeze-up or overpressure and loss of warranty.

- Do not use control transformers in the control center as the power source for external or field-supplied contactor coils, actuator motors or any other loads.
- 3.4 Do not route control wiring carrying 30 v or less within a conduit which has wires carrying 50 v or higher or along side wires carrying 50 v or higher.
- 3.5 Control wiring between starter and power panel must be separate shielded cables with minimum rating 600 v, 80 C. Ground shield at starter.
- 3.6 If optional pumpout/oil pump circuit breaker is not supplied within the starter enclosure, it must be located within sight of machine with wiring routed to suit.
- 3.7 When providing conductors for oil pump motor and oil heater power, refer to sizing data on label located on the chiller power panel, equipment submittal documentation or equipment product data catalog.
- 3.8 Head Pressure 4-20 mA output signal is designed for controllers with a non-grounded 4-20 mA input signal and a maximum input impedance of 500 ohms.

# IV. POWER WIRING BETWEEN FREE-STANDING STARTER AND COMPRESSOR MOTOR

- 4.0 Medium voltage (over 600 volts) compressor motors have (3) terminals. Connections are 9/16-in. threaded stud. Use the 3 supplied adapters for a NEMA lug size connection. These connectors ensure adequate electrical contact between stud and field wiring. Use suitable connectors and insulation for high voltage alternating current cable terminations (these items are not supplied by Carrier). Compressor motor starter must have nameplate stamped as to conforming with Carrier Engineering requirement "Z-415."
- 4.1 Power conductor rating must meet minimum unit nameplate voltage and compressor motor RLA. Refer to the label located on the side of the chiller control panel, equipment submittal documentation or equipment product data catalog for conductor sizing data. (Conductor as defined below may be a single lead or multiple smaller ampacity leads in parallel for the purpose of carrying the equivalent or higher current of a single larger lead.)

When 3 conductors are used:

Minimum ampacity per conductor = 1.25 x compressor RLA

- 4.2 When more than one conduit is used to run conductors from starter to compressor motor terminal box, an equal number of leads from each phase (conductor) must be in each conduit to prevent excessive heating. (For example, conductors to motor terminals 1, 2, and 3 in one conduit, and those to 4, 5, and 6 in another).
- 4.3 Compressor motor power conductors may enter terminal box through top, left side or bottom left using holes cut by contractor to suit conduit. Flexible conduit should be used for the last few feet to the terminal box for unit vibration isolation. Use of stress cones may require an oversize (special) motor terminal box (not supplied by Carrier).
- 4.4 Compressor motor frame to be grounded in accordance with the National Electrical Code (NFPA-70) and applicable codes. Means for grounding compressor motor is a #4 AWG to 500 MCM pressure connector, supplied and located in the lower left side corner of the compressor motor terminal box.
- 4.5 Do not allow motor terminals to support weight of wire cables. Use cable supports and strain reliefs as required.
- 4.6 Use backup wrench when tightening lead connectors to motor terminal studs. Torque to 30-35 ft-lb max. Use the instructions provided in the Startup and Operations Manual for additional detail for wire connections to the motor terminals.

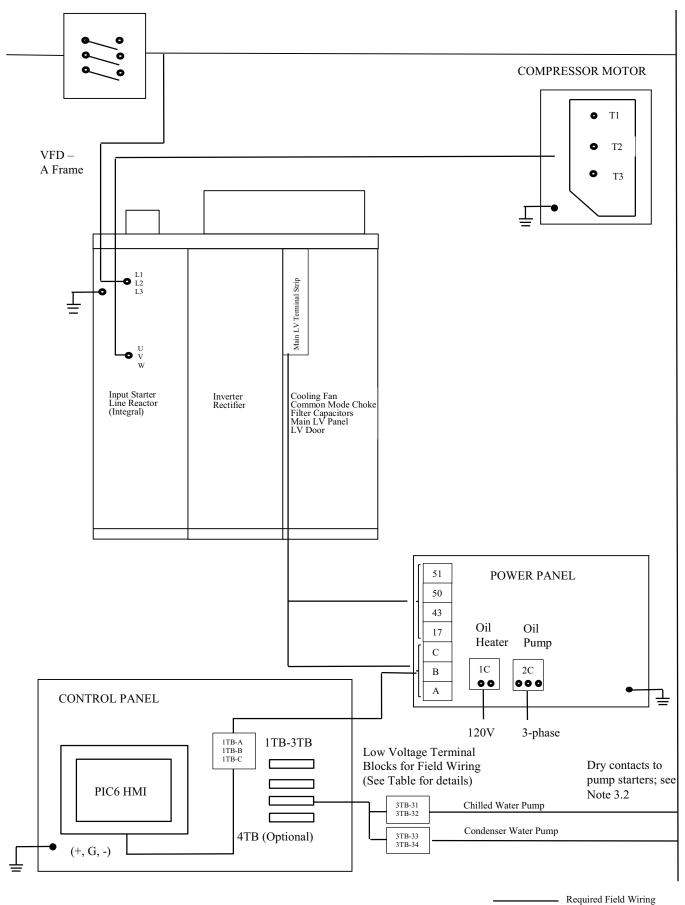


Fig. 60 — 19XR2-E Typical Field Wiring with Free-Standing Medium-Voltage VFD

## NOTES FOR FIG. 60 19XR2-E with Free-Standing Medium Voltage VFD

#### I. GENERAL

- 1.0 Variable Frequency Drive (VFD) shall be designed and manufactured in accordance with Carrier Engineering Requirement 7-416
- 1.1 All field-supplied conductors, devices, and the field installation wiring, termination of conductors and devices, must be in compliance with all applicable codes and job specifications.

#### **⚠** CAUTION

To prevent damage to machine, do NOT punch holes or drill into the top surface of the VFD enclosure for field wiring. Field wiring knockouts are provided on the top and side of the VFD enclosure for field wiring connections.

- 1.2 The routing of field-installed conduit and conductors and the location of field-installed devices must not interfere with equipment access or the reading, adjusting, or servicing of any component.
- 1.3 Equipment installation and all starting and control devices, must comply with details in equipment submittal drawings and literature.
- 1.4 Contacts and switches are shown in the position they would assume with the circuit de-energized and chiller shutdown.

#### 1.5 WARNING - Do not use aluminum conductors.

- 1.6 Installer is responsible for any damage caused by improper wiring between VFD and machine.
- 1.7 All field-installed wiring is field-supplied.

#### II. POWER WIRING TO VFD

- 2.0 Provide a means of disconnecting power to VFD.
- 2.1 Lug adapters may be required if installation conditions dictate that conductors be sized beyond the minimum ampacity required. Contact VFD supplier for lug information.
- 2.2 Compressor motor and controls must be grounded by using equipment grounding lug provided inside VFD enclosure.

#### III. CONTROL WIRING

- 3.0 Field supplied control conductors to be at least 18 AWG or larger. It is recommended to connect all input/output field control wiring to Carrier Input/Output boards (IOBs) inside Carrier control panel.
- 3.1 Optional controls Input device contacts (devices not supplied by Carrier), must have 24 VAC rating. MAX current is 60 mA, nominal current is 10 mA. The field wiring should be designed/ installed in such a manner as to prevent electrical noise from being introduced into the chiller controller. Switches with gold plated bifurcated contacts are recommended.
- 3.2 Each integrated contact output can control loads (VA) for evaporator pump, condenser pump, tower fan low, tower fan high, and alarm annunciator devices rated 1 amp AC RMS steadystate and 4 amps surge. Coil voltage of relay is 24 vac. Be sure to use pilot relays to avoid damage to the IOBs. Suggested rating of pilot relay is 10 amps; for example, 19XV05005503.

#### **⚠** CAUTION

Control wiring for Carrier to start water pumps and establish flows must be provided to assure machine protection. If primary pump, tower fan, and flow control is by other means, also provide parallel means for control by Carrier. Failure to do so could result in machine freeze-up or overpressure and loss of warranty.

Do not use control transformers in the control center as the power source for external or field-supplied contactor coils, actuator motors or any other loads.

- 3.3 Do not route control wiring carrying 30 v or less within a conduit which has wires carrying 50 v or higher or along side wires carrying 50 v or higher.
- 3.4 Control wiring between VFD and power panel must be separate shielded cables with minimum rating 600 v, 80 C. Ground shield at VFD
- 3.5 If optional pumpout/oil pump circuit breaker is not supplied within the starter enclosure, it must be located within sight of machine with wiring routed to suit.
- 3.6 When providing conductors for oil pump motor and oil heater power, refer to sizing data on label located on the chiller power panel, equipment submittal documentation or equipment product data catalog.
- 3.7 Head Pressure 4-20 mA output signal is designed for controllers with a non-grounded 4-20 mA input signal and a maximum input impedance of 500 ohms.

# IV. POWER WIRING BETWEEN FREE-STANDING VFD AND COMPRESSOR MOTOR

- 4.0 Medium voltage (over 600 volts) compressor motors have (3) terminals. Connections are <sup>9</sup>/<sub>16</sub>-in. threaded stud. A compression lug with a single <sup>9</sup>/<sub>16</sub>-in. diameter hole can be connected directly to the stud or 3 adapters are supplied for connecting a NEMA lug. Use suitable connectors and insulation for high voltage alternating current cable terminations (these items are not supplied by Carrier).
- 4.1 Power conductor rating must meet minimum unit nameplate voltage and compressor motor RLA. Refer to the label located on the side of the chiller control panel, equipment submittal documentation or equipment product data catalog for conductor sizing data. (Conductor as defined below may be a single lead or multiple smaller ampacity leads in parallel for the purpose of carrying the equivalent or higher current of a single larger lead.)

When 3 conductors are used:

Minimum ampacity per conductor = 1.25 x compressor RLA When 6 conductors are used:

Minimum ampacity per conductor = 1.25 x compressor RLA/2

- 4.2 When more than one conduit is used to run conductors from VFD to compressor motor terminal box, an equal number of leads from each phase (conductor) must be in each conduit to prevent excessive heating. (For example, conductors to motor terminals 1, 2, and 3 in one conduit, and to 1, 2, and 3 in another conduit).
- 4.3 Compressor motor power conductors may enter terminal box through top, left side or bottom left using holes cut by contractor to suit conduit. Flexible conduit should be used for the last few feet to the terminal box for unit vibration isolation. Use of stress cones may require an oversize (special) motor terminal box (not supplied by Carrier).
- 4.4 Compressor motor frame to be grounded in accordance with the National Electrical Code (NFPA-70) and applicable codes. Means for grounding compressor motor is a #4 AWG to 500 MCM pressure connector, supplied and located in the lower left side corner of the compressor motor terminal box.
- 4.5 Do not allow motor terminals to support weight of wire cables. Use cable supports and strain reliefs as required.
- 4.6 Use backup wrench when tightening lead connectors to motor terminal studs. Torque to 30-35 ft-lb max. Use the instructions provided in the Startup and Operations Manual for additional detail for wire connections to the motor terminals.
- 4.7 Do not exceed 100 ft. maximum power cable length between the VFD and motor terminals without consulting Carrier for special requirements.

# LEGEND FOR Fig. 61 19XR2-E Chiller Control Schematic

		TOXITE E OTILI
1FU		Fire 54
2FU	_	Fuse, 5A Fuse, 10A
1C	_	Oil Heater Contactor
2C	_	Oil Pump Contactor
3C 1-4IOB	_	EC Valve Solenoid Open Relay Carrier Input Output Board 1-4
1-4TB	_	Terminal Block 1-4
ALE	_	Chiller Alert Relay
ALM AUTO DEM	_	Chiller Alarm Relay
AUTO_DEM AUTO_RES	_	Auto Demand Limit Input Auto Water Temp Reset
CB2/3	_	Circuit Breaker 2/3
CDW_DP	_	Cond Water Pressure Difference
CDWP	_	Condenser Water Pump
CDWP_V CHRS	=	Condenser Water Pump (Variable Speed) Chiller Run Status
	_	Chiller Status Output mA
CHST_OUT CHW_DP	_	Chilled Water Pressure Difference
CHWP	_	Chilled Water Pump
CHWP_V CHWR_T	_	Chilled Water Pump (Variable Speed) Common Chilled Water Return Temperature
CHWS_T	_	Common Chilled Water Supply Temperature
COND_EWP	_	Entering Cond Water Pressure
COND_FL COND_FS	_	Cond Water Flow Measurement Cond Water Flow Switch
COND_LH	_	Cond Sump Level High
COND_LL	_	Cond Sump Level Low
COND_LWP	_	Leaving Cond Water Pressure
COND_P CUS_ALE	_	Condenser Pressure Customer Alert
CVSI CVSI	_	Compressor VFD/Starter Interlock
DGT	_	Compressor Discharge Temperature
DIFF_OUT	_	Diffuser Output
DIFF_P DMP_CI	_	Diffuser Pressure
DMP_CL DMP_FC	_	Economizer Damper Valve Close
DMP_FO	_	Damper Valve Feedback Fully Close
_		Damper Valve Feedback Fully Open
DMP_OP E_STOP	_	Economizer Damper Valve Open Remote Emergency Stop Input
ECDW	_	Entering Condenser Water Temperature
ECON_P	_	Economizer Pressure
EC VALVE	_	Envelope Control Valve
ECW EVAP FL	=	Entering Chilled Water Temperature Evap Water Flow Measurement
EVAP FS	_	Evap Water Flow Switch
EVAP_P EVAP_T	_	Evaporator Pressure
EVAP_I	_	Evap Retrigerant Liquid Temperature
FC_MODE FC_SS	=	Free Cooling Mode Free Cooling Start Switch
FS_LOCK	_	Fire Security Interlock
GV1_DEC GV1_INC	_	Stage 1 IGV becrease
GVI_INC GVI_OUT	=	Stage 1 IGV Increase Guide Vane 1 Output
GV1_POS	_	Guide Vane 1 Actual Position
HDPV_OUT	_	head pressure output
HGBP_MA HGBP OP	_	EC Valve Feedback
HGBP_OUT	=	EC Valve Solenoid/Open EC Valve Output mA
HMI	_	Human Machine Interface (Touch Screen)
HP_SW	_	High Pressure Switch
HR_EWT HR_LWT	_	Heat Reclaim Entering Temperature Heat Reclaim Leaving Temperature
ICE_CON	=	Ice Build Contact
IGV	_	Integrated Guide Vane
LCDW	_	Leaving Condenser Water Temperature Leaving Chilled Water Temperature
LCW LLC_EXV	_	Liquid Level EXV Output
LOWLIFT_OUT	_	Low Lift Valve Output
MTRB_OIL	_	Thrust Bearing Oil Temperature Motor Winding Temperature 1
MTRW1 MTRW2	_	Motor Winding Temperature 1 Motor Winding Temperature 2
MTRW3	_	Motor Winding Temperature 3
OIL_EXVO	Ξ	Oil EVX Output
OIL_HEAT	_	Oil Heater Relay
OIL_PUMP OILP_DIS	=	Oil Pump Relay Oil Supply Pressure
OILP_SMP	_	Oil Sump Pressure
OILT_DIS OILT_SMP	_	Oil Supply Temperature Oil Sump Temperature
OILT_SMP POW FDB	Ξ	
POW_FDB POW REQ	_	Power Request Feedback Power Request Output
R_RESET	_	Remote Reset Sensor
REF_LEAK	_	Refrigerant Leak Sensor
REM_CON REM_LOCK	Ξ	Remote Contact Input Chiller Lockout Input
RMS	_	Root-Mean-Square
SAFETY	=	Spare Safety Transformer 1/2
T1/2	_	
TFR_HIGH TFR_LOW	_	Tower Fan High Tower Fan Low
TOW_FAN	_	Tower Fan (Variable Speed)
VFDC_MA	_	FS VFD Load Current
VS_SV	_	Vapor Source SV

WIRING **Factory Wiring** Mechanically Connected  $\bigcirc$ Power Panel Terminal Block  $\rightarrow \succ$ Conductor Male/Female Conductor Field Wiring Optional Wiring Component / Panel Enclosure Control Panel Terminal Block Oil Pump Terminal Δ Wire Splice Component Terminal \* \* Motor Starter Panel Conn Thermistor Contactor / Relay Coil  $\Theta$ Contactor Contact (N.O.) To High Pressure Switch **₫** Pressure Transducer **-**Oil Heater Circuit Breaker **€ BLK** Black BLU Blue BRN Brown **GRN** Green GRY Gray RED Red WHT White YEL Yellow Y/G Yellow/green ORG Orange

# **⚠** CAUTION

IOB contact 1 amp AC RMS steady-state and 4 amps surge. Coil voltage of relay is 24 VAC. Be sure to use pilot relays to avoid damage to the IOBs. Suggested rating of pilot relay is 10 amps; for example, 19XV05005503.

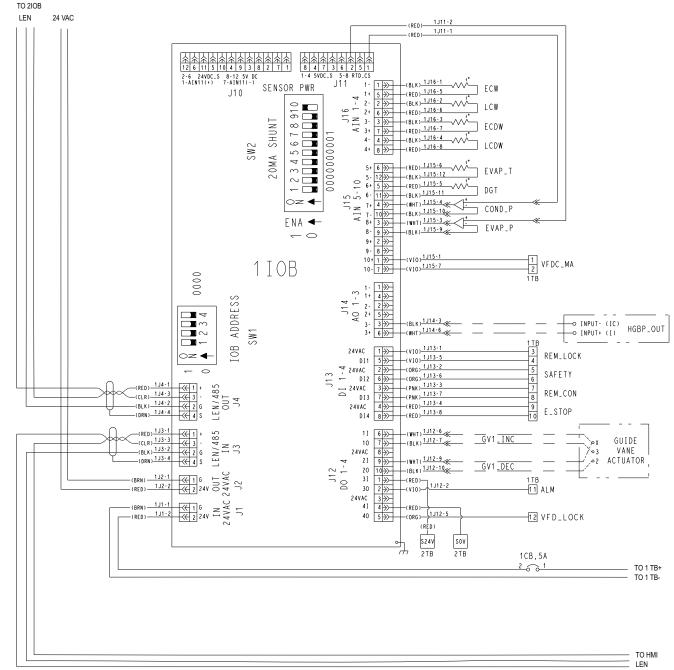


Fig. 61 — 19XR2-E Chiller Control Schematic FIELD TERMINALS for 1TB, Fig. 61

		DESCRIPTION	POINT NAME	TYPE	NOTES
	+ G -	Carrier Comfort Network (CCN) communication	CCN com	СОМ	Use for CCN communication devices
	A B C	Local Equipment Network (LEN) communication/Modbus (IOB and starter/ISM communication)	LEN com	СОМ	For unit mounted starters/VFD the communication connection between starter and VFD is completed at the factory.     For free-standing starters field connection between ISM and control panel communication is required
	1	Free Standing VFD LOAD CURRENT	VFDC_MA	4-20 mA	Optional input; FS VFD load current
1TB	3	Remote Lockout Input	REM_LOCK	24 VAC	Optional input; open/Close (dry contact); when closed chiller cannot be started
	5 6	Spare Safety	SAFETY	24 VAC	Optional input; Open/Close (dry contact); normally open (closed indicate safety shutdown condition
	7	Remote Contact Input	REM_CON	24 VAC	Optional input; Open/Close (dry contact); normally open (closed indicate start chiller signal)
	9 10	Emergency Stop Input	E_STOP	24 VAC	Optional Input; Open/Close (dry contact); normally open (closed indicate emergency stop)
	11	CHILLER ALARM RELAY	ALM	24 VAC	Optional output; 24 VAC indicates alarm condition

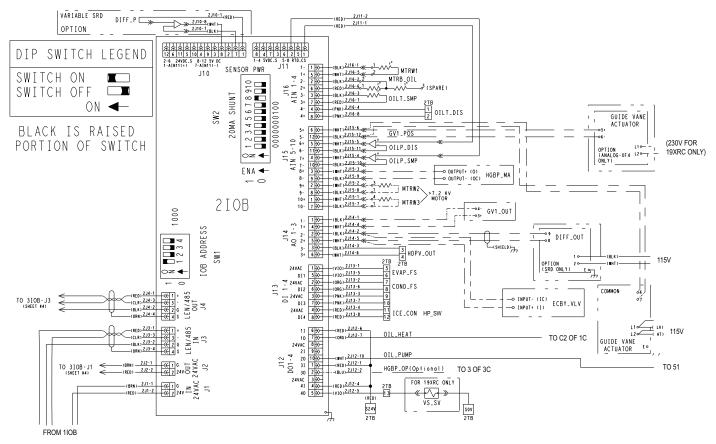


Fig. 61 — 19XR2-E Chiller Control Schematic (cont)

# FIELD TERMINALS for 2TB, Fig. 61

	DESCRIPTION	POINT NAME	TYPE	NOTES
3	Head Pressure Output	HDPV_OUT	4-20 mA	Optional Output; If used set dip switch to On for IOB2 channel 8.
5 6	Evaporator water flow switch	EVAP_FS	24 VAC	Optional Input; open/closed switch
2TB 7 8	Condenser water flow switch	COND_FS	24 VAC	Optional Input; open/closed switch
11 12	Ice build contact	ICE_CON	24 VAC	Optional Input; open/closed switch

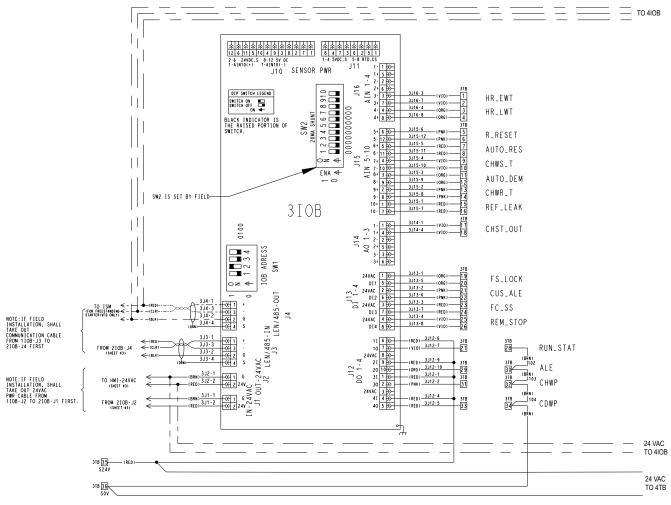


Fig. 61 — 19XR2-E Chiller Control Schematic (cont) FIELD TERMINALS for 3TB, Fig. 61

	DESCRIPTION	POINT NAME	TYPE	NOTES
5	Remote Reset Sensor	R_RESET	5 kOhm	Optional input
7 8	Auto Water Temp Reset	AUTO_RES	4-20 mA	Optional; If used set dip switch to On for IOB3 channel 6
9	Common Chilled Water Supply Temperature	CHWS_T	5 kOhm	Optional input
11 12	Auto Demand Limit Input	AUTO_DEM	4-20 mA	Optional; If used set dip switch to On for IOB3 channel 8
13 14	- Common Chilled Water Return Temperature	CHWR_T	5 kOhm	Optional
15 16	⊣ Retrigerant Leak Sensor	REF_LEAK	4-20 mA	Optional; If used set dip switch to On for IOB3 channel 10
17 18	Chiller Status Output mA	CHST_OUT	4-20 mA	Optional; (ON=20mA, OFF=4mA, TRIPOUT=8mA, Not Off and Compressor not running=12mA)
3TB 20	Fire Security Interlock	FS_LOCK	24 VAC	Optional Input; Normally open dry contact. If closed compressor will shut down under fire security alarm.
21 22	Customer Alert	CUS_ALE	24 VAC	Optional Input; Must be enabled and alert will show on PIC if contact is not closed.
23 24		FC_SS	24 VAC	Optional Input; Normally open dry contact.
25 26	Remote Stop	REM_STOP	24 VAC	Optional Input; If in Remote mode and Contact=Enable, then chiller will stop when contact is closed.
27 28	Chiller Run Status	RUN_STAT	24 VAC	Optional Output; Normally open dry contact
29 30	Chiller Alert Relay	ALE	24 VAC	Optional Output; Normally open dry contact
31 32	Chilled Water Pump	CHWP	24 VAC	Output; Normally open dry contact
33 34	Condenser Water Pump	CDWP	24 VAC	Output; Normally open dry contact

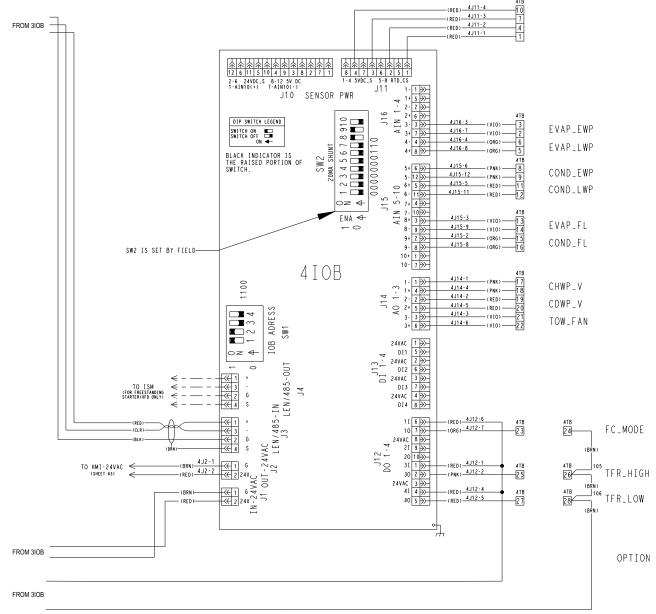


Fig. 61 — 19XR2-E Chiller Control Schematic (cont) FIELD TERMINALS for 4TB, Fig. 61

	DESCRIPTION	POINT NAME	TYPE	NOTES
	1 Chilled Water Pressure Difference or Evap Entering Water Pressure	CHW_DP or EVAP_EWP	5 VDC	Optional Input
_	4 Condenser Water Pressure Difference 5 or 6 Evap Leaving Water Pressure	CDW_DP or EVAP_LWP	5 VDC	Optional Input
	7   8   Condenser Entering Water Pressure	COND_EWP	5 VDC	Optional Input
4TR	0 11 Condenser Leaving water temperature	COND_LWP	5 VDC	Optional Input
_	3 Evaporator Water Flow Measurement	EVAP_FL	4-20 mA	Optional Input; If used set dip switch to On for IOB4 channel 8
	5 Condenser Water Flow Measurement	COND_FL	4-20 mA	Optional Input; If used set dip switch to On for IOB4 channel 9
2	Free Cooling Mode	FC_MODE	24 VAC	Optional Output; dry contact
25 26	Tower Fan High	TFR_HIGH	24 VAC	Optional Output; dry contact
2	Tower Fan Low	TFR_LOW	24 VAC	Optional Output; dry contact

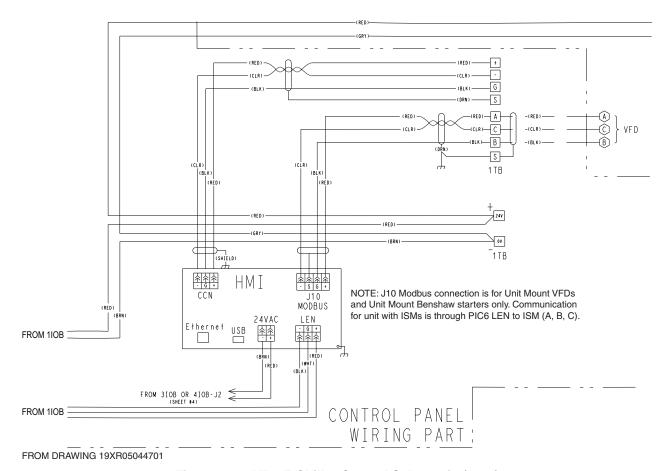


Fig. 61 — 19XR2-E Chiller Control Schematic (cont)

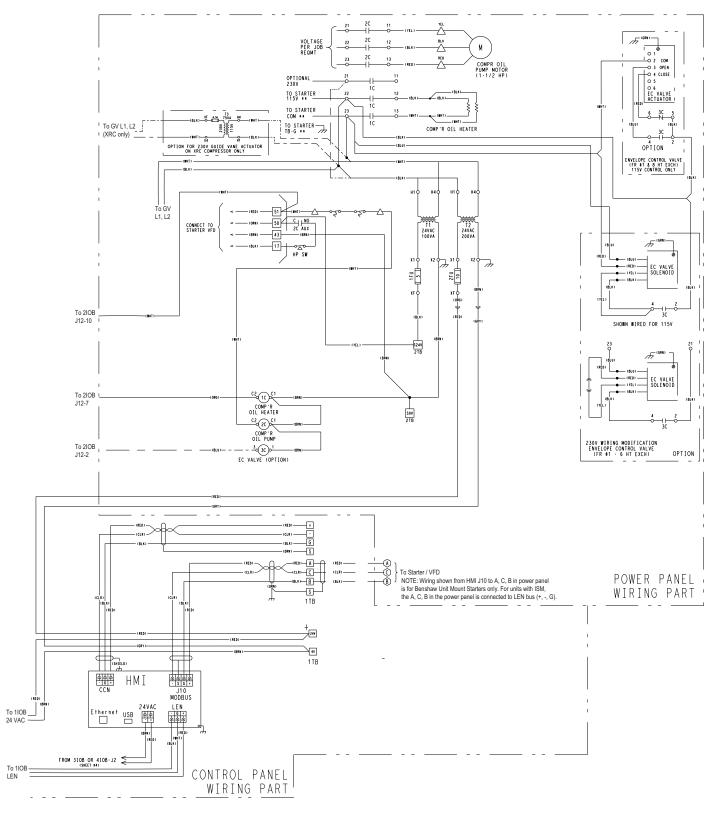


Fig. 62 — 19XR2-E Chiller Control Schematic for Non-Unit Mount VFD Chiller (Fixed Speed Chiller and free-standing VFD)

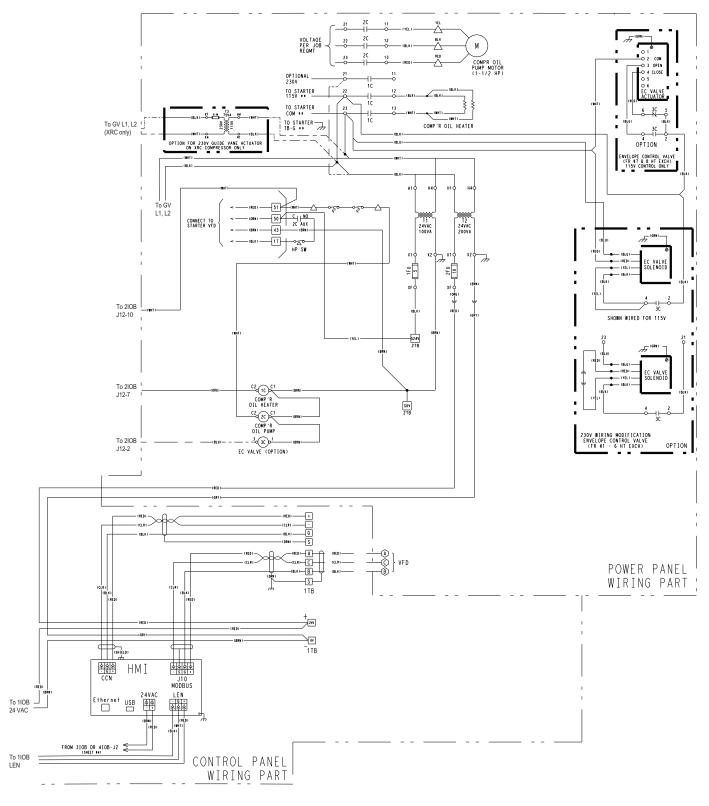


Fig. 63 — 19XR2-E Chiller Control Schematic for Unit Mount VFD Chiller

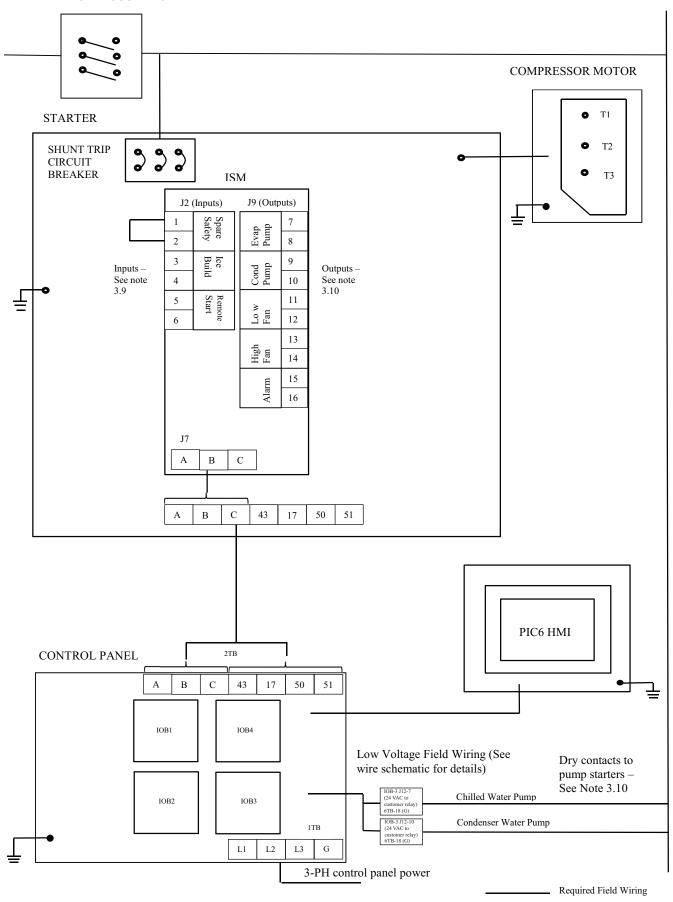


Fig. 64 — 19XR6/7 Typical Field Wiring with Free-Standing Starter (Medium Voltage)

#### NOTES FOR Fig. 64 19XR6/7 with Free-Standing Starter (Medium Voltage)

#### I. GENERAL

- 1.0 Starters shall be designed and manufactured in accordance with Carrier Engineering Requirement Z-415.
- 1.1 All field-supplied conductors, devices, and the field installation wiring, termination of conductors and devices, must be in compliance with all applicable codes and job specifications.

## **A** CAUTION

To prevent damage to machine, do NOT punch holes or drill into the top surface of the starter enclosure for field wiring. Knockouts are provided on the side of the starter enclosure for field wiring connections.

- 1.2 The routing of field-installed conduit and conductors and the location of field-installed devices must not interfere with equipment access or the reading, adjusting, or servicing of any component.
- 1.3 Equipment installation and all starting and control devices, must comply with details in equipment submittal drawings and literature.
- 1.4 Contacts and switches are shown in the position they would assume with the circuit de-energized and chiller shutdown.
- 1.5 WARNING Do not use aluminum conductors.
- 1.6 Installer is responsible for any damage caused by improper wiring between starter and machine.
- 1.7 All field-installed wiring is field-supplied.

#### II. POWER WIRING TO STARTER

- 2.0 Provide a means of disconnecting power to starter.
- 2.1 Lug adapters may be required if installation conditions dictate that conductors be sized beyond the minimum ampacity required. Contact starter supplier for lug information.
- 2.2 Compressor motor and controls must be grounded by using equipment grounding lug provided inside starter enclosure.

#### III. CONTROL WIRING

- 3.0 Field supplied control conductors to be at least 18 AWG or larger. It is recommended to connect all input/output field control wiring to Carrier Input/Output boards (IOBs) inside Carrier control panel.
- 3.1 Optional Input device contacts (devices not supplied by Carrier), must have 24 VAC rating. MAX current is 60 mA, nominal current is 10 mA. The field wiring should be designed/installed in such a manner as to prevent electrical noise from being introduced into the chiller controller. Switches with gold plated bifurcated contacts are recommended.
- 3.2 Remove jumper wire between J2-1 and J2-2 before connecting auxiliary safeties between these terminals.
- 3.3 Each integrated contact output can control loads (VA) for evaporator pump, condenser pump, tower fan low, tower fan high, and alarm annunciator devices rated 5 amps at 115 VAC and up to 3 amps at 277 VAC.

# **⚠** CAUTION

Control wiring for Carrier to start water pumps and establish flows must be provided to assure machine protection. If primary pump, tower fan, and flow control is by other means, also provide parallel means for control by Carrier. Failure to do so could result in machine freeze-up or overpressure and loss of warranty.

Do not use control transformers in the control center as the power source for external or field-supplied contactor coils, actuator motors or any other loads.

- 3.4 Do not route control wiring carrying 30 v or less within a conduit which has wires carrying 50 v or higher or along side wires carrying 50 v or higher.
- 3.5 Control wiring between starter and power panel must be separate shielded cables with minimum rating 600 v, 80 C. Ground shield at starter.

- 3.6 If optional pumpout/oil pump circuit breaker is not supplied within the starter enclosure, it must be located within sight of machine with wiring routed to suit.
- 3.7 When providing conductors for oil pump motor and oil heater power, refer to sizing data on label located on the chiller power panel, equipment submittal documentation or equipment product data catalog.
- 3.8 Head Pressure 4-20 mA output signal is designed for controllers with a non-grounded 4-20 mA input signal and a maximum input impedance of 500 ohms. Output is only available from Control Panel IOB - see wiring diagram.
- 3.9 ISM inputs Spare Safety, Ice Build, and Remote Start are active if ISM Input Enable has been set = Enable in *Main Menu→ Configuration→ IOB Configuration* (default ISM Input Enable = Dsable, which means that the IOBx inputs are active see wiring schematic).
- 3.10 Evap and Cond Pump, Lo and Hi Fan, and Alarm outputs are available from both J-9 ISM outputs and IOB assuming IOBx is enabled (see wiring schematic). Each integrated contact output can control loads (VA) for evaporator pump, condenser pump, tower fan low, tower fan high, and alarm annunciator devices rated 1 amp AC RMS steady-state and 4 amps surge. Coil voltage of relay is 24 vac. Be sure to use pilot relays to avoid damage to the IOBs. Suggested rating of pilot relay is 10 amps; for example, 19XV05005503.

# IV. POWER WIRING BETWEEN FREE-STANDING STARTER AND COMPRESSOR MOTOR

- 4.0 Medium voltage (over 600 volts) compressor motors have (3) terminals. Connections are <sup>9</sup>/<sub>16</sub>-in. threaded stud. Use the 3 supplied adapters for a NEMA lug size connection. These connectors ensure adequate electrical contact between stud and field wiring. Use suitable connectors and insulation for high voltage alternating current cable terminations (these items are not supplied by Carrier). Compressor motor starter must have nameplate stamped as to conforming with Carrier Engineering requirement "Z-415."
- 4.1 Power conductor rating must meet minimum unit nameplate voltage and compressor motor RLA. Refer to the label located on the side of the chiller control panel, equipment submittal documentation or equipment product data catalog for conductor sizing data. (Conductor as defined below may be a single lead or multiple smaller ampacity leads in parallel for the purpose of carrying the equivalent or higher current of a single larger lead.)

When 3 conductors are used:

Minimum ampacity per conductor = 1.25 x compressor RLA

- 4.2 When more than one conduit is used to run conductors from starter to compressor motor terminal box, an equal number of leads from each phase (conductor) must be in each conduit to prevent excessive heating. (For example, conductors to motor terminals 1, 2, and 3 in one conduit, and those to 4, 5, and 6 in another).
- 4.3 Compressor motor power conductors may enter terminal box through top, left side or bottom left using holes cut by contractor to suit conduit. Flexible conduit should be used for the last few feet to the terminal box for unit vibration isolation. Use of stress cones may require an oversize (special) motor terminal box (not supplied by Carrier).
- 4.4 Compressor motor frame to be grounded in accordance with the National Electrical Code (NFPA-70) and applicable codes. Means for grounding compressor motor is a #4 AWG to 500 MCM pressure connector, supplied and located in the lower left side corner of the compressor motor terminal box.
- 4.5 Do not allow motor terminals to support weight of wire cables. Use cable supports and strain reliefs as required.
- 4.6 Use backup wrench when tightening lead connectors to motor terminal studs. Torque to 30-35 ft-lb max.Use the instructions provided in the Startup and Operations Manual for additional detail for wire connections to the motor terminals.

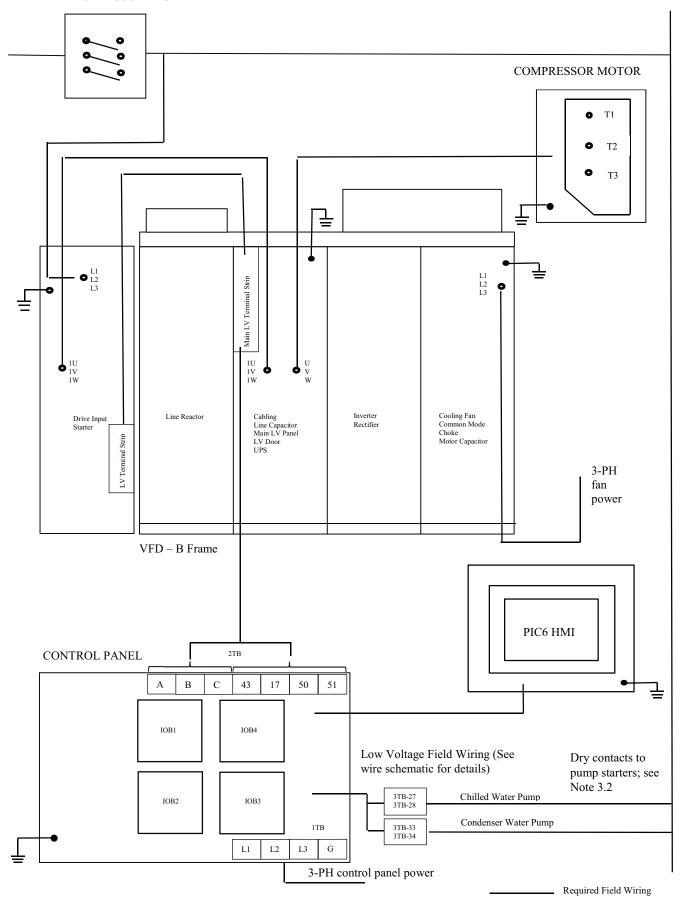


Fig. 65 — 19XR6/7 Typical Field Wiring with Free-Standing Variable Frequency Drive (VFD) (Medium Voltage)

## NOTES FOR Fig. 65 19XR6/7 with Medium Voltage VFD

#### I. GENERAL

- 1.0 Variable Frequency Drive (VFD) shall be designed and manufactured in accordance with Carrier Engineering Requirement 7-416.
- 1.1 All field-supplied conductors, devices, and the field installation wiring, termination of conductors and devices, must be in compliance with all applicable codes and job specifications.

#### **⚠** CAUTION

To prevent damage to machine, do NOT punch holes or drill into the top surface of the VFD enclosure for field wiring. Field wiring knockouts are provided on the top and side of the VFD enclosure for field wiring connections.

- 1.2 The routing of field-installed conduit and conductors and the location of field-installed devices must not interfere with equipment access or the reading, adjusting, or servicing of any component.
- 1.3 Equipment installation and all starting and control devices, must comply with details in equipment submittal drawings and literature.
- 1.4 Contacts and switches are shown in the position they would assume with the circuit de-energized and chiller shutdown.
- 1.5 WARNING Do not use aluminum conductors.
- 1.6 Installer is responsible for any damage caused by improper wiring between VFD and machine.
- 1.7 All field-installed wiring is field-supplied.

#### II. POWER WIRING TO VFD

- 2.0 Provide a means of disconnecting power to VFD.
- 2.1 Lug adapters may be required if installation conditions dictate that conductors be sized beyond the minimum ampacity required. Contact VFD supplier for lug information.
- 2.2 Compressor motor and controls must be grounded by using equipment grounding lug provided inside VFD enclosure.

#### III. CONTROL WIRING

- 3.0 Field supplied control conductors to be at least 18 AWG or larger. It is recommended to connect all input/output field control wiring to Carrier Input/Output boards (IOBs) inside Carrier control panel.
- 3.1 Optional controls Input device contacts (devices not supplied by Carrier), must have 24 VAC rating. MAX current is 60 mA, nominal current is 10 mA. The field wiring should be designed/ installed in such a manner as to prevent electrical noise from being introduced into the chiller controller. Switches with gold plated bifurcated contacts are recommended.
- 3.2 Each integrated contact output can control loads (VA) for evaporator pump, condenser pump, tower fan low, tower fan high, and alarm annunciator devices rated 1 amp AC RMS steadystate and 4 amps surge. Coil voltage of relay is 24 vac. Be sure to use pilot relays to avoid damage to the IOBs. Suggested rating of pilot relay is 10 amps; for example, 19XV05005503.

#### **A** CAUTION

Control wiring for Carrier to start water pumps and establish flows must be provided to assure machine protection. If primary pump, tower fan, and flow control is by other means, also provide parallel means for control by Carrier. Failure to do so could result in machine freeze-up or overpressure and loss of warranty.

Do not use control transformers in the control center as the power source for external or field-supplied contactor coils, actuator motors or any other loads.

- 3.3 Do not route control wiring carrying 30 v or less within a conduit which has wires carrying 50 v or higher or along side wires carrying 50 v or higher.
- 3.4 Control wiring between VFD and power panel must be separate shielded cables with minimum rating 600 v, 80 C. Ground shield at VFD
- 3.5 If optional pumpout/oil pump circuit breaker is not supplied within the starter enclosure, it must be located within sight of machine with wiring routed to suit.

- 3.6 When providing conductors for oil pump motor and oil heater power, refer to sizing data on label located on the chiller power panel, equipment submittal documentation or equipment product data catalog.
- 3.7 Head Pressure 4-20 mA output signal is designed for controllers with a non-grounded 4-20 mA input signal and a maximum input impedance of 500 ohms.

# IV. POWER WIRING BETWEEN FREE-STANDING VFD AND COMPRESSOR MOTOR

- 4.0 Medium voltage (over 600 volts) compressor motors have (3) terminals. Connections are <sup>9</sup>/<sub>16</sub>-in. threaded stud. A compression lug with a single <sup>9</sup>/<sub>16</sub>-in. diameter hole can be connected directly to the stud or 3 adapters are supplied for connecting a NEMA lug. Use suitable connectors and insulation for high voltage alternating current cable terminations (these items are not supplied by Carrier).
- 4.1 Power conductor rating must meet minimum unit nameplate voltage and compressor motor RLA. Refer to the label located on the side of the chiller control panel, equipment submittal documentation or equipment product data catalog for conductor sizing data. (Conductor as defined below may be a single lead or multiple smaller ampacity leads in parallel for the purpose of carrying the equivalent or higher current of a single larger lead.)

When 3 conductors are used:

Minimum ampacity per conductor = 1.25 x compressor RLA When 6 conductors are used:

Minimum ampacity per conductor = 1.25 x compressor RLA/2

- 4.2 When more than one conduit is used to run conductors from VFD to compressor motor terminal box, an equal number of leads from each phase (conductor) must be in each conduit to prevent excessive heating. (For example, conductors to motor terminals 1, 2, and 3 in one conduit, and to 1, 2, and 3 in another conduit).
- 4.3 Compressor motor power conductors may enter terminal box through top, left side or bottom left using holes cut by contractor to suit conduit. Flexible conduit should be used for the last few feet to the terminal box for unit vibration isolation. Use of stress cones may require an oversize (special) motor terminal box (not supplied by Carrier).
- 4.4 Compressor motor frame to be grounded in accordance with the National Electrical Code (NFPA-70) and applicable codes. Means for grounding compressor motor is a #4 AWG to 500 MCM pressure connector, supplied and located in the lower left side corner of the compressor motor terminal box.
- 4.5 Do not allow motor terminals to support weight of wire cables. Use cable supports and strain reliefs as required.
- 4.6 Use backup wrench when tightening lead connectors to motor terminal studs. Torque to 30-35 ft-lb max. Use the instructions provided in the Startup and Operations Manual for additional detail for wire connections to the motor terminals.
- 4.7 Do not exceed 100 ft. maximum power cable length between the VFD and motor terminals without consulting Carrier for special requirements.

# CABLE INSULATION REQUIREMENTS

SYSTEM VOLTAGE	CABLE INSULATION RATING (kv) (MAX. PEAK LINE-TO-GROUND)					
VOLTAGE	LINE SIDE	MACHINE SIDE				
2400	> 2.20	> 2.20				
3000	> 2.75	> 2.75				
3300	> 3.00	> 3.00				
4160	> 3.80	> 3.80				
6000	> 5.50	> 5.50				
6300	> 5.80	> 5.80				
6600	> 6.00	> 6.00				

## **LEGEND AND NOTES FOR Fig. 66-68**

#### Control Abbreviations — Fig. 66-68

 Chiller Alert **ALE**  Chiller Alarm ALM **AUTO DEM**  Demand Limit Input **AUTO RES** - Auto Water Temp Reset CHST\_OUT Chiller Running (On/Off/Ready) CHW\_DP - Chilled Water Pressure Difference

- Chilled Water Pump **CHWP** 

 Chilled Water Pump (Variable) CHWP V

**CHWR**  Chilled Water Return **CHWS**  Chilled Water Supply **CDWP** Condenser Water Pump

CDWP-V Condenser Water Pump (Variable)

**CHWP**  Chilled Water Pump Chilled Water Pump (Variable) CHWP V COND EWP Entering Condenser Water Pressure COND\_FL Condenser Water Flow Measurement COND\_FS - Condenser Water Flow Switch COND\_LWP - Leaving Condenser Water Pressure

COND\_P - Condenser Pressure CUS\_ALE Customer Alert

- Compressor Discharge Temperature DGT DMP\_CL - Economizer Damper Valve Close DMP\_FC - Damper Valve Feedback Fully Close DMP\_FO Damper Valve Feedback Fully Open DMP\_OP Economizer Damper Valve Open **ECDW** - Entering Condenser Water Temperature

**ECON P Economizer Pressure** 

- Entering Chilled Water Temperature **ECW** - Evaporator Refrigerant Temperature **ERT** EVAP\_EWP - Entering Evaporator Water Pressure EVAP\_FL - Evaporator Water Flow Measurement EVAP\_LWP - Leaving Evaporator Water Pressure

EVAP\_P - Evaporator Pressure FS-SS - Free Cooling Start Switch - IGV1 Position Input **GV1-ACT GV1 OUT** - IGV1 Control Signal HDPV OUT Head Pressure Output

HGBP\_CL - Hot Gas Bypass (HGBP) Valve Close HGBP\_FC Hot Gas Bypass Valve Feedback Fully Close HGBP\_FO - Hot Gas Bypass Valve Feedback Fully Open

HGBP\_OP Hot Gas Bypass Valve Open HP\_SW - High Pressure Switch ICE\_CON Ice Build Contact

 Leaving Condenser Water Temperature **LCDW LCW** Leaving Chilled Water Temperature

Low Speed Motor End Bearing Temperature MTRB1 (Thermistor/PT100)

Low Speed Compressor End Bearing MTRB2 Temperature (Thermistor/PT100)

MTRB3 High Speed Motor End Bearing Temperature

(Thermistor/PT100)

High Speed Compressor End Bearing MTRB4 Temperature (Thermistor/PT100)

MTRW1 Motor Winding Temperature 1 MTRW2 - Motor Winding Temperature 2 Motor Winding Temperature 3 MTRW3

OIL\_HEAT Oil Heater On/Off - Oil Pump On/Off OIL\_PUMP

OILP\_DIS - Oil Pump Discharge Pressure

OILP\_SMP Oil Sump Pressure **OILT SMP**  Oil Sump Temperature REM\_CON - Remote Connect Input REM\_LOCK - Chiller Lockout Input - Remote Stop Lock REM\_STP SAFETY Spare Safety

SHFT\_DIS Bearing Shaft Displacement Switch

TFR\_HIGH Tower Fan High Tower Fan Low TFR\_LOW TOW\_FAN Tower Fan (Variable) Wiring Codes — Fig. 66-68

1C - Oil Heater Contactor - Oil Pump Contactor 2C

1CB - Micro Circuit Breaker, Control Box 2CB Micro Circuit Breaker, HMI 3FU1,2 — Transformer 1 Primary Fuse 3FU3,4 — Transformer 1 Secondary Fuse

1R Alarm Relay - Transformer 1 1T **2T** - Transformer 2 **3T** - Transformer 3

- Terminal Block for Customer Power Connection 1TB

2TB Terminal Block for Field Connection

**3TB** Terminal Block for Customer Optional Connection

HMI Terminal Block Field CCN Connection **4TB** 

5TB Terminal Block for Control Panel Internal Connection Terminal Block for Guide Vane, HGBP and Damper 6TB Valve

**7TB** - Terminal Block for Guide Vane Actuator (220 v)

A01 - IGV/Stage 1 IGV

A03 Discharge Gas Temperature Thermistor

A04 - High Pressure Switch A06 - Bearing Displacement Switch

C11 - HGBP Valve Actuator

E01 - Evaporator Pressure Transducer

E03 - Leaving Chilled Water Temperature Thermistor

E05 - Evaporator Refrigerant Liquid Temperature Thermistor

EC01 - Economizer Pressure Transducer

EC06 Damper Valve Actuator НМІ - Human Interface Panel ISM - Integrated Starter Module

Motor Winding Temperature 1 (Thermistor/PT100) M01 M02 - Motor Winding Temperature 2 (Thermistor/PT100) Motor Winding Temperature 3 (Thermistor/PT100) M03

**MSP** - Motor Starter Protection

SAIA SAIA Touch Screen and Main Board

- Low Speed Motor End Bearing Temperature T01 (Thermistor/PT100)

T02 Low Speed Compressor End Bearing Temperature (Thermistor/PT100)

T03 High Speed Motor End Bearing Temperature

(Thermistor/PT100) High Speed Compressor End Bearing Temperature T04

(Thermistor/PT100)

T05 Oil Sump Temperature Thermistor T07 Oil Sump Pressure Transducer

T08 Oil Pump Discharge Pressure Transducer

T10 Oil Heater T11 — Oil Pump

NOTE: For customer-supplied 24 vac coil relays, Carrier recommends relays with contacts rated at a minimum of 10 amps sealed and 100 amps inrush.

# **LEGEND** — Fig. 66-68

O DENOTES COMPONENT TERMINAL

→ DENOTES CONDUCTOR MALE/FEMALE CONNECTOR

- FIELD WIRING
- OPTIONAL WIRING
- COMPONENT/PANEL ENCLOSURE
- TERMINAL BLOCK FOR FIELD WIRING
- OPTIONAL WIRE SPLICE

LUG CAPACITY: 8AWG MAX 380V / 460 VAC - 3PH - 60H7 USB LEN/RS-485 net D + >>> GND G>>>> SAIA /D - >>> нз о<u>400</u> \_\_\_\_ ×3 F G -(BLK) H2 460 3 ₹ 230<sub>0 X4</sub> 1TB L1 L2 L3 PE SP 1 2 CONTROL PANEL GND (BLK) CONNECTION DIAGRAM 1CB 9) HMI PANEL GND DUAL TAP PRIMARY-380V AND 480V 6 PIN (5-NC, 6-NC) SEE CONNECTION DIAGRAM FOR TRANSFORMER T1 INPUTS GND 6TB 719820 31<sub>0</sub> 5FU 75VA 4CB (BLK) 36 5 % (RED) 1 -< WHT >-≪ (BLU) (RED) 02 -(BLK)--≪-(BLK) 70 ⊣ RED ≻≪ 80--(GRN)-≪ (RED) A07 зсв (BLK) 5 0 0 (RED)-3|[ 75VA 對對 朝 朝 朝 - TO IOB-1 J3 IGV\_PWR (BLK) 11 GVIR 14 (BLK) 11 OH HO 14 (BLK) 11 OH HO 14 GVDR -(BLK)-(BLK) 2 —( WHT )— O L 2 EO 5TB PE DMP\_PWR DMP\_CLOS DMP\_OPEN (BLK) 110 + C14 (RED) - (BLU) - (WHT) DCLR O 3 OP MSP -O 5 CL → > > TO IOB-1 J1 4 5TB PE (RED) (G/Y) HGBP\_PWR HGBP\_CLOS HGBP\_OPEN (BLK) 110-| HCLR 14 (RED)-(BLK) 110-| HOPR (BLU)-O 3 CL -6 -( WHT )--O2 GO -( Y / G )--5TB PE OIL HEATER B2 3KW +/-5% B1 3.5KW +/-5% 6 TB 171513141618 24V24V24V0V 0V 0V 19XF75000201 REV H OIL PUMP 1490W

Fig. 66 — 19XR6-7 Controls Diagram

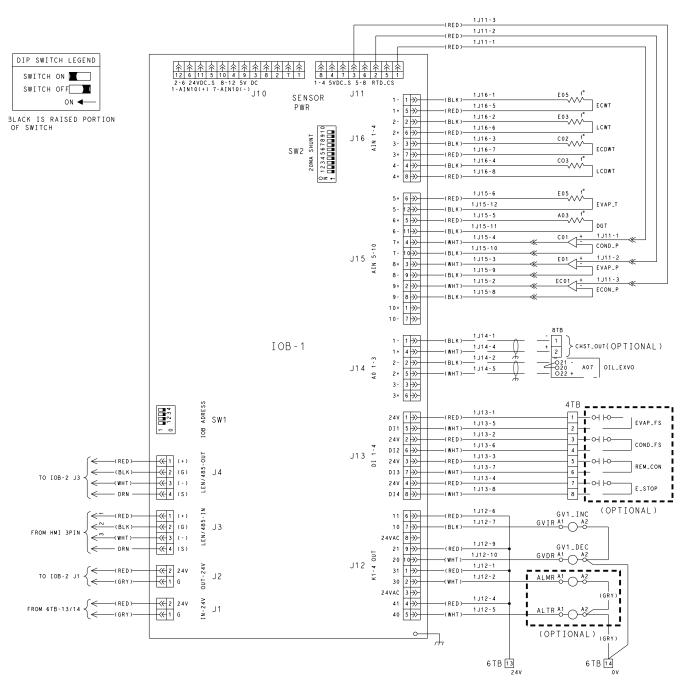


Fig. 67 — 19XR6-7 Chiller Control Schematic

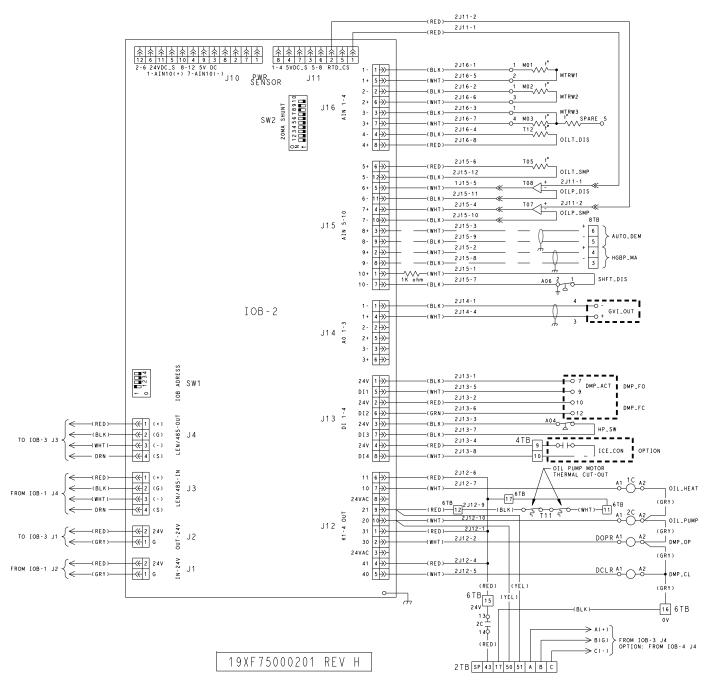


Fig. 67 — 19XR6-7 Chiller Control Schematic (cont)

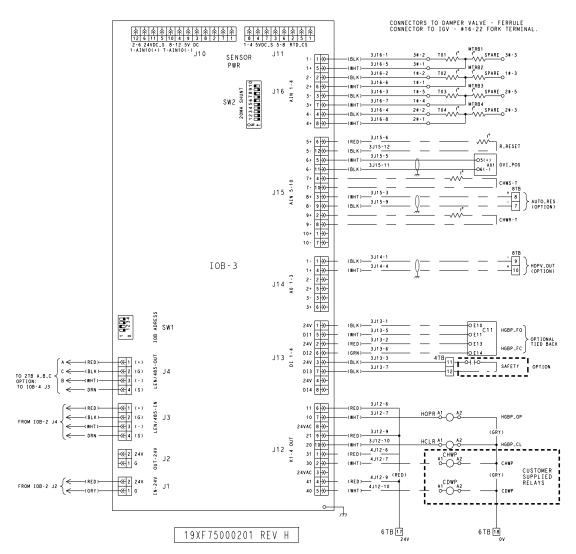


Fig. 67 — 19XR6-7 Chiller Control Schematic (cont)


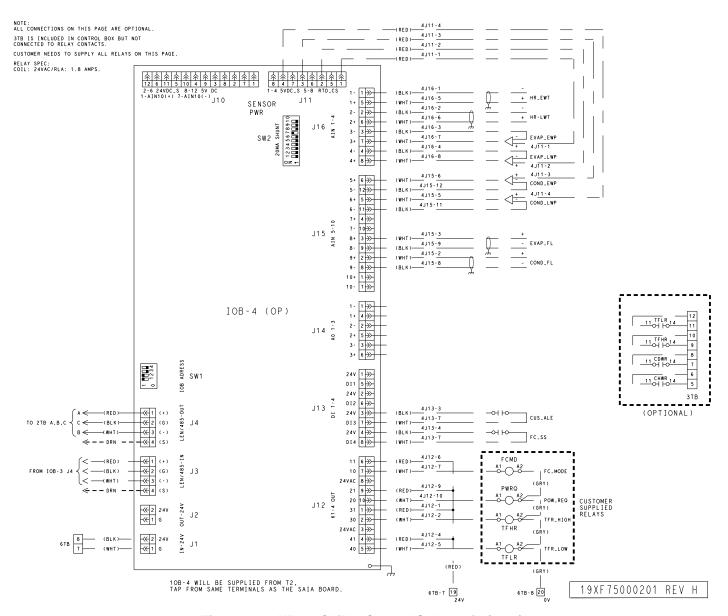


Fig. 67 — 19XR6-7 Chiller Control Schematic (cont)

FOR CUSTOMER SUPPLIED CONNECTION POINTS USE MOLEX CONNECTOR AND FEMALE PIN SHOWN HERE.

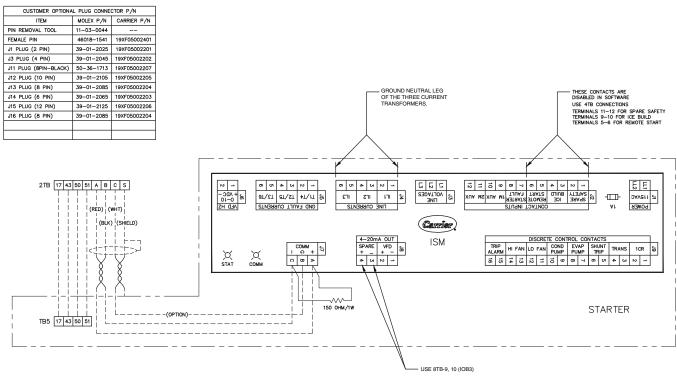

NOTE: For medium voltage free-standing VFD, TB5 is identified as drive terminal block 1 and is located at the low voltage terminal strip.

## Fig. 68 — Starter Wiring

## Insulate Motor Terminals and Lead Wire Ends

Insulate compressor motor terminals, lead wire ends, and electrical wires to prevent moisture condensation and electrical arcing.

# Medium Voltage Units

Medium-voltage units require special terminal preparation. Follow local electrical codes for high-voltage installation. Vinyl tape is not acceptable; a high voltage terminal method must be used.

# High Voltage Units (7000 Motor Volts and Higher)

These units require additional components for terminal isolation. The isolators (cap sleeve insulators) are ordered automatically for units that require the additional insulators. See Fig. 69 for an example.

NOTE: Wiring must be installed for the oil pump power supply and oil heater supply, along with interconnecting control wiring from the power panel to the starter.




Fig. 69 — Cap Sleeve Insulation to Prevent Arcing

# Connect Power Wires to Oil Pump Starter (For 19XR2-E, if required)

Connect power wires to power input terminals in the control panel. If required, use separate fused disconnect or circuit breaker as shown on job wiring diagrams. Check that power supply voltage agrees with oil pump voltage. Follow correct phasing for proper motor rotation.

# **A** CAUTION

Do not punch holes or drill into the top surface of power panel. Damage to machine could result. Use knockouts provided in the bottom of the power panels for wiring connections.

# Connect Power Wires to Oil Heater Contactor (For 19XR2-E, if required)

Connect control power wiring between the oil heater contactor terminals and terminals L1 and L2 on the field wiring strip in the compressor motor starter.

For 19XR6-7 connect 3-phase power (per job requirement) to terminal block 1TB in the control panel. This power controls the heater and oil pump.

# **MARNING**

When voltage to L1, L2, L3 in the control panel is supplied from a control transformer in a starter built to Carrier specifications, do not connect an outside source of control power to the compressor motor starter. An outside power source will produce dangerous voltage at the line side of the starter, because supplying voltage at the transformer secondary terminals produces input level voltage at the transformer primary terminals. Severe injury could result.

# Connect Wiring from Starter to Power Panel

Connect control wiring from main motor starter to the machine power panel. All control wiring must use shielded cable. Also, connect the communications cable. Refer to the job wiring diagrams for cable type and cable number. Make sure the control circuit is grounded in accordance with applicable electrical codes and instructions on machine control wiring label.

#### CARRIER COMFORT NETWORK INTERFACE

The Carrier Comfort Network® (CCN) communication bus wiring is supplied and installed by the electrical contractor. It consists of shielded, 3-conductor cable with drain wire.

The system elements are connected to the communication bus in a daisy chain arrangement. The positive pin of each system element communication connector must be wired to the positive pins of the system element on either side of it. The negative pins must be wired to the negative pins. The signal ground pins must be wired to the signal ground pins. See Fig. 49 for location of the CCN network connections on the terminal strip labeled CCN.

NOTE: Conductors and drain wire must be 20 AWG (American Wire Gage) minimum stranded, tinned copper. Individual conductors must be insulated with PVC, PVC/nylon, vinyl, Teflon<sup>1</sup>, or polyethylene. An aluminum/polyester 100% foil shield and an outer jacket of PVC, PVC/nylon, chrome vinyl, or Teflon with a minimum operating temperature range of –4°F to 140°F (–20°C to 60°C) is required. See table for cables that meet the requirements.

MANUFACTURER	CABLE NO.
Alpha	2413 OR 5463
American	A22503
Belden	8772
Columbia	02525

When connecting the CCN communication bus to a system element, a color code system for the entire network is recommended to simplify installation and checkout. The following color code is recommended:

SIGNAL TYPE	CCN BUS CONDUCTOR INSULATION COLOR	CCN NETWORK INTERFACE (Control Panel)
+	RED	+
Ground	WHITE	G
_	BLACK	-

If a cable with a different color scheme is selected, a similar color code should be adopted for the entire network.

At each system element, the shields of its communication bus cables must be tied together. If the communication bus is entirely within one building, the resulting continuous shield must be connected to ground at only one single point. See Fig. 49. If the communication bus cable exits from one building and enters another, the shields must be connected to ground at the lightning suppressor in each building where the cable enters or exits the building (one point only).

To connect the 19XR chiller to the network, proceed as follows (see Fig. 49):

- 1. Route wire through knockout in back of control panel.
- Strip back leads.
- 3. Crimp one no. 8 size spring spade terminal on each conductor.
- 4. Attach red to "+" terminal and white to "G" terminal and black to "-" terminal of CCN Network interface located in the control panel.

# Step 6 — Install Field Insulation

19XR

# **⚠ CAUTION**

Protect insulation from weld heat damage and weld splatter. Cover with wet canvas cover during water piping installation.

When installing insulation at the jobsite, insulate the following components:

- compressor motor
- · economizer
- · cooler shell
- · cooler tube sheets
- suction piping
- motor cooling drain
- · oil reclaim piping
- · oil cooler refrigerant side tubing
- refrigerant liquid line to cooler

NOTE: Insulation of the waterbox covers is applied only at the jobsite by the contractor. When insulating the covers, make sure there is access for removal of waterbox covers for servicing. See Fig. 70.

19XRV

# **⚠ CAUTION**

Protect insulation from weld heat damage and weld splatter. Cover with wet canvas cover during water piping installation.

When installing insulation at the jobsite, insulate the following components:

- · compressor motor
- cooler shell
- cooler tube sheets
- suction piping
- motor cooling drain
- · oil reclaim piping
- oil cooler refrigerant side tubing
- refrigerant liquid line to cooler

NOTE: Insulation of the waterbox covers is applied only at the jobsite by the contractor. When insulating the covers, make sure there is access for removal of waterbox covers for servicing. See Fig. 71.

<sup>1.</sup> Teflon is a registered trademark of Dupont.

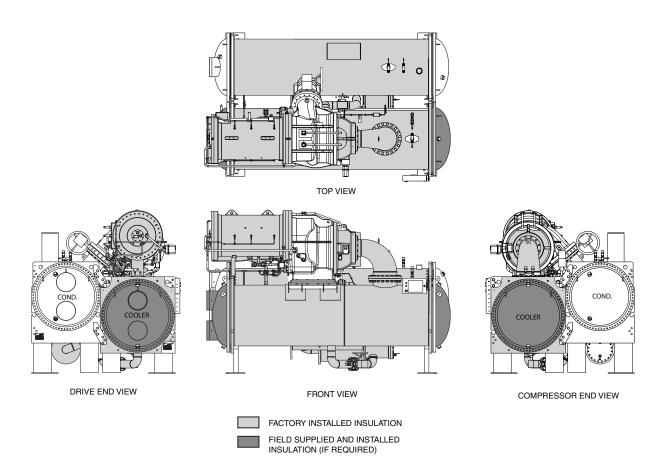


Fig. 70 — 19XR Insulation Area (Typical Unit with Economizer)

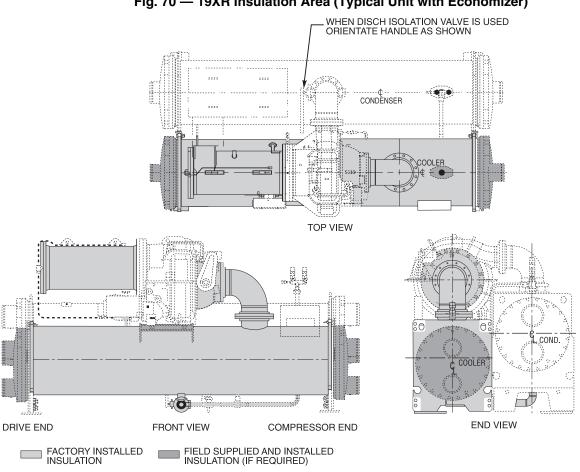


Fig. 71 — 19XR Insulation Area (Typical Unit without Economizer)

© 2020 Carrier Corporation

## **INSTALLATION START-UP REQUEST CHECKLIST**

NOTE: To avoid injury to personnel and damage to equipment or property when completing the procedures listed in this start-up checklist, use good judgment, follow safe practices and adhere to the safety considerations/information as outlined in preceding sections of this Installation Instructions document.

Mac	chine Model Number:	19XR Serial Number:	
То:			
Date	e:		
Attr	1:		
Proj	ect Name		
Car	rier Job Number		
NO app	TE: For units with medium voltage free-standing VFD, consult licable VFD frame size. The checklist is available at http://www.l	latest pre-commissioning Rociliterature.rockwellautomation.c	kwell Powerflex 7000 checklist for the com.
The	following information provides the status of the chiller installation	on.	
		YES/NO (N/A)	DATE TO BE COMPLETED
1.	The machine is level.		
2.	The machine components are installed and connected in accordance with the installation instructions.		
3.	The isolation package and grouting (if necessary) are installed.		
4.	The relief valves and fusible plugs are piped to the atmosphere.		
5.	All piping is installed and supported. Direction of flow is indicated in accordance with the installation instructions and job prints.		
	a. Chilled water piping		
	b. Condenser water piping		
	c. Waterbox drain piping		
	d. Pumpout unit condenser piping (if installed)		
	e. Other		
6.	Gages are installed as called for on the job prints required to establish design flow for the cooler and condenser.		
	a. Water pressure gages IN and OUT		
	b. Water temperature gages IN and OUT		

a. Power wiring to compressor motor. (If free-standing starter/VFD or disassembly job the motor leads will not be taped until the Carrier technician Megger tests the motor.)  b. Consult wiring diagram. Oil pump, heater, controls, and communication is per wiring diagrams.  c. Carrier controls can independently energize water pumps.  d. Line side voltage is within ±10% of chiller nameplate voltage.  e. Other	7.		ne machine's starter/VFD wiring is complete. The wiring is stalled per installation instructions and certified prints.		
and communication is per wiring diagrams.  c. Carrier controls can independently energize water pumps.  d. Line side voltage is within ±10% of chiller nameplate voltage.  e. Other		a.	starter/VFD or disassembly job the motor leads will not be taped until the Carrier technician Megger tests		
pumps.  d. Line side voltage is within ±10% of chiller nameplate voltage.  e. Other		b.	Consult wiring diagram. Oil pump, heater, controls, and communication is per wiring diagrams.		
voltage. e. Other		c.	1 , 5		
<ul> <li>8. The motor starter has not been supplied by Carrier. It has been installed according to the manufacturer's instructions.</li> <li>9. Inspect installation location. Does the starter/controls/VFD enclosure protection rating match the installation site environment?</li> <li>10. Note controls need to be powered for a substantial time prior to startup in order to obtain suitable oil temperature.</li> </ul>		d.			
has been installed according to the manufacturer's instructions.  9. Inspect installation location. Does the starter/controls/VFD enclosure protection rating match the installation site environment?  10. Note controls need to be powered for a substantial time prior to startup in order to obtain suitable oil temperature.		e.	Other		
enclosure protection rating match the installation site environment?  10. Note controls need to be powered for a substantial time prior to startup in order to obtain suitable oil temperature.	8.	ha	s been installed according to the manufacturer's		
	9.	en	closure protection rating match the installation site		
NOTE: NEMA Type 1 enclosures are constructed for indoor use to provide a degree of protection to personnel against incidental con-	10.	N	ote controls need to be powered for a substantial time prior to startup i	n order to obtain suitable oil ten	nperature.
with the enclosed equipment and to provide a degree of protection against falling dirt. This type of enclosure does not protect against, dust, moisture, or airborne contaminants.	with	the	enclosed equipment and to provide a degree of protection against fa	legree of protection to personnel Iling dirt. This type of enclosur	against incidental contact e does not protect agains

COMMENTS:

TES	TING	YES/NO	DATE TO BE
		•	COMPLETED
1.	The cooling tower fan has been checked for blade pitch and proper operation.		
2.	The chilled water and condenser water lines have been:	•	
	a. Filled		
	b. Tested		
	c. Flushed		
	d. Vented		
	e. Strainers cleaned		
3.	The chilled water and condenser water pumps have been checked for proper rotation and flow.		
4.	The following cooling load will be available for start-up:		
	a. 25%		
	b. 50%		
	c. 75%		
	d. 100%		
5.	Unless factory charged, the refrigerant charge is at the machine.		
6.	Services such as electrical power and control air will be available at start-up.		
7.	The electrical and mechanical representatives will be available to assist in commissioning the machine.		
8.	The customers operators will be available to receive instructions for proper operation of the chiller after start-up.		
9.	Is the building automation system complete and ready for use when the chiller is started?		
Cone	cerns about the installation/request for additional assistance:		
optio	aware that the start-up time for a Carrier chiller can take between 2 arons and accessories used with it.		
Phor	ne number		
	uil		
In ac	ccordance with our contract, we hereby request the services of your teriob on (Date). I understand that the technicians time we checklist that are incomplete.	chnician to render start-	up services per contract terms for
Sign	ature of Purchaser		
Sign	ature of Jobsite Supervisor		